

MARINA COAST WATER DISTRICT
2020 URBAN WATER MANAGEMENT PLAN
APPENDICES



Prepared by

Schaaf & Wheeler
CONSULTING CIVIL ENGINEERS

June 2021

LIST OF APPENDICES:

- A. Resolution of Urban Water Management Plan Adoption
- B. References
- C. Land Use Forecast and Water Demand Projections by Jurisdiction
- D. Notices and Letters to Public Agencies
- E. Technical Memoranda
 - 1. District Population Estimate, dated 4/26/2021
 - 2. Water Allocations by Jurisdiction, dated 4/30/2021
 - 3. MCWRA Zones of Benefit and Assessment, dated 4/30/2021
 - 4. MCWD Seismic Risk Assessment
- F. Water Shortage Contingency Plan with Resolution of Adoption
- G. DWR Urban Water Management Plan Checklist
- H. Standardized Data Tables and SB X7-7 Verification Form
- I. Voluntary Reporting of Energy Intensity
- J. Comments Received on the Draft Plan

Appendix A: Resolution Adopting the 2020 Urban Water Management Plan

June 21, 2021

Resolution No. 2021-35
Resolution of the Board of Directors
Marina Coast Water District
Adopting the Marina Coast Water District 2020 Urban Water Management Plan

RESOLVED by the Board of Directors (“Directors”) of the Marina Coast Water District (“District”), at a regular meeting duly called and held on June 21, 2021, via a videoconference pursuant to Governor Newsom’s Executive Order N-29-20, as follows:

WHEREAS, the California Legislature enacted Assembly Bill 797 (Water Code Section 10610 et seq, known as the Urban Water Management Plan Act) during the 1983-84 Regular session, and as amended subsequently, which mandates that every supplier providing water for municipal purposes to more than 3,000 customers or supplying more than 3,000 acre-feet of water annually, prepare an Urban Water Management Plan (UWMP), the primary objective of which is to plan for conservation and efficient use of water; and,

WHEREAS, the District is an urban supplier of water providing water to more than 3,000 customers; and, WHEREAS, the Plan must be adopted, after a public review and hearing, and must be filed with the California Department of Water Resources within thirty days of adoption; and,

WHEREAS, pursuant to Water Code §10642 the District mailed notices to affected cities and to Monterey County Water Resources Agency in January 2021, solicited input from affected land use jurisdictions in which the District serves water, prepared and circulated the 2020 UWMP in May 2021, publicly noticed and conducted a public hearing on the 2020 UWMP on June 21, 2021; and,

WHEREAS, pursuant to Water Code §10632, the UWMP must also contain a Water Shortage Contingency Plan, which the Board of Directors has adopted by separate resolution; and,

WHEREAS, copies of the adopted 2020 UWMP will be transmitted to land use jurisdictions in which the District serves water, the Monterey County Water Resources Agency, and the plan shall be made available on the District’s website.

NOW, THEREFORE, BE IT RESOLVED, that the Board of Directors of the Marina Coast Water District does hereby:

1. Approves and adopts the 2020 Urban Water Management Plan, and,
2. Authorizes and directs the General Manager to file the 2020 Urban Water Management Plan with the California Department of Water Resources within 30 days after this date; and,
3. Authorizes and directs the General Manager to make such revisions and edits to the 2020 Urban Water Management Plan as the General Manager determines to be in the best interests of the District.

PASSED AND ADOPTED on June 21, 2021, by the Board of Directors of the Marina Coast Water District by the following roll call vote:

Ayes: Directors Morton, Zefferman, Moore, Shriner

Noes: Directors None


Absent: Directors Cortez

Abstained: Directors None



Jan Shriner, President


ATTEST:

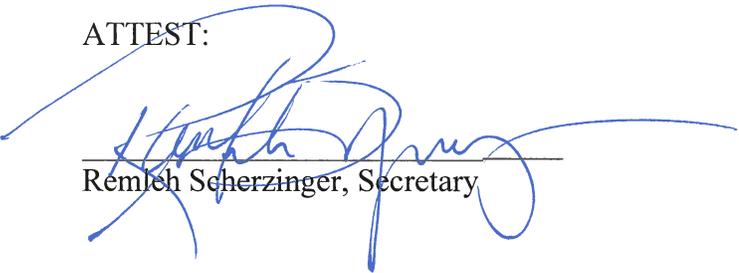

Remleh Scherzinger, Secretary

CERTIFICATE OF SECRETARY

The undersigned Secretary of the Board of the Marina Coast Water District hereby certifies that the foregoing is a full, true and correct copy of Resolution No. 2021-35 adopted June 21, 2021.



Remleh Scherzinger, Secretary

Appendix B: References

Akel Engineering Group:

Marina Coast Water District, Water Master Plan, May 29, 2020

Marina Coast Water District, Recycled Water Master Plan, May 29, 2020

Association of Monterey Bay Area Governments, 2022 Regional Growth Forecast, November 18, 2020

Brown & Caldwell, State of the Salinas River Groundwater Basin, January 2015.

Byron Buck & Associates, Marina Coast Water District 2005 Urban Water Management Plan, December 2005.

California American Water Company:

Coastal Water Project, Final Environmental Impact Report, prepared for the California Public Utilities Commission, October 2009

Monterey Peninsula Water Supply Project, Final Environmental Impact Report, prepared for the California Public utilities Commission, March 2018

California Department of Finance website, www.dof.ca.gov, population estimate tables:

Report E-1 Population Estimates for Cities, Counties and the State, January 1, 2019 and 2020

Report E-4 Population Estimates for Cities, Counties and the State, 2011-2020, with 2010 Benchmark

Report P-2A, Total Estimated and Projected Population for California and Counties: July 1, 2010 to 2060, published March 2021

California Department of Water Resources:

20x2020 Water Conservation Plan, February 2010.

California Irrigation Management Information System (CIMIS) website

2020 Urban Water Management Plan, Guidebook for Urban Water Suppliers, March 2021.

Methodologies for Calculating Baseline and Compliance Urban Per Capita Water Use, October 1, 2010.

Model Water Efficient Landscape Ordinance, September 10, 2009

Water Audit Manual, February 2016

California State University, Monterey Bay

Master Plan, December 2007

Draft Comprehensive Master Plan, June 2017

California Urban Water Conservation Council.

BMP Costs and Savings Study. 2003.

Memorandum of Understanding Regarding Urban Water Conservation in California, As Amended June 9, 2010

City of Del Rey Oaks:

Redevelopment Plan, Former Fort Ord Redevelopment Area, 2001

Housing Element, December 2019

City of Marina:

2000 General Plan, Adopted October 21, 2000, Amended through August 2010.

Midterm Review of the 2015-2023 Housing Element, December 2019

City of Seaside:

Midterm Review of the 2015-2023 Housing Element, October 2019

Redevelopment Agency of the City of Seaside, Implementation Plan, 2007 – 2012, Seaside-Fort Ord Redevelopment Project Area, January 17, 2008

County of Monterey:

2010 Monterey County General Plan, October 26, 2010

2015-2023 Housing Element, adopted November 2015

Monterey County Multi-Jurisdictional Hazard Mitigation Plan, June 2015

Denise Duffy & Associates in association with RBF Consulting. Draft Environmental Impact Report Regional Urban Water Augmentation Project. June 2004.

Denise Duffy & Associates in association with RBF Consulting. Final Environmental Impact Report Regional Urban Water Augmentation Project. September, 2004, with amendments in 2006, 2007 and 2016.

Denise Duff & Associates, et. al. Final Draft Groundwater Inventory and Status Report. March 18, 2004.

EKI Environmental and Water, Inc, Water Augmentation Alternatives Study, Former Fort Ord Area, Monterey County, CA, June 2020.

Engeo Incorporated, Assessment of Erosion Rates, MCWD Regional Water augmentation Desalination Plant, October 30, 2006

Fort Ord Reuse Authority:

Capital Improvement Program, FY 2019/20 through FY 2028/2029, May 2019, including annual development projection update for 2019/20

Fort Ord Reuse Plan, 1996.

Reuse Plan EIR, 1997.

Assignment of Easements on the Former Fort Ord and Ord Military Community, County of Monterey, and Quitclaim Deed for Water and Wastewater Systems, between Fort Ord Reuse Authority (Grantor) and Marina Coast Water District (Grantee), October 24, 2001

Geoscience Support Services, Inc

Monterey Peninsula Water Supply Project, Groundwater Modeling and Analysis, prepared for California American Water, April 2015

Monterey Peninsula Water Supply Project, Hydrogeologic Investigation, Technical Memorandum (TM-1) Summary of Results - Exploratory Boreholes, prepared for California American Water, July 2014

Monterey Peninsula Water Supply Project, Test Slant Well Long Term Pumping Monitoring Reports, prepared for California American Water, May 2015 thru May 2016

Monterey Peninsula Water Supply Project, Test Slant Well Long Term Pumping Monthly Monitoring Reports, prepared for California American Water, May 2015 thru May 2016

Technical Memorandum - Monterey Peninsula Water Supply Project, Baseline Water And Total Dissolved Solids Levels Test Slant Well Area, Submitted To The Hydrogeologic Working Group, prepared for California American Water, April 2015

GRC Redevelopment Consultants, Implementation Plan 2007-2012 for the Seaside – Fort Ord Redevelopment Project Area, prepared for the Redevelopment Agency of the City of Seaside, January 17, 2008.

Hopkins Groundwater Consultants, Inc., Technical Memorandum: North Marina Area Groundwater Data and Conditions, prepared for Marina Coast Water District, May 2016

Keyser Marston Associates, Inc., Implementation Plan for the Fort Ord Redevelopment Project Area, prepared for the Redevelopment Agency of Monterey County, March 2007

LAFCO of Monterey County, 2019 Municipal Services Review and Sphere of Influence Study: Marina Coast Water District, April 2019

Mactec Engineering and Consulting Inc. Former Fort Ord Environmental Cleanup. Fortordcleanup.com. 2005.

Marina Coast Water District:

2020 Consumer Confidence Report for Central Marina and Ord Community, April 2021

Comprehensive Annual Financial Report for the Fiscal Year Ended June 30, 2020, approved December 14, 2020

Water Supply Assessment and Written Verification of Supply for the Marina Heights Specific Plan, prepared with Byron Buck & Associates, December 15, 2003.

Water Supply Assessment and Written Verification of Supply for the Proposed East Garrison Specific Plan Development, prepared with Byron Buck & Associates, June 3, 2004.

Water Supply Assessment and Written Verification of Supply for the Proposed University Villages Specific Plan Development and Marina Community Partners Project, prepared with Byron Buck & Associates, January 26, 2005.

Water Supply Assessment and Written Verification of Supply for the Proposed Marina Station Project, prepared with Byron Buck & Associates, January 4, 2006.

Water Supply Assessment and Written Verification of Supply for the Proposed Cypress Knolls Residential Project, prepared with Byron Buck & Associates, March 22, 2006.

Water Supply Assessment and Written Verification of Supply for the Proposed Resort at Del Rey Oaks, prepared with Byron Buck & Associates, December 2007.

Water Supply Assessment and Written Verification of Supply for the City of Seaside Amended Main Gate Specific Plan, prepared with Schaaf & Wheeler, December 2018.

Water Supply Assessment and Written Verification of Supply for the City of Seaside Campus Town Specific Plan, prepared with Schaaf & Wheeler, June 2018.

Water Supply Assessment for the City of Marina Downtown Vitalization Specific Plan, prepared with Schaaf & Wheeler, April 2020.

Water Supply Assessment and Written Verification of Supply for the Marina Municipal Airport Business and Industrial Park/UC MBEST Center Specific Plan, prepared with Schaaf & Wheeler, April 2020.

Well 34 Basis of Design Report, Martin B. Feeney, Consulting Hydrogeologist, September 21, 2009

Quarterly Water Consumption Report, period ending: December 31, 2020.

Monterey County Water Resources Agency:

Agreement between the United States of America and the Monterey County Water Resources Agency concerning Annexation of Fort Ord into Zones 2 and 2A of the Monterey County Water Resources Agency, Agreement No. A-06404, September 21, 1993.

Annexation Agreement and Groundwater Mitigation Framework for Marina Area Lands (1996). Document recorded in the Office of the Monterey County Recorder on August 7, 1996, at Reel 3404 Page 749.

Environmental Impact Report/Environmental Impact Statement for the Salinas Valley Water Project. June 2001.

Final Report, Hydrogeologic Investigation of the Salinas Valley Basin in the Vicinity of Fort Ord and Marina, Salinas Valley, California, prepared by Harding ESE, April 2001

Groundwater Extraction Summary Reports for years 2010 through 2019.

Monterey County Groundwater Management Plan, May 2006

Salinas Valley Integrated Regional Water Management Functionally Equivalent Plan, prepared by RMC Water and Environment, May 2006

Salinas Valley Water Project Engineer's Report, prepared by RMC Water and Environment, January 2003

Recommendations to Address the Expansion of Seawater Intrusion in the Salinas Valley Groundwater Basin, October 2017

Well Locations Report, December 2020

Marina Coast Water District Groundwater Sustainability Agency

Draft Salinas Valley Groundwater Basin, Monterey Subbasin Groundwater Sustainability Plan, prepared jointly with the Salinas Valley Groundwater Sustainability Agency, January 2021

Monterey One Water (formerly Monterey Regional Water Pollution Control Agency)

Consolidated Final Environmental Impact Report for the Pure Water Monterey Groundwater Replenishment Project, prepared by Denise Duffy & Associates, adopted October 2015

Pure Water Delivery and Supply Agreement between MRWPCA and MCWD, April 2016

Monterey Peninsula Water Management District, Monterey Peninsula, Carmel Bay, and South Monterey Bay Integrated Regional Water Management Plan Update, September 2019

RBF Consulting. Water Conservation Feasibility Study Draft. September 2003.

RBF Consulting. Regional Urban Recycled Water Distribution Project. 2003.

RMC Water and Environment, MCWD Recycled Water Project Basis of Design Report, 2006

Regional Water Management Group, Integrated Regional Water Management Plan for the Greater Monterey County Area, updated September 2018

Salinas Valley Groundwater Sustainability Agency

Salinas Valley Groundwater Basin, 180/400-Foot Aquifer Subbasin Groundwater Sustainability Plan, prepared by Montgomery & Associates, January 2020

Schaaf & Wheeler, Consulting Civil Engineers

Marina Coast Water District 2010 Urban Water Management Plan, June 2011.

Marina Coast Water District 2015 Urban Water Management Plan, June 2016.

WRIME. Deep Aquifer Investigative Study. May, 2003.

United States Census Bureau, American FactFinder website, www.census.gov

2010 Decennial Census Redistricting Data, Table GCT-PL2: California Population and Housing Occupancy Status - County - Census Tract

2020 Census - Census Tract Reference Map: Monterey County, CA

Appendix C: Land Use Forecast and Water Demand Projections by Jurisdiction

The following tables present the water demand projects for the Marina Coast Water District, based upon the development and redevelopment projections provided by the various jurisdictions. Water demands are estimated as a function of the size (acreage/square footage) or number of units of a development, depending on the type of land use, and a water demand unit factor that corresponds to that use. For each type of land use, Demand = Size x Unit Factor.

- Existing demands are from estimated from MCWD's 2020 water usage records for each jurisdictional area.
- For developments that have approved Specific Plans, the water demand factors and total water demand estimates have been taken from the respective Water Supply Assessments (WSAs) for these Specific Plan areas.
- For in-fill development under approved General Plans or Master Plans (e.g., the City of Marina, CSUMB), MCWD's standard water demand factors have been used with the in-fill land use projections provided by the jurisdiction.
- For the Ord Community, the initial development forecast was based upon the Fort Ord Reuse Authority's latest annual growth forecast, which is developed for CIP planning. The projected developments, generally by square footage or units, are then multiplied by the appropriate unit demand factors.
- The in-fill rate for Central Marina reflects the updated projection by the City Planning Department included in the WSA for the Marina Downtown Vitalization Specific Plan.

Based upon the housing projections in the water demand tables, population projections were then developed. In-fill development was assumed to have the same number of persons per dwelling unit as the existing area. For new development, if the specific plan, the water supply assessment or the associated Environmental Impact Report projected a number of persons per housing unit, that factor was used. If a persons-per-dwelling-unit estimate did not exist, the new development was assumed to have the same occupancy as the city average.

Tables:

C1: 2020 Water Demand Projections by Jurisdiction

C2: 2015 Water Demand Projections by Jurisdiction

C3: Water Demand Projection Details

C4: Population Growth Projections by Jurisdiction

C5: Population Growth Projection Details

C6: Projected Demands by Source, with Planned Recycled Water Use

Marina Coast Water District, 2020 Urban Water Management Plan

Table C1: 2020 Water Demand by Jurisdiction (AFY)

	Jurisdiction	2020	2025	2030	2035	2040	Notes	Allocation
Ord	U.S. Army	409	461	471	471	471		1,562
	CSUMB	318	421	616	821	977	1	1,035
	Del Rey Oaks	0	31	224	238	238		243
	City of Monterey	0	0	130	130	130		65
	County of Monterey	227	436	436	522	522		720
	UCMBEST	1	116	335	377	408		230
	City of Seaside	339	839	1,032	1,435	1,698		1,012
	State Parks and Rec.	0	7	9	9	9		45
	Marina Ord Comm.	446	1,125	1,638	1,757	1,809		1,340
	Assumed Line Loss	190	348	348	348	348		348
Marina	Armstrong Ranch	0	550	680	680	680		920
	CEMEX	0	10	10	10	10		500
	Marina Central	1,438	1,656	1,874	2,081	2,284		3,020
Subtotal - Ord		1,929	3,784	5,239	6,108	6,610		6,600
Subtotal - Marina		1,438	2,217	2,563	2,771	2,974		4,440
Total		3,367	6,001	7,802	8,879	9,584		11,040

1. CSUMB Campus closed for most of 2020 due to COVID-19 restrictions, so the 2018 campus usage is assumed as the baseline demand.

Table C2: 2015 UWMP Water Demand by Jurisdiction (AFY)

	Jurisdiction	2015	2020	2025	2030	2035		Allocation
Ord	U.S. Army	633	663	825	825	825		1,577
	CSUMB	404	442	632	755	779		1,035
	Del Rey Oaks	0	186	551	551	551		243
	City of Monterey	0	0	130	130	130		65
	County of Monterey	52	377	539	539	539		720
	UCMBEST	3	94	299	515	515		230
	City of Seaside	657	992	1,183	1,497	1,960	2,3	1,012
	State Parks and Rec.	0	12	18	20	25		45
	Marina Ord Comm.	285	901	1,572	1,702	1,704	4	1,325
	Assumed Line Loss	348	348	348	348	348		348
Marina	Armstrong Ranch	0	0	680	680	680		920
	Cemex	0	0	0	0	500		500
	Marina Central	1,419	1,600	1,896	2,196	2,488	5	3,020
Subtotal - Ord		2,382	4,016	6,098	6,882	7,376		6,600
Subtotal - Marina		1,419	1,600	2,576	2,876	3,668		4,440
Total		3,801	5,616	8,674	9,758	11,044		11,040

2. Includes Seaside Resort Golf Course use in 2015 (temporary use).
3. Values revised to remove Monterey Downs project per the Campus Town WSA (2018).
4. Revised allocation to reflect groundwater only. Supply from pilot desal plant removed.
5. Projection revised per the Marina Downtown Vitalization Specific Plan WSA.

Marina Ord	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
New Residential																							
Sea Haven																							
Townhome	MAR	Dwelling Units	12	13	13	13	13	13	13	12													
Cluster Market/Bridge	MAR	Dwelling Units	47	19	19	19	19	19	19	18													
Market A	MAR	Dwelling Units	39	29	29	29	29	29	29	33													
Market B	MAR	Dwelling Units	-	34	34	34	34	34	34	33													
Estates	MAR	Dwelling Units	-	13	12	12	12	12	12	12	-												
Landscaping (Turf)	MAR	Acres	0.7	0.3	0.3	0.3	0.3	0.3	0.3	0.3													
Landscaping (Non-Turf)	MAR	Acres	0.5	0.2	0.2	0.2	0.1	0.1	0.1	0.1													
Cypress Knolls Specific Plan Area																							
SF Home / Townhome	MAR	Dwelling Units								255	200		141										
Apartments	MAR	Dwelling Units								85			31										
Assisted Living	MAR	Dwelling Units											60										
Open Space	MAR	Acres								28.57													
Parklands	MAR	Acres								2.17													
Right of Way	MAR	Acres								27.79			5.51										
Dunes on Monterey Bay																							
Alley (small lot)	MAR	Dwelling Units	44	54	59	37																	
Carriage	MAR	Dwelling Units		18	30	47																	
Standard	MAR	Dwelling Units		44	6																		
Standard (small lot)	MAR	Dwelling Units		48	23																		
Duets	MAR	Dwelling Units		62	88	40	60	4															
Townhome (live-work)	MAR	Dwelling Units		50	50	39																	
Townhome (mixed use)	MAR	Dwelling Units		8	8	8																	
Apartments (completed)	MAR	Dwelling Units																					
Landscaping (MCP)	MAR	Acres		5.00	5.00	4.20																	
Landscaping (other)	MAR	Acres		4.00	2.10																		
VTC Supportive Housing																							
	MAR	Dwelling Units		71																			
Non Residential																							
SVMHS Development	MAR	Square Feet								10,000	15,000	15,000	16,000										
TAMC TOD (office/public facilities)	MAR	Square Feet															20,000	20,000					
Airport Specific Plan - Commercial/Mixed Use	MAR	Square Feet	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	2,290	
Airport Specific Plan - Business Aviation	MAR	Square Feet	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	12,030	
Airport Specific Plan - Business Park	MAR	Square Feet	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	28,640	
Airport Specific Plan - Landscape	MAR	Acres	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	
Cypress Knolls Community Center	MAR	Square Feet																			16,525		
Cypress Knolls Support Services	MAR	Square Feet																			6,300		
TAMC TOD (retail)	MAR	Square Feet															37,500	37,500					
Marina Airport Hotel/Golf	MAR	Rooms																					
Marina High School Theater	MAR	Square Feet								16,000													
Imjin Office Park (completed)	MAR	Square Feet																					
Monterey Peninsula College	MAR	Square Feet																					
UV - Planning Area A	MAR	Square Feet			20,000	16,000																	
UV - Planning Area J	MAR	Square Feet						3,000	55,000	8,000	17,000												
UV - Planning Area B1	MAR	Square Feet		25,000					114,000	15,000	10,000	35,000	10,000										
UV - Planning Area V	MAR	Square Feet								12,000	5,000	2,000	5,500										
UV - Planning Area OP (1-5)	MAR	Square Feet		150,000							300,000	253,000	82,000	170,000	95,000								
UV - Planning Area T	MAR	Rooms		108																			
UV - Planning Area Z	MAR	Square Feet											8,500	5,000	5,000	1,500							

UV = University Villages, now Dunes on Monterey Bay

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Sea Haven					
Townhome	Residential (8-15 units / acre)	102	Dwelling Units	0.25	
Cluster Market/Bridge	Residential (8-15 units / acre)	179	Dwelling Units	0.25	
Market A	SF Residential (5-8 units / acre)	246	Dwelling Units	0.33	
Market B	SF Residential (5-8 units / acre)	237	Dwelling Units	0.33	
Estates	SF Residential (< 5 units / acre)	85	Dwelling Units	0.5	
Landscaping (Turf)	Landscape (turf)	2.8	Acres	2.5	
Landscaping (Non-Turf)	Landscape (non-turf)	1.5	Acres	1.5	1
Cypress Knolls					
SF Home / Townhome	SF Residential (5-8 units / acre)	596	Dwelling Units	0.1319	1
Apartments	Multi family (> 15 units / acre)	116	Dwelling Units	0.1507	1
Assisted Living	Multi family (> 15 units / acre)	60	Dwelling Units	0.1672	1
Open Space	Landscape (non-turf)	28.57	Acres	0.5849	1
Parklands	Landscape (turf)	2.17	Acres	1.1244	1
Right of Way	Landscape (non-turf)	33.3	Acres	0.4586	1
Dunes on Monterey Bay					
Alley (small lot)	Residential (8-15 units / acre)	194	Dwelling Units	0.20572165	1
Carriage	Residential (8-15 units / acre)	95	Dwelling Units	0.34094737	1
Standard	SF Residential (5-8 units / acre)	50	Dwelling Units	0.687	1
Standard (small lot)	Residential (8-15 units / acre)	71	Dwelling Units	0.44056338	1
Duets	SF Residential (5-8 units / acre)	254	Dwelling Units	0.17173228	1
Townhome (live-work)	Residential (8-15 units / acre)	139	Dwelling Units	0.12791367	1
Townhome (mixed use)	Residential (8-15 units / acre)	24	Dwelling Units	0.16375	1
Apartments (completed)	Multi family (> 15 units / acre)		Dwelling Units	0.12185185	1
Landscaping (MCP)	Landscape (non-turf)	14.2	Acres	1.66197183	1
Landscaping (other)	Landscape (non-turf)	6.1	Acres	1.47540984	1
VTC Supportive Housing					
	Residential (8-15 units / acre)	71	Dwelling Units	0.25	
Non Residential					
SVMHS Development	Office / R&D	56000	Square Feet	0.000135	
TAMC TOD (office/public facilities)	Office / R&D	40000	Square Feet	0.000135	
Airport Specific Plan - Commercial/Mixed Use	Other Commercial	45800	Square Feet	0.0003	
Airport Specific Plan - Business Aviation	Light Industrial	240600	Square Feet	0.00015	
Airport Specific Plan - Business Park	Office / R&D	572800	Square Feet	0.000135	
Airport Specific Plan - Landscape	Landscape (non-turf)	8.6	Acres	2.1	
Cypress Knolls Community Center	Various	16525	Square Feet	0.001	1
Cypress Knolls Support Services	Office / R&D	6300	Square Feet	0.001	1
TAMC TOD	Retail	75000	Square Feet	0.00021	
Marina Airport Hotel/Golf	Hotel, Motel and Timeshares		Rooms	0.11	1
Marina High School Theater	Schools (K-12)	16000	Square Feet	0.0003	
Imjin Office Park (completed)	Office / R&D		Square Feet	0.000135	
Monterey Peninsula College	Higher Education		Square Feet	0.00002	
UV - Planning Area A	Various	36000	Square Feet	0.00298361	1
UV - Planning Area J	Various	83000	Square Feet	0.00040458	1
UV - Planning Area B1	Various	209000	Square Feet	0.00037813	1
UV - Planning Area V	Various	24500	Square Feet	0.00067102	1
UV - Planning Area OP (1-5)	Various	1050000	Square Feet	0.00020227	1
UV - Planning Area T	Various	108	Rooms	0.28703704	1
UV - Planning Area Z	Various	20000	Square Feet	0.000683	1

Jurisdiction	Incremental Demand (AFY)			
	2025	2030	2035	2040
	19.25	6.25	0.00	0.00
	35.50	9.25	0.00	0.00
	60.72	20.46	0.00	0.00
	56.10	22.11	0.00	0.00
	30.50	12.00	0.00	0.00
	5.50	1.50	0.00	0.00
	1.95	0.30	0.00	0.00
Marina Ord Comm.	209.52	71.87	0.00	0.00
	0.00	78.62	0.00	0.00
	0.00	17.48	0.00	0.00
	0.00	10.03	0.00	0.00
	0.00	16.71	0.00	0.00
	0.00	2.44	0.00	0.00
	0.00	15.27	0.00	0.00
Marina Ord Comm.	0.00	140.55	0.00	0.00
	39.91	0.00	0.00	0.00
	32.39	0.00	0.00	0.00
	34.35	0.00	0.00	0.00
	31.28	0.00	0.00	0.00
	43.62	0.00	0.00	0.00
	17.78	0.00	0.00	0.00
	3.93	0.00	0.00	0.00
	0.00	0.00	0.00	0.00
	23.60	0.00	0.00	0.00
	9.00	0.00	0.00	0.00
Marina Ord Comm.	235.86	0.00	0.00	0.00
Marina Ord Comm.	17.75	0.00	0.00	0.00
Marina Ord Comm.	0.00	7.56	0.00	0.00
Marina Ord Comm.	0.00	0.00	5.40	0.00
Marina Ord Comm.	3.44	3.44	3.44	3.44
Marina Ord Comm.	9.02	9.02	9.02	9.02
Marina Ord Comm.	19.33	19.33	19.33	19.33
Marina Ord Comm.	4.52	4.52	4.52	4.52
Marina Ord Comm.	0.00	0.00	0.00	9.22
Marina Ord Comm.	0.00	0.00	0.00	6.31
Marina Ord Comm.	0.00	0.00	15.75	0.00
Marina Ord Comm.	0.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	4.80	0.00	0.00
Marina Ord Comm.	0.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	0.00	0.00	0.00
Marina Ord Comm.	107.41	0.00	0.00	0.00
Marina Ord Comm.	1.21	32.37	0.00	0.00
Marina Ord Comm.	9.45	69.58	0.00	0.00
Marina Ord Comm.	0.00	16.44	0.00	0.00
Marina Ord Comm.	30.34	128.44	53.60	0.00
Marina Ord Comm.	31.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	5.81	7.85	0.00

Cumulative Demand (AFY)				
2025	2030	2035	2040	
19.25	25.50	25.50	25.50	
35.50	44.75	44.75	44.75	
60.72	81.18	81.18	81.18	
56.10	78.21	78.21	78.21	
30.50	42.50	42.50	42.50	
5.50	7.00	7.00	7.00	
1.95	2.25	2.25	2.25	
209.52	281.39	281.39	281.39	
0.00	78.62	78.62	78.62	
0.00	17.48	17.48	17.48	
0.00	10.03	10.03	10.03	
0.00	16.71	16.71	16.71	
0.00	2.44	2.44	2.44	
0.00	15.27	15.27	15.27	
0.00	140.55	140.55	140.55	
39.91	39.91	39.91	39.91	
32.39	32.39	32.39	32.39	
34.35	34.35	34.35	34.35	
31.28	31.28	31.28	31.28	
43.62	43.62	43.62	43.62	
17.78	17.78	17.78	17.78	
3.93	3.93	3.93	3.93	
0.00	0.00	0.00	0.00	
23.60	23.60	23.60	23.60	
9.00	9.00	9.00	9.00	
235.86	235.86	235.86	235.86	
17.75	17.75	17.75	17.75	
0.00	7.56	7.56	7.56	
0.00	0.00	5.40	5.40	
3.44	6.87	10.31	13.74	
9.02	18.05	27.07	36.09	
19.33	38.66	58.00	77.33	
4.52	9.03	13.55	18.06	
0.00	0.00	0.00	9.22	
0.00	0.00	0.00	6.31	
0.00	0.00	15.75	15.75	
0.00	0.00	0.00	0.00	
0.00	4.80	4.80	4.80	
0.00	0.00	0.00	0.00	
0.00	0.00	0.00	0.00	
107.41	107.41	107.41	107.41	
1.21	33.58	33.58	33.58	
9.45	79.03	79.03	79.03	
0.00	16.44	16.44	16.44	
30.34	158.78	212.38	212.38	
31.00	31.00	31.00	31.00	
0.00	5.81	13.66	13.66	

Armstrong Ranch	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
New Residential																							
Marina Station																							
Single Family Homes (15,000)	MAR	Dwelling Units				23	87	37															
Single Family Homes (6,500)	MAR	Dwelling Units				100	250	220	99														
Apartments	MAR	Dwelling Units				100	250	220	78														
Irrigated parkland	MAR	Acres				6.0	6.5																
Open Space (turf)	MAR	Acres				4.3																	
Non Residential																							
Marina Station																							
Mixed Use Retail	MAR	Square Feet					15,000	30,000	15,000														
Office Uses	MAR	Square Feet					40,000	60,000	43,808														
Light Industrial	MAR	Square Feet						300,000	351,624														
Landscape (15% of indoor consumption)	MAR	Square Feet																					
System Loss (5%)	MAR	Square Feet																					

CEMEX	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
Non Residential																							
Visitor Cener	MAR	Square Feet						33,300															

Marina Central	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
New Residential																							
In-Fill Development MF	MAR	Dwelling Units						50					50				50						39
In-Fill Development SF	MAR	Dwelling Units		10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
Downtown Specific Plan (over 30 years)	MAR	Dwelling Units		97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97
Non Residential																							
Hotel / Motel	MAR	Rooms						90					90										
RV Park	MAR	Spaces	24																				
Other Commercial	MAR	Square Feet						34650					34650				34650						34571
Institutional	MAR	Square Feet																					
Schools	MAR	Square Feet																					
Landscape (non-turf)	MAR	Acres						1					1				1						0.53
Downtown Specific Plan - Office	MAR	Square Feet		17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020	17020
Downtown Specific Plan - Retail / Comemrcial	MAR	Square Feet		29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160	29160

Monterey County	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
New Residential																							
East Garrison I																							
Market Rate	MCO	Dwelling Units	143	125	177	79	77																
Affordable	MCO	Dwelling Units																					
Non Residential																							
Monterey County Office																							
Intergarrison Rd Office Park	MCO	Square Feet												127,200	127,200	127,200	127,200	127,000					
East Garrison I Office Development	MCO	Square Feet		24,000	24,000	20,000																	
Monterey County Light Ind.																							
Monterey County Retail																							
East Garrison I Retail	MCO	Square Feet		20,000	14,000																		
Monterey County Landscaping																							
East Garrison Landscaping	MCO	Acres			5																		

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Marina Station					
Single Family Homes (15,000)	SF Residential (< 5 units / acre)	147	Dwelling Units	0.5	
Single Family Homes (6,500)	SF Residential (5-8 units / acre)	669	Dwelling Units	0.33	
Apartments	Multi family (> 15 units / acre)	648	Dwelling Units	0.25	
Irrigated parkland	Landscape (turf)	12.5	Acres	2.5	
Open Space (turf)	Landscape (turf)	4.3	Acres	2.5	
Non Residential					
Marina Station					
Mixed Use Retail	Retail	60000	Square Feet	0.00021	
Office Uses	Office / R&D	143808	Square Feet	0.000135	
Light Industrial	Light Industrial	651624	Square Feet	0.00015	
Landscape (15% of indoor consumption)	Landscape (non-turf)		Square Feet	2.1	
System Loss (5%)			Square Feet		1

	Incremental Demand (AFY)			
	2025	2030	2035	2040
	73.50	0.00	0.00	0.00
	188.10	32.67	0.00	0.00
	142.50	19.50	0.00	0.00
	31.25	0.00	0.00	0.00
	10.75	0.00	0.00	0.00
Armstrong Ranch	446.10	52.17	0.00	0.00

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	73.50	73.50	73.50	73.50
	188.10	220.77	220.77	220.77
	142.50	162.00	162.00	162.00
	31.25	31.25	31.25	31.25
	10.75	10.75	10.75	10.75
Armstrong Ranch	446.10	498.27	498.27	498.27

Armstrong Ranch	9.45	3.15	0.00	0.00
Armstrong Ranch	13.50	5.91	0.00	0.00
Armstrong Ranch	45.00	52.74	0.00	0.00
Armstrong Ranch	10.19	9.27	0.00	0.00
Armstrong Ranch	26.21	6.16	0.00	0.00

	9.45	12.60	12.60	12.60
	13.50	19.41	19.41	19.41
	45.00	97.74	97.74	97.74
	10.19	19.46	19.46	19.46
	26.21	32.37	32.37	32.37

Land Use Type	Land Use	Total	Units	Multiplier	Notes
Non Residential					
Visitor Center	Institutional	33300	Square Feet	0.0003	

	Incremental Demand (AFY)			
	2025	2030	2035	2040
CEMEX	9.99	0.00	0.00	0.00

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	9.99	9.99	9.99	9.99

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
In-Fill Development MF	Multi family (> 15 units / acre)	189	Dwelling Units	0.25	
In-Fill Development SF	Residential (8-15 units / acre)	200	Dwelling Units	0.25	
Downtown Specific Plan	Multi family (> 15 units / acre)	1940	Dwelling Units	0.25	2
Non Residential					
Hotel / Motel	Hotel, Motel and Timeshares	180	Rooms	0.11	
RV Park	Other	24	Spaces	0.065	
Other Commercial	Other Commercial	138521	Square Feet	0.0003	
Institutional	Institutional		Square Feet	0.0003	
Schools	Schools (K-12)		Square Feet	0.0003	
Landscape (turf)	Landscape (non-turf)	3.53	Acres	2.1	
Downtown Specific Plan - Office	Office / R&D	340400	Square Feet	0.000135	2
Downtown Specific Plan - Retail / Commercial	Other Commercial	583200	Square Feet	0.0002538	2

	Incremental Demand (AFY)			
	2025	2030	2035	2040
Marina Central	12.50	12.50	12.50	9.75
Marina Central	12.50	12.50	12.50	12.50
Marina Central	121.25	121.25	121.25	121.25

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	12.50	25.00	37.50	47.25
	12.50	25.00	37.50	50.00
	121.25	242.50	363.75	485.00

Marina Central	9.90	9.90	0.00	0.00
Marina Central	1.56	0.00	0.00	0.00
Marina Central	10.40	10.40	10.40	10.37
Marina Central	0.00	0.00	0.00	0.00
Marina Central	0.00	0.00	0.00	0.00
Marina Central	2.10	2.10	2.10	1.11
Marina Central	11.49	11.49	11.49	11.49
Marina Central	37.00	37.00	37.00	37.00

	9.90	19.80	19.80	19.80
	1.56	1.56	1.56	1.56
	10.40	20.79	31.19	41.56
	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00
	2.10	4.20	6.30	7.41
	11.49	22.98	34.47	45.95
	37.00	74.01	111.01	148.02

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
East Garrison					
Market rate	SF Residential (< 5 units / acre)	601	Dwelling Units	0.3	1
Affordable	SF Residential (5-8 units / acre)		Dwelling Units	0.186	1
Non Residential					
Monterey County Office					
Intergarrison Rd Office Park	Office / R&D	635800	Square Feet	0.000135	
East Garrison I Office Development	Office / R&D	68000	Square Feet	0.000135	
Monterey County Light Ind.					
	Light Industrial			0.00015	
Monterey County Retail					
East Garrison I Retail	Retail	34000	Square Feet	0.00021	
Monterey County Landscaping					
East Garrison Landscaping	Landscape (turf)	5	Acres	2.5	

	Incremental Demand (AFY)			
	2025	2030	2035	2040
	180.30	0.00	0.00	0.00
	0.00	0.00	0.00	0.00
County of Monterey	180.30	0.00	0.00	0.00

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	180.30	180.30	180.30	180.30
	0.00	0.00	0.00	0.00
County of Monterey	180.30	180.30	180.30	180.30

County of Monterey	0.00	0.00	85.83	0.00
County of Monterey	9.18	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00
County of Monterey	7.14	0.00	0.00	0.00
County of Monterey	0.00			
County of Monterey	12.50	0.00	0.00	0.00

	0.00	0.00	85.83	85.83
	9.18	9.18	9.18	9.18
	0.00	0.00	0.00	0.00
	7.14	7.14	7.14	7.14
	12.50	12.50	12.50	12.50

CSUMB	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
New Residential																							
CSUMB Housing (CSU Corporation)	CSUMB	Dwelling Units							70	70	70	70	70	70	70	70	70	70	70	70	70	70	45
Student Housing Phase 2B	CSUMB	Beds				400																	
Student Housing Phase 3	CSUMB	Beds						600															
Student Housing Phase 4	CSUMB	Beds								600													
Student Housing Phase 5	CSUMB	Beds										600											
Student Housing Phase 6	CSUMB	Beds												600									
Student Housing Phase 7	CSUMB	Beds														600							
Student Housing Phase 8	CSUMB	Beds															600						
Student Housing Phase 9	CSUMB	Beds																		600			
Student Housing Phase 10	CSUMB	Beds																				600	
Student Housign Landscape 2B	CSUMB	Square Feet				160,000																	
Student Housign Landscape 3	CSUMB	Square Feet						240000															
Student Housign Landscape 4	CSUMB	Square Feet								200,000													
Student Housign Landscape 5	CSUMB	Square Feet										200000											
Student Housign Landscape 6	CSUMB	Square Feet												200,000									
Student Housign Landscape 7	CSUMB	Square Feet														200,000							
Student Housign Landscape 8	CSUMB	Square Feet															200,000						
Student Housign Landscape 9	CSUMB	Square Feet																		200,000			
Student Housign Landscape 10	CSUMB	Square Feet																				200000	
Non Residential																							
Student Union (Phase I)	CSUMB	Square Feet		70,360																			
Academic III	CSUMB	Square Feet		48,032																			
Storage Facility	CSUMB	Square Feet			50,000																		
Panetta Institute	CSUMB	Square Feet				63,695																	
Academic IV	CSUMB	Square Feet				72,200																	
Demolish bldgs 13, 21, 23 & 902	CSUMB	Square Feet				(29,247)																	
Student Rec Center	CSUMB	Square Feet						70,000															
Student Life (Phase I)	CSUMB	Square Feet						72,737															
Administration Building	CSUMB	Square Feet								77,454													
Student Union (Phase II)	CSUMB	Square Feet								20,000													
Childcare Center	CSUMB	Square Feet								23,000													
Academic V	CSUMB	Square Feet										76,704											
Demolish bldgs 1, 2, 3, 42 & 91	CSUMB	Square Feet										(24,232)											
Wellness Center	CSUMB	Square Feet										30,769											
Student Life (Phase II)	CSUMB	Square Feet												72,736									
Facilities Building	CSUMB	Square Feet												23,590									
Academic VI	CSUMB	Square Feet															76,704						
Demolish bldgs 14 & 16	CSUMB	Square Feet															(21,271)						
Campus Arts & Auditorium	CSUMB	Square Feet															82,291						
Recreation Center Addition	CSUMB	Square Feet															64,574						
Academic VII	CSUMB	Square Feet																		76,704			
Demolish bldgs 44, 45, 46, 58 & 59	CSUMB	Square Feet																		(26,254)			
Academic VIII	CSUMB	Square Feet																				76,704	
Demolish bldgs 70 & 95	CSUMB	Square Feet																				(5,341)	
Dining additions (in various buildings)	CSUMB	Square Feet		5,144		4,003		4,841		4,018		5,797		1,221			2,143				521		399
Stadium House	CSUMB	Square Feet					40,177																
Field House & Otter Retail	CSUMB	Square Feet							12,502														
Aquatic Center	CSUMB	Square Feet										7,000											
Stadium Field and Track (replaces existing stadium)	CSUMB	Acres				0.1																	
Multi-Purpose Field	CSUMB	Acres						3.0															
Soccer Field	CSUMB	Acres								1.9													
Olympic Pools (2)	CSUMB	Square Feet												27,000									
Tennis Court Landscaping	CSUMB	Acres														2.2							
MB Charter School	CSUMB	Square Feet									31,800												
MB Charter School Landscape	CSUMB	Acres									5.3												
Greenhouses	CSUMB	Square Feet			1,344.00																		

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
CSUMB Housing (CSU Corporation)	Multi family (> 15 units / acre)	1025	Dwelling Units	0.25	C1
Student Housing Phase 2B	Other	400	Beds	0.036	
Student Housing Phase 3	Other	600	Beds	0.036	
Student Housing Phase 4	Other	600	Beds	0.036	
Student Housing Phase 5	Other	600	Beds	0.036	
Student Housing Phase 6	Other	600	Beds	0.036	
Student Housing Phase 7	Other	600	Beds	0.036	
Student Housing Phase 8	Other	600	Beds	0.036	
Student Housing Phase 9	Other	600	Beds	0.036	
Student Housing Phase 10	Other	600	Beds	0.036	
Non Residential					
Student Union (Phase I)	Higher Education	70360	Square Feet	0.000072	C3
Academic III	Higher Education	48032	Square Feet	0.000072	
Storage Facility	Higher Education	50000	Square Feet	0.000072	
Panetta Institute	Higher Education	63695	Square Feet	0.000072	
Academic IV	Higher Education	72200	Square Feet	0.000072	
Demolish bldgs 13, 21, 23 & 902	Other	-29247	Square Feet	0.000018	
Student Rec Center	Higher Education	70000	Square Feet	0.000072	
Student Life (Phase I)	Higher Education	72737	Square Feet	0.000072	
Administration Building	Higher Education	77454	Square Feet	0.000072	
Student Union (Phase II)	Higher Education	20000	Square Feet	0.000072	
Other					
Childcare Center	Other	23000	Square Feet	0.0001	C4
Academic V	Higher Education	76704	Square Feet	0.000072	
Demolish bldgs 1, 2, 3, 42 & 91	Higher Education	-24232	Square Feet	0.000072	
Wellness Center	Higher Education	30769	Square Feet	0.000072	
Student Life (Phase II)	Higher Education	72736	Square Feet	0.000072	
Facilities Building	Higher Education	23590	Square Feet	0.000072	
Academic VI	Higher Education	76704	Square Feet	0.000072	
Demolish bldgs 14 & 16	Other	-21271	Square Feet	0.000508	
Campus Arts & Auditorium	Higher Education	82291	Square Feet	0.000072	
Recreation Center Addition	Higher Education	64574	Square Feet	0.000072	
Academic VII	Higher Education	76704	Square Feet	0.000072	
Demolish bldgs 44, 45, 46, 58 & 59	Other	-26254	Square Feet	0.000017	
Academic VIII	Higher Education	76704	Square Feet	0.000072	
Demolish bldgs 70 & 95	Other	-5341	Square Feet	0	
Dining additions (in various buildings)	Other	28087	Square Feet	0.00012	
Stadium House	Higher Education	40177	Square Feet	0.000072	
Field House & Otter Retail	Higher Education	12502	Square Feet	0.000072	
Aquatic Center	Higher Education	7000	Square Feet	0.000072	
Stadium Field and Track	Landscape (turf)	0.1	Acres	2.5	
Multi-Purpose Field	Landscape (turf)	2.9843893	Acres	2.5	
Soccer Field	Landscape (turf)	1.8778696	Acres	2.5	
Olympic Pools (2)	Other	27000	Square Feet	0.0002	
Tennis Court Landscaping	Landscape (non-turf)	2.17	Acres	2.1	
MB Charter School	Schools (K-12)	31800	Square Feet	0.0003	
MB Charter School Landscape	Landscape (non-turf)	5.3	Acres	2.1	
CSUMB Landscaping	Landscape (non-turf)	1344	Square Feet	0.00223	

	Incremental Demand (AFY)			
	2025	2030	2035	2040
CSUMB	0.00	87.50	87.50	81.25
CSUMB	14.40	0.00	0.00	0.00
CSUMB	21.60	0.00	0.00	0.00
CSUMB	0.00	21.60	0.00	0.00
CSUMB	0.00	21.60	0.00	0.00
CSUMB	0.00	0.00	21.60	0.00
CSUMB	0.00	0.00	21.60	0.00
CSUMB	0.00	0.00	0.00	21.60
CSUMB	0.00	0.00	0.00	21.60
CSUMB	8.16	0.00	0.00	0.00
CSUMB	12.24	0.00	0.00	0.00
CSUMB	0.00	10.20	0.00	0.00
CSUMB	0.00	10.20	0.00	0.00
CSUMB	0.00	0.00	10.20	0.00
CSUMB	0.00	0.00	10.20	0.00
CSUMB	0.00	0.00	0.00	10.20
CSUMB	0.00	0.00	0.00	10.20

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
CSUMB	0.00	87.50	175.00	256.25
CSUMB	14.40	14.40	14.40	14.40
CSUMB	21.60	21.60	21.60	21.60
CSUMB	0.00	21.60	21.60	21.60
CSUMB	0.00	21.60	21.60	21.60
CSUMB	0.00	0.00	21.60	21.60
CSUMB	0.00	0.00	21.60	21.60
CSUMB	0.00	0.00	0.00	21.60
CSUMB	0.00	0.00	0.00	21.60
CSUMB	8.16	8.16	8.16	8.16
CSUMB	12.24	12.24	12.24	12.24
CSUMB	0.00	10.20	10.20	10.20
CSUMB	0.00	10.20	10.20	10.20
CSUMB	0.00	0.00	10.20	10.20
CSUMB	0.00	0.00	10.20	10.20
CSUMB	0.00	0.00	0.00	10.20
CSUMB	0.00	0.00	0.00	10.20

CSUMB	5.07	0.00	0.00	0.00
CSUMB	3.46	0.00	0.00	0.00
CSUMB	3.60	0.00	0.00	0.00
CSUMB	4.59	0.00	0.00	0.00
CSUMB	5.20	0.00	0.00	0.00
CSUMB	-0.53	0.00	0.00	0.00
CSUMB	5.04	0.00	0.00	0.00
CSUMB	5.24	0.00	0.00	0.00
CSUMB	0.00	5.58	0.00	0.00
CSUMB	0.00	1.44	0.00	0.00
CSUMB	0.00	2.30	0.00	0.00
CSUMB	0.00	5.52	0.00	0.00
CSUMB	0.00	-1.74	0.00	0.00
CSUMB	0.00	2.22	0.00	0.00
CSUMB	0.00	0.00	5.24	0.00
CSUMB	0.00	0.00	1.70	0.00
CSUMB	0.00	0.00	5.52	0.00
CSUMB	0.00	0.00	-10.80	0.00
CSUMB	0.00	0.00	5.92	0.00
CSUMB	0.00	0.00	4.65	0.00
CSUMB	0.00	0.00	0.00	5.52
CSUMB	0.00	0.00	0.00	-0.44
CSUMB	0.00	0.00	0.00	5.52
CSUMB	0.00	0.00	0.00	0.00
CSUMB	1.68	1.18	0.40	0.11
CSUMB	2.89	0.00	0.00	0.00
CSUMB	0.00	0.90	0.00	0.00
CSUMB	0.00	0.50	0.00	0.00
CSUMB	0.25	0.00	0.00	0.00
CSUMB	7.46	0.00	0.00	0.00
CSUMB	0.00	4.69	0.00	0.00
CSUMB	0.00	0.00	5.40	0.00
CSUMB	0.00	0.00	4.56	0.00
CSUMB	0.00	9.54	0.00	0.00
CSUMB	0.00	11.13	0.00	0.00
CSUMB	3.00	0.00	0.00	0.00

CSUMB	5.07	5.07	5.07	5.07
CSUMB	3.46	3.46	3.46	3.46
CSUMB	3.60	3.60	3.60	3.60
CSUMB	4.59	4.59	4.59	4.59
CSUMB	5.20	5.20	5.20	5.20
CSUMB	-0.53	-0.53	-0.53	-0.53
CSUMB	5.04	5.04	5.04	5.04
CSUMB	5.24	5.24	5.24	5.24
CSUMB	0.00	5.58	5.58	5.58
CSUMB	0.00	1.44	1.44	1.44
CSUMB	0.00	2.30	2.30	2.30
CSUMB	0.00	5.52	5.52	5.52
CSUMB	0.00	-1.74	-1.74	-1.74
CSUMB	0.00	2.22	2.22	2.22
CSUMB	0.00	0.00	5.24	5.24
CSUMB	0.00	0.00	1.70	1.70
CSUMB	0.00	0.00	5.52	5.52
CSUMB	0.00	0.00	-10.80	-10.80
CSUMB	0.00	0.00	5.92	5.92
CSUMB	0.00	0.00	4.65	4.65
CSUMB	0.00	0.00	0.00	5.52
CSUMB	0.00	0.00	0.00	-0.44
CSUMB	0.00	0.00	0.00	5.52
CSUMB	0.00	0.00	0.00	0.00
CSUMB	1.68	2.86	3.26	3.37
CSUMB	2.89	2.89	2.89	2.89
CSUMB	0.00	0.90	0.90	0.90
CSUMB	0.00	0.50	0.50	0.50
CSUMB	0.25	0.25	0.25	0.25
CSUMB	7.46	7.46	7.46	7.46
CSUMB	0.00	4.69	4.69	4.69
CSUMB	0.00	0.00	5.40	5.40
CSUMB	0.00	0.00	4.56	4.56
CSUMB	0.00	9.54	9.54	9.54
CSUMB	0.00	11.13	11.13	11.13
CSUMB	3.00	3.00	3.00	3.00

UCMBEST	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
New Residential																							
UC 8th Street	UC/MCO	Dwelling Units												30	30	35	35	35	35	30	30	30	
UC East Campus - SF	UC/MCO	Dwelling Units								110	110	20											
UC East Campus - MF	UC/MCO	Dwelling Units																					
Non Residential																							
UC Central North - R&D	UC/MCO	Square Feet				60,000	80,000	100,000	100,000	100,000	72,000												
UC Central North - Commercial	UC/MAR	Square Feet				62,500	82,500	82,500	20,500														
UC Central North - Landscape	UC/MAR	Square Feet					2	2	2	2	2												
UC West & Central South - Office	UC/MAR	Square Feet										68,000	100,000										
UC West & Central South - Industrial	UC/MAR	Square Feet					20,000	20,000	20,000	20,000	20,000												
UC West & Central South - Retail	UC/MAR	Square Feet							10,000														
UC East Campus - Retail	UC/MAR	Square Feet									26,000	26,000											

Seaside	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
Residential																							
Seaside Resort Housing	SEA	Dwelling Units				25	25	25	25	22													
Seaside East	SEA	Dwelling Units												100	100	100	100	100	100	100	100	100	
Nurses Barracks	SEA	Dwelling Units			40																		
Seaside Senior Living	SEA	Dwelling Units				88	43	13															
Main Gate																							
Single Family Homes	SEA	Dwelling Units				10	70	60															
Apartments	SEA	Dwelling Units					310	140	30														
Campus Town																							
Single Family Homes	SEA	Dwelling Units					100	84	60					70	70	70	70	70	70	70	70	70	
Apartments	SEA	Dwelling Units												100	100	100	100	100	100			11	
Non Residential																							
Main Gate																							
Retail	SEA	Square Feet						95,000															
Gas Station	SEA	Pumps						16															
Restaurants	SEA	Square Feet						13,000															
Landscape	SEA	Acres						7.35															
Hotel	SEA	Rooms						250															
Seaside Resort																							
Seaside Resort Golf Buildings	SEA	Square Feet		10,000																			
Seaside Resort Golf Clubhouse	SEA	Square Feet						16,300															
Seaside Golf Course Hotel	SEA	Rooms						330															
Seaside Golf Course Timeshares	SEA	Rooms							120	50													
Campus Town																							
Commercial	SEA	Square Feet							50,000	50,000	50,000												
Office	SEA	Square Feet												50,000									
Hotel	SEA	Rooms						250							75								
Parks - Turf	SEA	Acres												1.5	1.5								
Landscape	SEA	Acres						1	0.5	0.5	0.5			0.5	0.5	0.5	0.3						
Seaside Senior Living																							
Dining Hall/Kitchen	SEA	Square Feet				2,000	1,000																
Clinic	SEA	Square Feet				5,000																	
Offices	SEA	Square Feet				5,000	2,000																
Beauty Shop (4 seats)	SEA	Stations				4																	
Day Spa	SEA	Square Feet					2,000																
Landscape	SEA	Acres				0.93																	
Veterans' Cemetery	SEA	Square Feet			9,000	7,500		11,200															
Monterey Peninsula Trade & Conf Cntr	SEA	Square Feet							250,000														
Seaside Corp Yard	SEA	Square Feet						25,000	27,200														
Conference Facility	SEA	Square Feet						27,000															
Seaside East - Office	SEA	Square Feet				50,000	50,000	50,000	50,000	50,000	50,000	50,000	50,000										
Seaside Est - Industrial	SEA	Square Feet				10,000	20,000	20,000	20,000	20,000	10,000												
Auto Center (1st & Light Fighter)	SEA	Square Feet																					

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
UC 8th Street	Multi family (> 15 units / acre)	290	Dwelling Units	0.25	
UC East Campus - SF	SF Residential (< 5 units / acre)	240	Dwelling Units	0.5	
UC East Campus - MF	Multi family (> 15 units / acre)		Dwelling Units	0.25	
UC Central North - R&D	Office / R&D	512000	Square Feet	0.000135	
UC Central North - Commercial	Other Commercial	248000	Square Feet	0.0003	
UC Central North - Landscape	Landscape (non-turf)	9.71	Square Feet	2.1	
UC West & Central South - Office	Office / R&D	168000	Square Feet	0.000135	
UC West & Central South - Industrial	Light Industrial	100000	Square Feet	0.00015	
UC West & Central South - Retail	Retail	10000	Square Feet	0.00021	
UC East Campus - Retail	Retail	52000	Square Feet	0.00021	

	Incremental Demand (AFY)			
	2025	2030	2035	2040
UCMBEST	0.00	0.00	41.25	31.25
UCMBEST	0.00	120.00	0.00	0.00
UCMBEST	0.00	0.00	0.00	0.00

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	0.00	0.00	41.25	72.50
	0.00	120.00	120.00	120.00
	0.00	0.00	0.00	0.00

UCMBEST	32.40	36.72	0.00	0.00
UCMBEST	68.25	6.15	0.00	0.00
UCMBEST	8.40	11.99	0.00	0.00
UCMBEST	0.00	22.68	0.00	0.00
UCMBEST	6.00	9.00	0.00	0.00
UCMBEST	0.00	2.10	0.00	0.00
UCMBEST	0.00	10.92	0.00	0.00

	32.40	69.12	69.12	69.12
	68.25	74.40	74.40	74.40
	8.40	20.39	20.39	20.39
	0.00	22.68	22.68	22.68
	6.00	15.00	15.00	15.00
	0.00	2.10	2.10	2.10
	0.00	10.92	10.92	10.92

Land Use Type	Land Use	Total	Units	Multiplier	Notes
Residential					
Seaside Resort Housing	SF Residential (< 5 units / acre)	122	Dwelling Units	0.5	
Seaside East	SF Residential (5-8 units / acre)	1000	Dwelling Units	0.33	
Nurses Barracks	Multi family (> 15 units / acre)	40	Dwelling Units	0.25	
Seaside Senior Living	Multi family (> 15 units / acre)	144	Dwelling Units	0.25	
Main Gate					
Single Family Homes	Residential (8-15 units / acre)	140	Dwelling Units	0.25	
Apartments	Multi family (> 15 units / acre)	480	Dwelling Units	0.25	
Campus Town					
Single Family Homes	Residential (8-15 units / acre)	885	Dwelling Units	0.25	
Apartments	Multi family (> 15 units / acre)	600	Dwelling Units	0.25	
Non Residential					
Main Gate					
Retail	Retail	95000	Square Feet	0.00021	
Gas Station	Other	16	Pumps	0.1051	
Restaurants	Restaurant	13000	Square Feet	0.00145	
Landscaping	Landscape (non-turf)	7.35	Acres	2.1	
Hotel	Hotel, Motel and Timeshares	250	Rooms	0.11	
Seaside Resort					
Seaside Resort Golf Buildings	Office / R&D	10000	Square Feet	0.000135	
Seaside Resort Golf Clubhouse	Restaurant	16300	Square Feet	0.00145	
Seaside Golf Course Hotel	Hotel, Motel and Timeshares	330	Rooms	0.11	
Seaside Golf Course Timeshares	Hotel, Motel and Timeshares	170	Rooms	0.11	
Campus Town					
Commercial	Other Commercial	150000	Square Feet	0.0003	
Office	Office / R&D	50000	Square Feet	0.000135	
Hotel	Hotel, Motel and Timeshares	325	Rooms	0.11	
Parks - Turf	Landscape (turf)	3	Acres	2.5	
Landscape	Landscape (non-turf)	4.3	Acres	2.1	
Seaside Senior Living					
Dining Hall/Kitchen	Restaurant	3000	Square Feet	0.00145	
Clinic	Other	5000	Square Feet	0.00018	
Offices	Other	7000	Square Feet	0.00012	
Beauty Shop (4 seats)	Other	4	Stations	0.059	
Day Spa	Other	2000	Square Feet	0.00018	
Landscape	Landscape (non-turf)	0.93	Acres	2.1	
Veterans' Cemetery	Various	27700	Square Feet	0.000141	
Monterey Peninsula Trade & Conf Cntr	Office / R&D	250000	Square Feet	0.000135	
Seaside Corp Yard	Various	52200	Square Feet	0.00015709	
Conference Facility	Office / R&D	27000	Square Feet	0.0002	
Seaside East - Office	Office / R&D	400000	Square Feet	0.000135	
Seaside Est - Industrial	Light Industrial	100000	Square Feet	0.00015	

	Incremental Demand (AFY)			
	2025	2030	2035	2040
City of Seaside	37.50	23.50	0.00	0.00
City of Seaside	0.00	0.00	165.00	165.00
City of Seaside	10.00	0.00	0.00	0.00
City of Seaside	36.00	0.00	0.00	0.00
City of Seaside	35.00	0.00	0.00	0.00
City of Seaside	112.50	7.50	0.00	0.00
City of Seaside	46.00	15.00	87.50	72.75
City of Seaside	0.00	0.00	125.00	25.00

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	37.50	61.00	61.00	61.00
	0.00	0.00	165.00	330.00
	10.00	10.00	10.00	10.00
	36.00	36.00	36.00	36.00
	35.00	35.00	35.00	35.00
	112.50	120.00	120.00	120.00
	46.00	61.00	148.50	221.25
	0.00	0.00	125.00	150.00

City of Seaside	19.95	0.00	0.00	0.00
City of Seaside	1.68	0.00	0.00	0.00
City of Seaside	18.85	0.00	0.00	0.00
City of Seaside	15.44	0.00	0.00	0.00
City of Seaside	27.50	0.00	0.00	0.00
City of Seaside	1.35	0.00	0.00	0.00
City of Seaside	23.64	0.00	0.00	0.00
City of Seaside	36.30	0.00	0.00	0.00
City of Seaside	0.00	18.70	0.00	0.00
City of Seaside	0.00	45.00	0.00	0.00
City of Seaside	0.00	0.00	6.75	0.00
City of Seaside	27.50	0.00	8.25	0.00
City of Seaside	0.00	0.00	7.50	0.00
City of Seaside	2.10	3.15	3.78	0.00
City of Seaside	4.35	0.00	0.00	0.00
City of Seaside	0.90	0.00	0.00	0.00
City of Seaside	0.84	0.00	0.00	0.00
City of Seaside	0.24	0.00	0.00	0.00
City of Seaside	0.36	0.00	0.00	0.00
City of Seaside	1.95	0.00	0.00	0.00
City of Seaside	3.90	0.00	0.00	0.00
City of Seaside	0.00	33.75	0.00	0.00
City of Seaside	3.93	4.27	0.00	0.00
City of Seaside	5.40	0.00	0.00	0.00
City of Seaside	20.25	33.75	0.00	0.00
City of Seaside	7.50	7.50	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00

	19.95	19.95	19.95	19.95
	1.68	1.68	1.68	1.68
	18.85	18.85	18.85	18.85
	15.44	15.44	15.44	15.44
	27.50	27.50	27.50	27.50
	1.35	1.35	1.35	1.35
	23.64	23.64	23.64	23.64
	36.30	36.30	36.30	36.30
	0.00	18.70	18.70	18.70
	0.00	45.00	45.00	45.00
	0.00	0.00	6.75	6.75
	27.50	27.50	35.75	35.75
	0.00	0.00	7.50	7.50
	2.10	5.25	9.03	9.03
	4.35	4.35	4.35	4.35
	0.90	0.90	0.90	0.90
	0.84	0.84	0.84	0.84
	0.24	0.24	0.24	0.24
	0.36	0.36	0.36	0.36
	1.95	1.95	1.95	1.95
	3.90	3.90	3.90	3.90
	0.00	33.75	33.75	33.75
	3.93	8.20	8.20	8.20
	5.40	5.40	5.40	5.40
	20.25	54.00	54.00	54.00
	7.50	15.00	15.00	15.00
	0.00	0.00	0.00	0.00

Del Rey Oaks	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
New Residential																							
Del Rey Oaks																							
Residential	DRO	Dwelling Units							50	50	50	50	50	25									
Golf Villas	DRO	Dwelling Units																					
Patio Homes	DRO	Dwelling Units																					
Condos	DRO	Dwelling Units																					
Workforce	DRO	Dwelling Units																					
Townhomes/Senior Casitas	DRO	Dwelling Units																					
RV Resort (Manager)	DRO	Dwelling Units					1																
Non Residential																							
Del Rey Oaks Office	DRO	Square Feet				100,000	100,000																
Del Rey Oaks Retail	DRO	Square Feet								25,000													
Del Rey Oaks Hotel	DRO	Rooms								250													
Del Rey Oaks Industrial	DRO	Square Feet							100,000	100,000	100,000	100,000	100,000										
RV Resort	DRO	Spaces					70					40					100						

Monterey City	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
Non Residential																							
Monterey City Office	MRY	Square Feet								721,524													
Industrial -- City Corp. Yard	MRY	Square Feet								100,000													
Industrial -- Public/Private	MRY	Square Feet								116,275													

US Army	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
Residential																							
Lower Stilwell Single Family	ARMY	Dwelling Units				36	42	72															
Lower Stilwell Duplex	ARMY	Dwelling Units																					
Non Residential																							
Recreation Center	ARMY	Square Feet							8,340														
Child Development Center	ARMY	Square Feet								24,000													
Landscaping	ARMY	Acre					1																
Emergency Services Center	ARMY	Square Feet				40,000																	

CA State Parks	Jurisd	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
Residential																							
Staff Housing	SP	Dwelling Units							3														
Non Residential																							
Fort Ord Dunes State Park - Bldgs	SP	Square feet			3,645																		
Fort Ord Dunes State Park - Restrooms	SP	Stalls			16																		
Fort Ord Dunes State Park - RV Park	SP	Spaces						45															
American Youth Hostel (Seaside)	SP	Units			18					12	2												

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Del Rey Oaks					
Residential	SF Residential (5-8 units / acre)	275	Dwelling Units	0.33	
Golf Villas	SF Residential (< 5 units / acre)		Dwelling Units	0.5	
Patio Homes	SF Residential (< 5 units / acre)		Dwelling Units	0.5	
Condos	Multi family (> 15 units / acre)		Dwelling Units	0.25	
Workforce	Multi family (> 15 units / acre)		Dwelling Units	0.25	
Townhomes/Senior Casitas	SF Residential (5-8 units / acre)		Dwelling Units	0.33	
RV Resort (Manager)	Residential (8-15 units / acre)	1	Dwelling Units	0.25	
Non Residential					
Del Rey Oaks Office	Office / R&D	200000	Square Feet	0.000135	
Del Rey Oaks Retail	Retail	25000	Square Feet	0.00021	
Del Rey Oaks Hotel	Hotel, Motel and Timeshares	250	Rooms	0.11	
Del Rey Oaks Industrial	Light Industrial	500000	Square Feet	0.00015	
RV Resort	Other	210	Spaces	0.06	1

	Incremental Demand (AFY)			
	2025	2030	2035	2040
	0.00	82.50	8.25	0.00
	0.25	0.00	0.00	0.00
Del Rey Oaks	0.25	82.50	8.25	0.00
Del Rey Oaks	27.00	0.00	0.00	0.00
Del Rey Oaks	0.00	5.25	0.00	0.00
Del Rey Oaks	0.00	27.50	0.00	0.00
Del Rey Oaks	0.00	75.00	0.00	0.00
Del Rey Oaks	4.20	2.40	6.00	0.00

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	0.00	82.50	90.75	90.75
	0.25	0.25	0.25	0.25
	0.25	82.75	91.00	91.00
	27.00	27.00	27.00	27.00
	0.00	5.25	5.25	5.25
	0.00	27.50	27.50	27.50
	0.00	75.00	75.00	75.00
	4.20	6.60	12.60	12.60

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Monterey City Office	Office / R&D	721524	Square Feet	0.000135	
Industrial -- City Corp. Yard	Light Industrial	100000	Square Feet	0.00015	
Industrial -- Public/Private	Light Industrial	116275	Square Feet	0.00015	

	Incremental Demand (AFY)			
	2025	2030	2035	2040
City of Monterey	0.00	97.41	0.00	0.00
City of Monterey	0.00	15.00	0.00	0.00
City of Monterey	0.00	17.44	0.00	0.00

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	0.00	97.41	97.41	97.41
	0.00	15.00	15.00	15.00
	0.00	17.44	17.44	17.44

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Lower Stilwell Single Family	Residential (8-15 units / acre)	150	Dwelling Units	0.25	3
Lower Stilwell Duplex	Residential (8-15 units / acre)		Dwelling Units	0.25	3
Non Residential					
Recreation Center	Institutional	8340	Square Feet	0.0003	
Child Development Center	Institutional	24000	Square Feet	0.0003	
Landscaping	Landscape (non-turf)	1	Acre	2.1	
Emergency Services Center	Governmental	40000	Square Feet	0.0003	

	Incremental Demand (AFY)			
	2025	2030	2035	2040
U.S. Army	37.50	0.00	0.00	0.00
U.S. Army	0.00	0.00	0.00	0.00
U.S. Army	0.00	2.50	0.00	0.00
U.S. Army	0.00	7.20	0.00	0.00
U.S. Army	2.10	0.00	0.00	0.00
U.S. Army	12.00	0.00	0.00	0.00

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	37.50	37.50	37.50	37.50
	0.00	0.00	0.00	0.00
	0.00	2.50	2.50	2.50
	0.00	7.20	7.20	7.20
	2.10	2.10	2.10	2.10
	12.00	12.00	12.00	12.00

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Staff Housing	SF Residential (5-8 units / acre)	3	Dwelling Units	0.33	
New Residential					
Fort Ord Dunes State Park - Bldgs	Institutional	3645	Square feet	0.0003	
Fort Ord Dunes State Park - Restrooms	Other	16	Stalls	0.058	
Fort Ord Dunes State Park - RV Park	Other	45	Spaces	0.065	
American Youth Hostel (Seaside)	Hotel, Motel and Timeshares	32	Units	0.11	

	Incremental Demand (AFY)			
	2025	2030	2035	2040
State Parks and Rec.	0.00	0.99	0.00	0.00
State Parks and Rec.	1.09	0.00	0.00	0.00
State Parks and Rec.	0.93	0.00	0.00	0.00
State Parks and Rec.	2.93	0.00	0.00	0.00
State Parks and Rec.	1.98	1.54	0.00	0.00

	Cumulative Demand (AFY)			
	2025	2030	2035	2040
	0.00	0.99	0.99	0.99
	1.09	1.09	1.09	1.09
	0.93	0.93	0.93	0.93
	2.93	2.93	2.93	2.93
	1.98	3.52	3.52	3.52

NOTES:

- 1 Unique water demand multiplier based on the quantity of units (square feet, acres, dwelling units) and total expected water demand, from Water Supply Supply Assessment.
- 2 Marina DVSP projects a 30-year build-out. Annual values reflect 1/30th of total.
- 3 OMC housing is being rennovated and replaced. Currently there are 150 in transition.
- C1 Campus housing factor is 0.031 AFY/bed for dormitory plus 0.005 AFY/bed for dining halls.
- C2 Factor is for landscaping around building.
- C3 Academic factor is 0.00021 AFY/SF for indoor demand plus 0.00051 AFY/SF for landscaping around building
- C4 Child care center factor based upon existing facility in the Ord Community.

Marina Coast Water District 2020 Urban Water Management Plan

Table C4: 2020 Population Growth by Jurisdiction

	Jurisdiction	2020	2025	2030	2035	2040
Ord	U.S. Army		450	450	450	450
	CSUMB		400	2,318	4,836	6,702
	Del Rey Oaks		3	753	828	828
	City of Monterey		0	0	0	0
	County of Monterey		1,233	1,233	1,233	1,233
	UCMBEST		0	624	1,053	1,378
	City of Seaside		2,883	3,294	7,344	10,017
	State Parks and Rec.		0	9	9	9
	Marina Ord Comm.		3,743	5,786	5,786	5,786
	Marina	Armstrong Ranch		3,591	4,085	4,085
RMC Lonestar			0	0	0	0
Marina Central			1,633	3,265	4,898	6,500
Subtotal - Ord		22,349	30,611	36,366	43,438	48,302
Subtotal - Marina		14,297	19,520	21,647	23,279	24,881
Total		36,646	50,131	58,012	66,717	73,183

Note: The existing (current) population is aggregated by service area (Ord and Marina) and not shown by jurisdiction.

This page is intentionally blank.

Marina Ord	Jurisd	Land Use	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
New Residential																								
Sea Haven																								
Townhome	MAR	Residential (8-15 units / acre)	Dwelling Units	12	13	13	13	13	13	13	12													
Cluster Market/Bridge	MAR	Residential (8-15 units / acre)	Dwelling Units	47	19	19	19	19	19	19	18													
Market A	MAR	SF Residential (5-8 units / acre)	Dwelling Units	39	29	29	29	29	29	29	33													
Market B	MAR	SF Residential (5-8 units / acre)	Dwelling Units	-	34	34	34	34	34	34	33													
Estates	MAR	SF Residential (< 5 units / acre)	Dwelling Units	-	13	12	12	12	12	12	12	-												
Cypress Knolls Specific Plan Area																								
SF Home / Townhome	MAR	SF Residential (5-8 units / acre)	Dwelling Units								255	200		141										
Apartments	MAR	Multi family (> 15 units / acre)	Dwelling Units								85			31										
Assisted Living	MAR	Multi family (> 15 units / acre)	Dwelling Units											60										
Dunes on Monterey Bay																								
Alley (small lot)	MAR	Residential (8-15 units / acre)	Dwelling Units	44	54	59	37																	
Carriage	MAR	Residential (8-15 units / acre)	Dwelling Units		18	30	47																	
Standard	MAR	SF Residential (5-8 units / acre)	Dwelling Units		44	6																		
Standard (small lot)	MAR	Residential (8-15 units / acre)	Dwelling Units		48	23																		
Duets	MAR	SF Residential (5-8 units / acre)	Dwelling Units		62	88	40	60	4															
Townhome (live-work)	MAR	Residential (8-15 units / acre)	Dwelling Units		50	50	39																	
Townhome (mixed use)	MAR	Residential (8-15 units / acre)	Dwelling Units		8	8	8																	
Apartments (completed)	MAR	Multi family (> 15 units / acre)	Dwelling Units																					
VTC Supportive Housing																								
	MAR	Residential (8-15 units / acre)	Dwelling Units		71																			
Armstrong Ranch																								
New Residential																								
Marina Station																								
Single Family Homes (15,000)	MAR	SF Residential (< 5 units / acre)	Dwelling Units				23	87	37															
Single Family Homes (6,500)	MAR	SF Residential (5-8 units / acre)	Dwelling Units				100	250	220	99														
Apartments	MAR	Multi family (> 15 units / acre)	Dwelling Units				100	250	220	78														
Marina Central																								
New Residential																								
In-Fill Development MF	MAR	Multi family (> 15 units / acre)	Dwelling Units						50					50					50					39
In-Fill Development SF	MAR	Residential (8-15 units / acre)	Dwelling Units		10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
Downtown Specific Plan (over 30 years)	MAR	Multi family (> 15 units / acre)	Dwelling Units		97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97	97
Monterey County																								
New Residential																								
East Garrison I																								
Market Rate	MCO	SF Residential (< 5 units / acre)	Dwelling Units	143	125	177	79	77																
Affordable	MCO	SF Residential (5-8 units / acre)	Dwelling Units																					

Marina Ord		Jurisd
New Residential		
Sea Haven		
Townhome	MAR	
Cluster Market/Bridge	MAR	
Market A	MAR	
Market B	MAR	
Estates	MAR	
Cypress Knolls Specific Plan Area		
SF Home / Townhome	MAR	
Apartments	MAR	
Assisted Living	MAR	
Dunes on Monterey Bay		
Alley (small lot)	MAR	
Carriage	MAR	
Standard	MAR	
Standard (small lot)	MAR	
Duets	MAR	
Townhome (live-work)	MAR	
Townhome (mixed use)	MAR	
Apartments (completed)	MAR	
VTC Supportive Housing	MAR	
Armstrong Ranch		
New Residential		
Marina Station		
Single Family Homes (15,000)	MAR	
Single Family Homes (6,500)	MAR	
Apartments	MAR	
Marina Central		
New Residential		
In-Fill Development MF	MAR	
In-Fill Development SF	MAR	
Downtown Specific Plan (over 30 years)	MAR	
Monterey County		
New Residential		
East Garrison I		
Market Rate	MCO	
Affordable	MCO	

Multiplier	
Marina Heights	
1.5	
3.0	
3.0	
3.0	
4.0	
Cypress Knolls	
1.8	
2.4	
1.0	
Dunes (UV)	
2.0	
3.0	
3.0	
3.0	
1.5	
1.5	
1.5	
2.0	
Marina Station	
2.8	
2.8	
2.8	
Marina Central	
2.8	
2.8	
2.8	
Multiplier	
East Garrison	
2.1	
2.1	

Incremental Increase (Persons)					
2020	2025	2030	2035	2040	
18	97.5	37.5	0	0	
141	285	111	0	0	
117	435	186	0	0	
0	510	201	0	0	
0	244	96	0	0	
276	1571.5	631.5	0	0	
0	0	1072.8	0	0	
0	0	278.4	0	0	
0	0	60	0	0	
0	0	1411.2	0	0	
88	300	0	0	0	
0	285	0	0	0	
0	150	0	0	0	
0	213	0	0	0	
0	381	0	0	0	
0	208.5	0	0	0	
0	36	0	0	0	
0	0	0	0	0	
88	1573.5	0	0	0	
0	234.3	0	0	0	
Cumulative Increase (Persons)					
2020	2025	2030	2035	2040	
18	116	153	153	153	
141	426	537	537	537	
117	552	738	738	738	
0	510	711	711	711	
0	244	340	340	340	
276	1848	2479	2479	2479	
0	0	1073	1073	1073	
0	0	278	278	278	
0	0	60	60	60	
0	0	1411	1411	1411	
88	388	388	388	388	
0	285	285	285	285	
0	150	150	150	150	
0	213	213	213	213	
0	381	381	381	381	
0	209	209	209	209	
0	36	36	36	36	
0	0	0	0	0	
88	1662	1662	1662	1662	
0	234	234	234	234	
Incremental Increase (EDU)					
2020	2025	2030	2035	2040	
12	65	25	0	0	
47	95	37	0	0	
39	145	62	0	0	
0	170	67	0	0	
0	61	24	0	0	
98	536	215	0	0	
0	0	596	0	0	
0	0	116	0	0	
0	0	60	0	0	
0	0	772	0	0	
44	150	0	0	0	
0	95	0	0	0	
0	50	0	0	0	
0	71	0	0	0	
0	254	0	0	0	
0	139	0	0	0	
0	24	0	0	0	
0	0	0	0	0	
44	783	0	0	0	
0	71	0	0	0	

Incremental Increase (Persons)					
2020	2025	2030	2035	2040	
0	410	0	0	0	
0	1590	276	0	0	
0	1590	218	0	0	
0	3591	494	0	0	
Cumulative Increase (Persons)					
2020	2025	2030	2035	2040	
0	410	410	410	410	
0	1590	1867	1867	1867	
0	1590	1808	1808	1808	
0	3591	4085	4085	4085	
Incremental Increase (EDU)					
2020	2025	2030	2035	2040	
0	147	0	0	0	
0	570	99	0	0	
0	570	78	0	0	
0	1287	177	0	0	

Incremental Increase (Persons)					
2020	2025	2030	2035	2040	
0	140	140	140	109	
0	140	140	140	140	
0	1353	1353	1353	1353	
0	1633	1633	1633	1602	
Cumulative Increase (Persons)					
2020	2025	2030	2035	2040	
0	140	279	419	527	
0	140	280	420	560	
0	1353	2706	4059	5413	
0	1633	3265	4898	6500	
Incremental Increase (EDU)					
2020	2025	2030	2035	2040	
0	50	50	50	39	
0	50	50	50	50	
0	485	485	485	485	
0	585	585	585	574	

Incremental Increase (Persons)					
2020	2025	2030	2035	2040	
293	939	0	0	0	
0	0	0	0	0	
293	939	0	0	0	
Cumulative Increase (Persons)					
2020	2025	2030	2035	2040	
293	1233	1233	1233	1233	
0	0	0	0	0	
293	1233	1233	1233	1233	
Incremental Increase (EDU)					
2020	2025	2030	2035	2040	
143	458	0	0	0	
0	0	0	0	0	
143	458	0	0	0	

CSUMB	Jurisd	Land Use	Units	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2030-31	2031-32	2032-33	2033-34	2034-35	2035-36	2036-37	2037-38	2038-39	2039-40
New Residential																								
CSUMB Housing (CSU Corporation)	CSUMB	Multi family (> 15 units / acre)	Dwelling Units							70	70	70	70	70	70	70	70	70	70	70	70	70	70	45
Student Housing Phase 3	CSUMB	Other	Beds				400																	
Student Housing Phase 4	CSUMB	Other	Beds								600													
Student Housing Phase 5	CSUMB	Other	Beds										600											
Student Housing Phase 6	CSUMB	Other	Beds											600										
Student Housing Phase 7	CSUMB	Other	Beds														600							
Student Housing Phase 8	CSUMB	Other	Beds																600					
Student Housing Phase 9	CSUMB	Other	Beds																	600				
Student Housing Phase 10	CSUMB	Other	Beds																			600		
UCMBEST																								
New Residential																								
UC 8th Street	UC/MCO	Multi family (> 15 units / acre)	Dwelling Units												30	30	35	35	35	35	30	30	30	
UC East Campus - SF	UC/MCO	SF Residential (< 5 units / acre)	Dwelling Units								110	110	20											
UC East Campus - MF	UC/MCO	Multi family (> 15 units / acre)	Dwelling Units																					
Seaside																								
Residential																								
Seaside Resort Housing	SEA	SF Residential (< 5 units / acre)	Dwelling Units				25	25	25	25	22													
Seaside East	SEA	SF Residential (5-8 units / acre)	Dwelling Units												100	100	100	100	100	100	100	100	100	100
Nurses Barracks	SEA	Multi family (> 15 units / acre)	Dwelling Units			40																		
Seaside Senior Living	SEA	Multi family (> 15 units / acre)	Dwelling Units				88	43	13															
Main Gate																								
Single Family Homes	SEA	Residential (8-15 units / acre)	Dwelling Units				10	70	60															
Apartments	SEA	Multi family (> 15 units / acre)	Dwelling Units					310	140	30														
Campus Town																								
Single Family Homes	SEA	Residential (8-15 units / acre)	Dwelling Units					100	84	60					70	70	70	70	70	70	70	70	70	11
Apartments	SEA	Multi family (> 15 units / acre)	Dwelling Units												100	100	100	100	100	100				
Del Rey Oaks																								
New Residential																								
Del Rey Oaks																								
Residential	DRO	SF Residential (5-8 units / acre)	Dwelling Units							50	50	50	50	50	25									
Golf Villas	DRO	SF Residential (< 5 units / acre)	Dwelling Units																					
Patio Homes	DRO	SF Residential (< 5 units / acre)	Dwelling Units																					
Condos	DRO	Multi family (> 15 units / acre)	Dwelling Units																					
Workforce	DRO	Multi family (> 15 units / acre)	Dwelling Units																					
Townhomes/Senior Casitas	DRO	SF Residential (5-8 units / acre)	Dwelling Units																					
RV Resort (Manager)	DRO	Residential (8-15 units / acre)	Dwelling Units					1																
US Army																								
Residential																								
Lower Stilwell Single Family	ARMY	Residential (8-15 units / acre)	Dwelling Units				36	42	72															
Lower Stilwell Duplex	ARMY	Residential (8-15 units / acre)	Dwelling Units																					
CA State Parks																								
Residential																								
Staff Housing	SP	SF Residential (5-8 units / acre)	Dwelling Units							3														

CSUMB		Jurisd
New Residential		
CSUMB Housing (CSU Corporation)	CSUMB	
Student Housing Phase 3	CSUMB	
Student Housing Phase 4	CSUMB	
Student Housing Phase 5	CSUMB	
Student Housing Phase 6	CSUMB	
Student Housing Phase 7	CSUMB	
Student Housing Phase 8	CSUMB	
Student Housing Phase 9	CSUMB	
Student Housing Phase 10	CSUMB	
UCMBEST		
New Residential		
UC 8th Street	UC/MCO	
UC East Campus - SF	UC/MCO	
UC East Campus - MF	UC/MCO	
Seaside		
Residential		
Seaside Resort Housing	SEA	
Seaside East	SEA	
Nurses Barracks	SEA	
Seaside Senior Living	SEA	
Main Gate		
Single Family Homes	SEA	
Apartments	SEA	
Campus Town		
Single Family Homes	SEA	
Apartments	SEA	
Del Rey Oaks		
New Residential		
Del Rey Oaks		
Residential	DRO	
Golf Villas	DRO	
Patio Homes	DRO	
Condos	DRO	
Workforce	DRO	
Townhomes/Senior Casitas	DRO	
RV Resort (Manager)	DRO	
US Army		
Residential		
Lower Stilwell Single Family	ARMY	
Lower Stilwell Duplex	ARMY	
CA State Parks		
Residential		
Staff Housing	SP	

CSUMB
2.1
1
1
1
1
1
1
1
1
1

UC MBEST
2.6
2.6
2.6

Seaside
3.0
3.0
3.0
1.5
3.0
3.0
3.0
3.0
3.0
3.0

Del Rey Oaks
3.0
3.5
3.0
1.8
2.5
2.0
3.0

Army
3.0
3.0

Army
3.0

2020	2025	2030	2035	2040
0	0	718	718	667
0	400	0	0	0
0	0	600	0	0
0	0	600	0	0
0	0	0	600	0
0	0	0	600	0
0	0	0	600	0
0	0	0	0	600
0	0	0	0	600
0	400	1918	2518	1867

2020	2025	2030	2035	2040
0	0	0	429	325
0	0	624	0	0
0	0	0	0	0
0	0	624	429	325

2020	2025	2030	2035	2040
0	225	141	0	0
0	0	0	1500	1500
0	120	0	0	0
0	216	0	0	0
0	0	0	0	0
0	420	0	0	0
0	1350	90	0	0
0	0	0	0	0
0	552	180	1050	873
0	0	0	1500	300
0	2883	411	4050	2673

2020	2025	2030	2035	2040
0	0	750	75	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	3	0	0	0
0	3	750	75	0

2015	2020	2025	2030	2035
0	450	0	0	0
0	0	0	0	0
0	450	0	0	0

2015	2020	2025	2030	2035
0	0	9	0	0

2020	2025	2030	2035	2040
0	0	718	1436	2102
0	400	400	400	400
0	0	600	600	600
0	0	600	600	600
0	0	0	600	600
0	0	0	600	600
0	0	0	600	600
0	0	0	0	600
0	0	0	0	600
0	400	2318	4836	6702

2020	2025	2030	2035	2040
0	0	0	429	754
0	0	624	624	624
0	0	0	0	0
0	0	624	1053	1378

2020	2025	2030	2035	2040
0	225	366	366	366
0	0	0	1500	3000
0	120	120	120	120
0	216	216	216	216
0	0	0	0	0
0	420	420	420	420
0	1350	1440	1440	1440
0	0	0	0	0
0	552	732	1782	2655
0	0	0	1500	1800
0	2883	3294	7344	10017

2020	2025	2030	2035	2040
0	0	750	825	825
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	3	3	3	3
0	3	753	828	828

2015	2020	2025	2030	2035
0	450	450	450	450
0	0	0	0	0
0	450	450	450	450

2015	2020	2025	2030	2035
0	0	9	9	9

2020	2025	2030	2035	2040
0	0	350	350	325
0	400	0	0	0
0	0	600	0	0
0	0	600	0	0
0	0	0	600	0
0	0	0	600	0
0	0	0	600	0
0	0	0	0	600
0	0	0	0	600
0	400	1550	2150	1525

2020	2025	2030	2035	2040
0	0	0	165	125
0	0	240	0	0
0	0	0	0	0
0	0	240	165	125

2020	2025	2030	2035	2040
0	75	47	0	0
0	0	0	500	500
0	40	0	0	0
0	144	0	0	0
0	0	0	0	0
0	140	0	0	0
0	450	30	0	0
0	0	0	0	0
0	184	60	350	291
0	0	0	500	100
0	1033	137	1350	891

2020	2025	2030	2035	2040
0	0	250	25	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	0	0	0	0
0	1	0	0	0
0	1	250	25	0

2015	2020	2025	2030	2035
0	150	0	0	0
0	0	0	0	0
0	150	0	0	0

2015	2020	2025	2030	2035
0	0	3	0	0

Marina Coast Water District 2020 Urban Water Management Plan

Table C6: Projected Demands by Source, with Planned Recycled Use (AFY)

Total Demands by Jurisdiction		2020	2025	2030	2035	2040	SVGB Allocation	RW Allocation
Ord	U.S. Army	409	461	471	471	471	1,562	
	CSUMB	318	421	616	821	977	1,035	87
	Del Rey Oaks	0	31	224	238	238	243	280
	City of Monterey	0	0	130	130	130	65	
	County of Monterey	227	436	436	522	522	710	134
	UCMBEST	1	116	335	377	408	230	60
	City of Seaside	339	839	1,032	1,435	1,698	1,012	453
	State Parks and Rec.	0	7	9	9	9	45	
	Marina Ord Comm.	446	1,125	1,638	1,757	1,809	1,340	345
	Assumed Line Loss	190	348	348	348	348	348	68
Marina	Armstrong Ranch	0	550	680	680	680	920	
	CEMEX	0	10	10	10	10	500	
	Marina Central	1,438	1,656	1,874	2,081	2,284	3,020	
	Subtotal - Ord	1,929	3,784	5,239	6,108	6,610	6,600	1,427
	Subtotal - Marina	1,438	2,217	2,563	2,771	2,974	4,440	0
Total	3,367	6,001	7,802	8,879	9,584	11,040	1,427	

Recycled Water Demand (1,2)

U.S. Army	0	0	0	0	0
CSUMB	0	70	110	150	190
Del Rey Oaks	0	0	10	10	10
City of Monterey	0	0	0	0	0
County of Monterey	0	30	39	39	39
UCMBEST	0	0	60	60	60
City of Seaside	0	490	559	590	620
State Parks and Rec.	0	0	0	0	0
Marina Ord Comm.	0	10	110	175	235
Assumed Line Loss					
Armstrong Ranch	0	0	40	40	40
CEMEX	0	0	0	0	0
Marina Central	0	0	26	77	77

RW Phasing

Tier 1	Tier 2	Tier 3
		47
70		241
	39	
		59
502	57	158
17	93	125
		40
26		51

Groundwater Demand (3)

U.S. Army	409	461	471	471	471
CSUMB	318	352	506	671	787
Del Rey Oaks	0	31	214	228	228
City of Monterey	0	0	65	65	65
County of Monterey	227	406	397	483	483
UCMBEST	1	116	230	230	230
City of Seaside	339	349	473	845	1,012
State Parks and Rec.	0	7	9	9	9
Marina Ord Comm.	446	1,115	1,340	1,340	1,340
Assumed Line Loss	190	348	348	348	348
Armstrong Ranch	0	550	640	640	640
CEMEX	0	10	10	10	10
Marina Central	1,438	1,656	1,848	2,004	2,207

Remaining GW

1,091
248
15
0
227
0
0
36
0
0
280
490
813

3,199 total unused

Demand by Source	2020	2025	2030	2035	2040
Groundwater	3,367	5,401	6,550	7,345	7,831
Recycled Water	0	600	953	1,140	1,270
Desalinated Water(4,5)	0	0	299	394	483

Notes:

- 1 2025 value = Tier 1&2 Demand
- 2 Total capped at 600 AFY Phase 1 proejct
- 3 Maximum of projected potable demand or SVGB allocation
- 4 Desalinated demand is total minus groundwater and recycled
- 5 Or other potable supply

Appendix D: Notices and Letters to Public Agencies

The following notices and mailings were prepared during the development of this Urban Water Management Plan, and are included in this appendix.

1. 60-day Notice to Cities and Agencies, dated January 4, 2021 (sample letter)
2. Demand Projection Review to Cities, dated March 8, 2021 (sample letter)
3. Mailing list for notices and reviews
4. Transmittal of Draft Plan to Cities and Agencies, dated May 20, 2021 (sample letter, same mailing list as item 3)
5. Newspaper Notices for Public Hearing, published on May 29 and June 5, 2021
6. MCWD Board Agenda and Staff Report for Public Hearing, June 21, 2020 meeting
7. Transmittal of Adopted Plan to Cities and Agencies, dated July 2, 2021 (sample letter, same mailing list as item 3)



MARINA COAST WATER DISTRICT

11 RESERVATION ROAD, MARINA, CA 93933-2099

Home Page: www.mcwd.org

TEL: (831) 384-6131 FAX: (831) 883-5995

DIRECTORS

JAN SHRINER
President

THOMAS P. MOORE
Vice President

HERBERT CORTEZ
MATT ZEFFERMAN

January 4, 2021

Mr. Layne Long, City Manager
City of Marina
211 Hillcrest Ave
Marina, CA 93933

Dear Mr. Long:

The Marina Coast Water District (MCWD) is preparing an updated Urban Water Management Plan (UWMP) for submittal to the California Department of Water Resources, pursuant to the Urban Water Management Planning Act, as codified in the California Water Code Sections 10610-10656. The last UWMP was adopted in 2016.

The updated plan is currently being drafted. You will be contacted by our planning consultant for review and input on the development and water demand projections for the planning period, which runs to the year 2040. Our anticipated schedule for public review and plan adoption is:

April 22, 2021	Publish public review draft of the UWMP
May 17, 2021	Conduct public hearing at the regularly scheduled MCWD Board meeting
May 31, 2021	Comment period closes
June 21, 2021	Adopt final UWMP at the regularly scheduled MCWD Board meeting

We will provide you a copy of the public review draft plan in April. We invite your input and comments on the UWMP. Please provide input to our consultant, Schaaf & Wheeler Consulting Civil Engineers, Attn: Andy Sterbenz, 3 Quail Run Circle, Suite 101, Salinas, CA, 93907. Andy may be contacted by phone at (831) 883-4848, or by e-mail at asterbenz@swsv.com. You may contact me by direct phone at (831) 883-5951, or e-mail pbreen@mcwd.org.

Sincerely,

Patrick J. Breen
Water Resources Manager

Schaaf & Wheeler
CONSULTING CIVIL ENGINEERS

3 Quail Run Circle, Suite 101
Salinas, CA 93907
831-883-4848
FAX 831-758-6328

March 8, 2021

Mr. Layne Long
City Manager
City of Marina
211 Hillcrest Ave
Marina, CA 93933

Subject: Marina Coast Water District, 2020 Urban Water Management Plan

Dear Mr. Long:

Schaaf & Wheeler is preparing the 2020 Urban Water Management Plan (UWMP) for the Marina Coast Water District. These plans are prepared by water suppliers every five years. Existing and projected water demands are compared to existing and planned water supplies to ensure there is sufficient supply available. A preliminary task in this effort is to coordinate with the District's customer jurisdictions to determine projected population and water demands. The 2020 UWMP will need to account for existing and forecasted water demands by five-year increments through the year 2040.

Water demands are generally a function of the size (acreage/square footage) or number of units in a development, depending on the type of land use, and a water demand unit factor that corresponds to that use. For each type of land use, Demand = Size x Unit Factor. Using this concept, Schaaf & Wheeler has prepared a preliminary estimate of water demands by land use type and by jurisdiction through 2035 as follows:

- Existing demands from the District's 2020 water usage records for each jurisdictional area.
- For developments that have approved Specific Plans, the water demand factors and total water demand estimates have been taken from the respective Water Supply Assessments (WSAs) for these Specific Plan areas.
- For in-fill development under approved General Plans or Master Plans (e.g., the City of Marina, CSUMB), the District's standard water demand factors have been used with the in-fill land use projections provided by the jurisdiction. (The District's standard water demand factors are attached as Table 1 to this letter.)
- For most of the future development within the District's planning area, including planned Fort Ord redevelopment through 2030, we have incorporated the Fort Ord Reuse Authority's (FORA) final development forecast from their FY 2019-20 CIP. The projected developments, generally by square footage or units, are then multiplied by the appropriate unit demand factors.

- For areas not reflected in the Fort Ord Reuse Authority forecast (Central Marina, Army Housing and State Parks), the projections build on the 2015 UWMP, adding data from any more recent studies or projects.

You will find attached to this letter several tables detailing the estimates of existing and projected water usage. The 2020 summary table (C.1) categorizes demand estimates by jurisdiction. The 2015 demand summary (C.2) is provided for reference. The more detailed table (C.3) shows the projected development over the next 20-years, by component parts. The

Please have the appropriate staff member(s) review the projected development for your jurisdiction and report any updates or discrepancies to us. Please note the following updates since 2015:

- The projections reflect the Water Supply Assessments (WSA) prepared for the Downtown Vitalization Specific Plan (DVSP) and the Airport Specific Plan
- In-fill development projection is reduced per the revisions made in the DVSP WSA
- Several older projects have been zeroed out (Airport Golf Course project, MPC Campus expansion)

The 2020 UWMP is projected to be completed in June 2021. We would appreciate your prompt review of and feedback on the projected water use figures. Even if no discrepancies are noted, please respond within thirty (30) days so that the UWMP preparation can proceed as scheduled.

Feel free to contact me at 831-883-4848, email asterbenz@swws.com, with any questions regarding this matter. Thank you for your cooperation.

Sincerely,
Schaaf & Wheeler

Andrew A. Sterbenz, PE
Senior Project Manager

Attachments

Mailing List for Notices and Reviews

City of Marina	Mr. Layne Long, City Manager City of Marina 211 Hillcrest Ave. Marina, CA 93933
City of Seaside	Mr. Craig Malin, City Manager City of Seaside 440 Harcourt Ave. Seaside, CA 93955
City of Del Rey Oaks	Mr. Jeffrey Hoyne, Acting City Manager City of Del Rey Oaks 650 Canyon Del Rey Road Del Rey Oaks, CA 93940 Phone: 831-394-8511 Fax: 831-394-6421
City of Monterey	Mr. Hans Uslar, City Manager City of Monterey 580 Pacific Street Monterey, CA 93940
County of Monterey	Mr. Carl P. Holm, AICP County of Monterey, Director, Resource Management Agency 1441 Schilling Place, 2 nd Floor-South Salinas, CA 93901
MCWRA	Mr. Brent Buche, General Manager Monterey County Water Resources Agency 1441 Schilling Place, North Bldg Salinas, CA 93901
M1W	Mr. Paul Sciuto, General Manager Monterey One Water 5 Harris Court, Bldg D Monterey, CA 93940

CSUMB	<p>Mr. Marcel Forte CSUMB, Associate Vice President for Facilities Management 100 Campus Center, CSU Monterey Bay Seaside CA 93955-8001 (831) 582-4796 mforte@csumb.edu Alternate POC: Anya Spear, aspear@csumb.edu, 582-5098</p>
UCMBEST	<p>Mr. Stephen Matarazzo Planning Director, UC MBEST Center 3180 Imjin Road, Suite 104 Marina. CA 93933 Phone: 831.521.7273 smataraz@ucsc.edu</p>
US Army	<p>Mr. Oscar Ordonez Presidio of Monterey, Directorate of Public Works IMPM-PW-H Attn: Oscar Ordonez 4463 Gigling Road, Rm 304 Seaside, CA 93955</p>
State Parks	<p>Ms. Brent Marshall, Superintendent California State Parks, Monterey District 2211 Garden Road Monterey, CA 93940</p>
CalAm	<p>Mr. Chris Cook General Manager, Monterey District California American Water 511 Forest Lodge Road, Suite 100 Pacific Grove, CA 93950</p>
MPWMD	<p>Mr. David J Stoldt Monterey Peninsula Water Management District 5 Harris Court, Bldg G Monterey, CA 93940</p>



MARINA COAST WATER DISTRICT

11 RESERVATION ROAD, MARINA, CA 93933-2099

Home Page: www.mcwd.org

TEL: (831) 384-6131 FAX: (831) 883-5995

DIRECTORS

JAN SHRINER
President

THOMAS P. MOORE
Vice President

HERBERT CORTEZ
MATT ZEFFERMAN
GAIL MORTON

May 20, 2021

Mr. Layne Long, City Manager
City of Marina
211 Hillcrest Ave
Marina, CA 93933

Dear Mr. Long:

The Marina Coast Water District (MCWD) is preparing an updated Urban Water Management Plan (UWMP) for submittal to the California Department of Water Resources, pursuant to the Urban Water Management Planning Act, as codified in the California Water Code Sections 10610-10656. The plan is a projection of water supply and demand through the year 2040.

The draft UWMP is now available for public review and comment. The Executive Summary of the report is attached. The full report and appendices are available on the District's website, www.mcwd.org. A public hearing on the plan will be held during our Board of Directors meeting on June 21, 2021.

Please provide comments to our consultant, Schaaf & Wheeler Consulting Civil Engineers, Attn: Andy Sterbenz, 3 Quail Run Circle, Suite 101, Salinas, CA, 93907. Andy may be contacted by phone at (831) 883-4848, or by e-mail at asterbenz@swsv.com. You may contact me by direct phone at (831) 883-5951, or e-mail pbreen@mcwd.org.

Sincerely,

Patrick J. Breen
Water Resources Manager

Publication Name:
Monterey County Herald

Publication URL:
www.montereyherald.com

Publication City and State:
Monterey, CA

Publication County:
Monterey

Notice Popular Keyword Category:

Notice Keywords:
marina coast

Notice Authentication Number:
202106281022557876664
216635802

Notice URL:

[Back](#)

Notice Publish Date:
Saturday, May 29, 2021

Notice Content

NOTICE OF PUBLIC HEARING THE MARINA COAST WATER DISTRICT will conduct a public hearing to receive comments on the 2020 Urban Water Management Plan. The Urban Water Management Plan addresses water supply and water demands within the District's Marina and Ord Community Service Areas for the next 20-years. The District Board of Directors will conduct the hearing at their regularly scheduled meeting at 7:00 p.m., Monday, June 21, 2021, via Zoom at <https://us02web.zoom.us/j/84391790406?pwd=c2s4eFJZbFZTcEFzYzUzbjRjRzBRUT09> Passcode: 285923 Or One tap mobile : US: +16699009128,,84391790406#,,,,*285923# or +12532158782,,84391790406#,,,,*285923# Or Telephone: Dial(for higher quality, dial a number based on your current location): US: +1 669 900 9128 or +1 253 215 8782 or +1 346 248 7799 or +1 301 715 8592 or +1 312 626 6799 or +1 646 558 8656 Webinar ID: 843 9179 0406 Passcode: 285923 The Draft Plan is available for review on the District website at www.mcwd.org. Written comments will be accepted until 5:00 p.m., Friday, June 18, 2021. Submit written comments to MCWD, ATTN: Patrick Breen, 11 Reservation Road, Marina, CA 93933. Email pbreen@mcwd.org, Phone (831)384-6131, Fax (831)384-0197. 5/30, 6/06/2021

[Back](#)

Publication Name:
Monterey County Herald

Publication URL:
www.montereyherald.com

Publication City and State:
Monterey, CA

Publication County:
Monterey

Notice Popular Keyword Category:

Notice Keywords:
marina coast

Notice Authentication Number:
202106281023264127417
216635802

Notice URL:

[Back](#)

Notice Publish Date:
Saturday, June 05, 2021

Notice Content

NOTICE OF PUBLIC HEARING THE MARINA COAST WATER DISTRICT will conduct a public hearing to receive comments on the 2020 Urban Water Management Plan. The Urban Water Management Plan addresses water supply and water demands within the District's Marina and Ord Community Service Areas for the next 20-years. The District Board of Directors will conduct the hearing at their regularly scheduled meeting at 7:00 p.m., Monday, June 21, 2021, via Zoom at <https://us02web.zoom.us/j/84391790406?pwd=c2s4eFJZbFZTcEFzYzUzbjRjRzBRUT09> Passcode: 285923 Or One tap mobile : US: +16699009128,,84391790406#,,,,*285923# or +12532158782,,84391790406#,,,,*285923# Or Telephone: Dial(for higher quality, dial a number based on your current location): US: +1 669 900 9128 or +1 253 215 8782 or +1 346 248 7799 or +1 301 715 8592 or +1 312 626 6799 or +1 646 558 8656 Webinar ID: 843 9179 0406 Passcode: 285923 The Draft Plan is available for review on the District website at www.mcwd.org. Written comments will be accepted until 5:00 p.m., Friday, June 18, 2021. Submit written comments to MCWD, ATTN: Patrick Breen, 11 Reservation Road, Marina, CA 93933. Email pbreen@mcwd.org, Phone (831)384-6131, Fax (831)384-0197. 5/30, 6/06/2021

[Back](#)



MARINA COAST WATER DISTRICT

11 RESERVATION ROAD, MARINA, CA 93933-2099

Home Page: www.mcwd.org

TEL: (831) 384-6131 FAX: (831) 883-5995

DIRECTORS

JAN SHRINER
President

THOMAS P. MOORE
Vice President

HERBERT CORTEZ
GAIL MORTON
MATT ZEFFERMAN

Agenda

**Regular Board Meeting, Board of Directors
Marina Coast Water District**

and

**Regular Board Meeting, Board of Directors
Marina Coast Water District Groundwater Sustainability Agency**

Monday, June 21, 2021, 6:30 p.m. PST

Due to Governor Newsom's Executive Order N-29-20 and recommendations on protocols to contain the spread of COVID-19, staff and Board members will be attending the June 21, 2021 meeting remotely from various locations and the meeting will be held via Zoom conference. There will be NO physical location of the meeting. The public is strongly encouraged to use the Zoom app for best reception.

There may be limited opportunity to provide verbal comments during the meeting. Persons who are participating via telephone will need to press *9 to be acknowledged for comments. Members of the public participating by Zoom will be placed on mute during the proceedings and will be acknowledged only when public comment is allowed, after requesting and receiving recognition from the Board President. Public comment can also be submitted in writing to Paula Riso at priso@mcwd.org by 9:00 am on Monday, June 21, 2021; such comments will be distributed to the MCWD Board before the meeting.

This meeting may be accessed remotely using the following Zoom link:

<https://us02web.zoom.us/j/84391790406?pwd=c2s4eFJZbFZTcEFzYzUzbjRjRzBRUT09>

Passcode: 285923

To participate via phone: 1-669-900-9128; Meeting ID: 843 9179 0406 Passcode: 285923

Our Mission: We provide our customers with high quality water, wastewater collection and conservation services at a reasonable cost, through planning, management, and the development of water resources in an environmentally sensitive manner.

1. Call to Order

2. Roll Call

3. Public Comment on Closed Session Items *Anyone wishing to address the Board on matters appearing on Closed Session may do so at this time. Please limit your comment to four minutes. The public may comment on any other items listed on the agenda at the time they are considered by the Board.*

This agenda is subject to revision and may be amended prior to the scheduled meeting. Pursuant to Government Code section 54954.2(a)(1), the agenda for each meeting of the Board shall be posted at the District offices at 11 Reservation Road, Marina. The agenda shall also be posted at the following locations, but those locations are not official agenda posting locations for purposes of section 54954.2(a)(1): City of Marina Council Chambers. A complete Board packet containing all enclosures and staff materials will be available for public review on the District website, Wednesday, June 16, 2021. Information about items on this agenda or persons requesting disability related modifications and/or accommodations should contact the Board Clerk 48 hours prior to the meeting at: 831-883-5910

4. Closed Session

A. Pursuant to Government Code 54956.9

Conference with Legal Counsel – Existing Litigation

- 1) Bay View Community DE, LLC; Bryan Taylor; Greg Carter; and Brooke Bilyeu vs Marina Coast Water District; Board of Directors of Marina Coast Water District; County of Monterey and Does 1-25, inclusive, Monterey County Superior Court Case No. 18CV000765 (Petition for Writ of Mandate or Administrative Mandate, and Complaint for Declaratory and Injunctive Relief and Breach of Contract)
- 2) California-American Water Company, Real Party in Interest vs Marina Coast Water District, Court of Appeal, Sixth Appellate District Case No. (to be assigned; Cal-Am filed Notice of Appeal on May 25, 2021) (CalAm’s appeal of decision by Trial Court in MCWD’s favor in MCWD’s Monterey County Superior Court Case No. 19CV003305 (Petition for Writ of Mandate and Complaint for Injunctive Relief))
- 3) Appeal No. A-3-MRA-19-0034 by California-American Water Company to the California Coastal Commission over Denial by the City of Marina for a Coastal Development Permit for Construction of Slant Intake Wells for the Monterey Peninsula Water Supply Project
- 4) City of Marina vs. RMC Lonestar [CEMEX], California-America Water Company, Marina Coast WD, et al Defendants, Monterey County Superior Court Case No. 20CV001387 (Complaint for Breach of Contract, Declaratory Relief under the Agency Act, and Tortious Interference with Existing Contract)
- 5) California-American Water Company and Monterey County Water Resources Agency vs Marina Coast Water District, Court of Appeal, First Appellate District Case No. A160662 (CalAm’s appeal from Trial Court’s granting of summary adjudication of CalAm’s tort causes of action in favor of MCWD)

B. Pursuant to Government Code 54957

Public Employee Performance Evaluation

Title: General Manager

7:00 p.m. Reconvene Open Session

5. Reportable Actions Taken During Closed Session *The Board will announce any reportable action taken during closed session and the vote or abstention on that action of every director present and may take additional action in open session as appropriate. Any closed session items not completed may be continued to after the end of all open session items.*

6. Pledge of Allegiance

7. Oral Communications *Anyone wishing to address the Board on matters not appearing on the Agenda may do so at this time. Please limit your comment to four minutes. The public may comment on any other items listed on the agenda at the time they are considered by the Board.*

8. Presentation

- A. Adopt Resolution No. 2021-32 Congratulating and Recognizing Michael Wegley on his Retirement as the District Engineer with 6 Years of Service to Marina Coast Water District

9. Consent Calendar

- A. Receive and File the Check Register for the Month of May 2021
- B. Approve the Draft Minutes of the Special Joint Board/GSA Meeting of May 10, 2021
- C. Approve the Draft Minutes of the Regular Joint Board/GSA Meeting of May 17, 2021
- D. Adopt Resolution No. 2021-33 to Authorize a Notice of Completion for the Human Machine Interface Project to be Filed with the Monterey County Recorder
- E. Adopt Resolution No. 2021-34 to Approve a Water, Sewer and Recycled Water Infrastructure Agreement between the Marina Coast Water District and Shea Homes Limited Partnership for the Enclave at Cypress Grove Seaside Resort Project

10. Public Hearing

- A. Conduct a Public Hearing to Receive Public Comment on the Draft 2020 Urban Water Management Plan

11. Action Items *The Board will review and discuss agenda items and take action or direct staff to return to the Board for action at a following meeting. The public may address the Board on these items as each item is reviewed by the Board. Please limit your comment to four minutes.*

- A. Adopt Resolution No. 2021-35 to Adopt the District's 2020 Urban Water Management Plan
- B. Adopt Resolution No. 2021-36 to Accept the District's Five-Year Capital Improvement Projects Plan
- C. Adopt Resolution No. 2021-37 to Approve the Marina Coast Water District Budget for FY 2021-2022
- D. Adopt Resolution No. 2021-38 to Approve a Revision to the Board Procedures Manual - Section 36 – Board Member Compensation
- E. Provide Direction Regarding Election to the Coastal Network, Seat A, of the California Special Districts Association Board

12. Staff Report

- A. Receive an Update on the Fiscal Impacts to the District due to Covid-19

13. Informational Items *Informational items are normally provided in the form of a written report or verbal update and may not require Board action. The public may address the Board on Informational Items as they are considered by the Board. Please limit your comments to four minutes.*

A. General Manager's Report

B. Counsel's Report

C. Committee and Board Liaison Reports

- | | |
|-----------------------------------|------------------------------------|
| 1. Water Conservation Commission | 6. M1W Board Member Liaison |
| 2. Joint City-District Committee | 7. LAFCO Liaison |
| 3. Executive Committee | 8. JPIA Liaison |
| 4. Community Outreach Committee | 9. Special Districts Association |
| 5. Budget and Personnel Committee | 10. MCWD/SVBGSA Steering Committee |

14. Correspondence

15. Board Member Requests for Future Agenda Items

16. Director's Comments *Director reports on meetings with other agencies, organizations and individuals on behalf of the District and on official District matters.*

17. Adjournment *Set or Announce Next Meeting(s), date(s), time(s), and location(s):*

Regular Meeting: Monday, July 19, 2021, 6:30 p.m.

Marina Coast Water District
Agenda Transmittal

Agenda Item: 11-A

Meeting Date: June 21, 2021

Prepared By: Patrick Breen

Approved By: Remleh Scherzinger

Agenda Title: Adopt Resolution No. 2021-35 to Adopt the 2020 Urban Water Management Plan

Staff Recommendation: The Board conduct a public hearing to receive comments on the Marina Coast Water District 2020 Urban Water Management Plan. Following the closure of the public hearing, the comments received may be contemplated and the 2020 Urban Water Management Plan can be considered for adoption by the Board.

Background: *Strategic Plan, Mission Statement – We provide our customers with high-quality water, wastewater collection, and conservation services at a reasonable cost, through planning, management, and the development of water resources in an environmentally sensitive manner.*

Pursuant to California law, all wholesale and retail municipal water suppliers serving over 3,000 connections or 3,000 acre-feet of water per year must prepare an Urban Water Management Plan (UWMP) every five years. The 2015 Marina Coast Water District (MCWD) UWMP was adopted by the Board on June 6, 2016 (Resolution No. 2016-33).

Discussion/Analysis: In accordance with the California UWMP Act, a notice of preparation of the proposed 2020 UWMP was posted to the District’s website and mailed to the affected cities and county (or land use jurisdiction) in January 2021.

The Executive Summary of the 2020 UWMP along with a link to the complete plan was distributed to the land use jurisdictions on May 20, 2021, with a deadline for comments of 5:00 p.m. on Friday, June 18, 2021. Public advertisement(s) for this document were run in local newspapers, with the same deadline for written comments. All comments received will be included in the Appendices of the adopted 2020 UWMP. Updated plans for the 2020 planning cycle must be adopted by July 1, 2021.

Environmental Impact: None required.

Financial Impact: Yes No Funding Source/Recap: Funding of the plan was included in the 2020/2021 Water Resources Department Budget.

Other Considerations: The Board can choose not to hold a public hearing, not adopt the plan, and/or direct staff as appropriate.

Material Included for Information/Consideration: Resolution No. 2021-35; and, [2020 Marina Coast Water District Urban Water Management Plan \(provided separately\)](#).

Action Required: Resolution Motion Review
(Roll call vote is required.)

Board Action

Motion By _____ Seconded By _____ No Action Taken _____

Ayes _____

Abstained _____

Noes _____

Absent _____



MARINA COAST WATER DISTRICT

11 RESERVATION ROAD, MARINA, CA 93933-2099

Home Page: www.mcwd.org

TEL: (831) 384-6131 FAX: (831) 883-5995

DIRECTORS

JAN SHRINER
President

THOMAS P. MOORE
Vice President

HERBERT CORTEZ
MATT ZEFFERMAN
GAIL MORTON

July 2, 2021

Mr. Layne Long, City Manager
City of Marina
211 Hillcrest Ave
Marina, CA 93933

Dear Mr. Long:

Enclosed please find one copy of the Marina Coast Water District 2020 Urban Water Management Plan (UWMP). The District Board of Directors adopted the UWMP at the June 21, 2021 Board Meeting.

Copies of this plan are being provided to the State Department of Water Resources, the California State Library and the jurisdictions served by MCWD. Electronic copies of the 2020 UWMP are available at the District website, www.mcwd.org.

If you have any questions, you may contact me by direct phone at (831) 883-5951, or e-mail pbreen@mcwd.org.

Sincerely,

Patrick J. Breen
Water Resources Manager

Appendix E: Technical Memoranda

The following technical memoranda were prepared as interim reports during the development of this Urban Water Management Plan, and are included in this appendix.

1. District Population Estimate, dated 4/26/2021
2. Water Allocations by Jurisdiction, dated 4/30/2021
3. MCWRA Zones of Benefit and Assessment, dated 4/30/2021
4. MCWD Seismic Risk Assessment, 5/14/2021

MEMORANDUM

TO: Patrick Breen and Paul Lord
Marina Coast Water District

DATE: April 26, 2021

FROM: Andrew Sterbenz, PE

JOB#: MCWD.46.17:010

SUBJECT: 2020 Population Estimate for the Urban Water Management Plan Update

The purpose of this memorandum is to summarize the methodology and source data used to develop the year 2020 population by service area for the Marina Coast Water District (MCWD) 2020 Urban Water Management Plan (UWMP).

2020 Population

MCWD serves the City of Marina and the former Fort Ord, which includes portions of Seaside, Del Rey Oaks, City of Monterey and unincorporated Monterey County. Results from the 2020 Federal Census have not yet been published, so the population estimate for the year 2020 was derived from the estimates published by the California Department of Finance, Demographic Research Unit.

In February 2020, the Demographic Research Unit published a Special District Population Estimate for MCWD, covering the years 2010 to 2019 (attached). The estimated population within the MCWD service area on 1/1/2019 was 36,661 persons. In May 2020, the Demographic Research Unit published the Population Estimates Cities, Counties and State, 2011-2020 (Table 1). Both Monterey County and the City of Marina were shown to have a slight population decrease from 1/1/2019 to 1/1/2020. The County decreased from 441,304 to 441,143, a change of -161 persons or -0.04%. The City of Marina decreased from 22,688 to 22,321, a change of -347 persons or -1.6%.

The percentage change within the MCWD service area is assumed to match the County average, since new homes were being added within the Ord Community. The estimated population is calculated as

$$\begin{array}{r} 0.9996 \times 36,661 = 36,646 \text{ persons total} \\ - 22,321 \text{ persons in Marina} \\ \hline 14,325 \text{ persons in Seaside and unincorporated Monterey County} \end{array}$$

Due to the way the Demographic Research Unit estimate is prepared, a split between the Central Marina and Ord Community Service Areas cannot be made (Central Marina and Marina-Ord are combined in a single value).

The 2020 U.S. Census results were due to be published in April 2021, but the release of detailed data has been delayed. If the 2020 census results are published before the UWMP is adopted, the 2020 population can easily be updated. The MCWD service area is the occupied portion of nine Census Tracts, as listed in Table 2 and shown in Figure 1. The population for Central Marina is the sum of Census Tracts 124.01, 142.02, 143.01 and 143.02. The Ord Community population is the sum of Census Tracts 141.02, 141.04, 141.05, 141.08 and 141.09. Note that the Census Tracts do not always align with city limits, so calculating jurisdictional populations requires aggregating data at the census block level. A small portion of the former Fort Ord (south of South Boundary Road) is within Census Tract 132, but that area is currently undeveloped so it may be omitted.

Population Growth Projection

The population growth projection method used for the UWMP is persons per dwelling unit times the number of dwelling units projected to be added. This method has been used for the two previous UWMP cycles and is consistent with the water demand estimation method. It produces a higher estimate than the regional estimates produced by the Association of Monterey Bay Area Governments (AMBAG) or the Demographic Research Unit, because the redevelopment projection used are optimistic. The AMBAG and Demographic Research Unit population projections are attached for information.

Attachments:

Letter from California Department of Finance, Demographic Research Unit, Special District Population Estimate, Marina Coast Water District, dated 2/12/2020

Table 1: Excerpt from DOF Table E-4, Population

Table 2: 2020 U.S. Census Tracts within MCWD Service Area

Figure 1: Excerpt from U.S. Census Tract Reference Map

Table 3: Excerpt from AMBAG 2022 Regional Growth Forecast

Table 4: Excerpt from CA Dept of Finance Report P-2A

References:

Association of Monterey Bay Area Governments, Final 2022 Regional Growth Forecast, dated 11/18/2020

California Department of Finance, Demographic Research Unit:

Table E-4, Population Estimate for Cities, Counties and State, 2011-2020, published May 1, 2020

Report P-2A, Total Estimated and Projected Population for California and Counties: July 1, 2010 to 2060, published March 2021

Marina Coast Water District 2010 Urban Water Management Plan, prepared by Schaaf & Wheeler, July 2011

Marina Coast Water District 2015 Urban Water Management Plan, prepared by Schaaf & Wheeler, July 2016

U.S Dept. of Commerce, U.S. Census Bureau, 2020 Census - Census Tract Reference Map: Monterey County, CA



February 12, 2020

Mr. Keith Van Der Maaten
 General Manager
 Marina Coast Water District
 11 Reservation Rd.
 Marina, CA 93933-2099

Subject: Special District Population Estimate, Marina Coast Water District

Dear Mr. Van Der Maaten:

The California Department of Finance (Finance) has prepared the special district population estimate requested by the Marina Coast Water District as of January 1, 2019. Pursuant to Article XIII B of the California Constitution, the District's population and housing information is as follows:

Marina City + Fort Ord Community									
	Total Population	Household Population	Group Quarters Population	Housing Units	Households	Vacant Units	Vacancy Rate	Persons Per Household	Population Percent Change
4/1/2010 Census	31,160	28,456	2,704	11,736	10,769	967	8.24%	2.642	
Change 4/1/2010-12/31/2010	166	205	0	1	-9	10			
1/1/2011 Estimate	31,326	28,661	2,665	11,737	10,760	977	8.33%	2.664	0.533
Change 1/1/2011-12/31/2011	416	309	0	1	-6	7			
1/1/2012 Estimate	31,742	28,970	2,772	11,738	10,753	985	8.39%	2.694	1.328
Change 1/1/2012-12/31/2012	242	226	0	0	-25	25			
1/1/2013 Estimate	31,984	29,196	2,788	11,738	10,728	1,010	8.60%	2.721	0.762
Change 1/1/2013-12/31/2013	329	337	0	81	89	-8			
1/1/2014 Estimate	32,313	29,533	2,780	11,819	10,817	1,002	8.48%	2.730	1.029
Change 1/1/2014-12/31/2014	1,081	771	310	228	222	6			
1/1/2015 Estimate	33,394	30,304	3,090	12,047	11,039	1,008	8.37%	2.745	3.345
Change 1/1/2015-12/31/2015	903	534	369	145	104	41			
1/1/2016 Estimate	34,297	30,838	3,459	12,192	11,143	1,049	8.60%	2.767	2.704
Change 1/1/2016-12/31/2016	660	414	246	48	94	-46			
1/1/2017 Estimate	34,957	31,252	3,705	12,240	11,237	1,003	8.20%	2.781	1.924
Change 1/1/2017-12/31/2017	716	683	33	291	261	30			
1/1/2018 Estimate	35,673	31,935	3,738	12,531	11,497	1,034	8.25%	2.778	2.048
Change 1/1/2018-12/31/2018	988	1,098	-110	390	353	37			
1/1/2019 Estimate	36,661	33,033	3,628	12,921	11,850	1,071	8.29%	2.788	2.770

Enclosed is an invoice in the amount of \$1,000.00 for the cost of preparing the 2010 Census benchmark and 2019 special district population estimate for your jurisdiction.

If you require further information regarding this special district population estimate, please contact Doug Kuczynski at (916) 323-4086.

Sincerely,

Doug Kuczynski
 Research Program Specialist
 Demographic Research Unit

Enclosure

Table 1: Excerpt from Table E-4 Population Estimates for Cities, Counties, and State 2011-2020 with 2010 Benchmark

COUNTY/CITY	4/1/2010	1/1/2011	1/1/2012	1/1/2013	1/1/2014	1/1/2015	1/1/2016	1/1/2017	1/1/2018	1/1/2019	1/1/2020
California											
Incorporated Total	30,764,188	31,086,714	31,506,091	31,858,521	32,110,077	32,385,073	32,628,187	32,870,570	33,051,381	33,163,325	33,256,246
Balance Of State Total	6,489,768	6,474,910	6,418,570	6,411,343	6,446,654	6,485,077	6,503,120	6,528,132	6,535,265	6,532,051	6,526,624
State Total	37,253,956	37,561,624	37,924,661	38,269,864	38,556,731	38,870,150	39,131,307	39,398,702	39,586,646	39,695,376	39,782,870
Monterey County											
Carmel-By-The-Sea	3,722	3,726	3,752	3,790	3,807	3,854	3,896	3,915	3,920	3,939	3,949
Del Rey Oaks	1,624	1,631	1,647	1,652	1,657	1,663	1,672	1,678	1,671	1,674	1,662
Gonzales	8,187	8,226	8,308	8,376	8,408	8,441	8,513	8,551	8,535	8,566	8,506
Greenfield	16,330	16,413	16,612	16,997	17,095	17,172	17,650	18,013	18,023	18,109	18,284
King City	12,874	12,958	13,122	13,343	13,421	13,736	14,001	14,214	14,327	14,540	14,797
Marina	19,718	19,771	20,084	20,247	20,313	21,057	21,589	22,051	22,303	22,688	22,321
Monterey	27,810	28,027	28,522	28,237	28,149	28,086	28,181	28,234	28,016	27,992	28,170
Pacific Grove	15,041	15,107	15,224	15,398	15,411	15,460	15,457	15,489	15,355	15,360	15,265
Salinas	150,441	151,167	153,445	156,084	157,332	158,059	160,220	161,124	161,446	162,353	162,222
Sand City	334	335	337	338	341	361	364	365	380	383	385
Seaside	33,025	32,826	33,287	33,512	33,500	33,815	33,781	33,703	33,705	33,047	33,537
Soledad	25,738	26,293	26,295	25,500	24,945	24,597	25,311	25,726	25,593	25,745	25,301
Balance Of County	100,213	100,796	101,986	102,494	103,354	104,009	104,765	105,660	105,919	106,908	106,744
Incorporated	314,844	316,480	320,635	323,474	324,379	326,301	330,635	333,063	333,274	334,396	334,399
County Total	415,057	417,276	422,621	425,968	427,733	430,310	435,400	438,723	439,193	441,304	441,143

Source: California Department of Finance, Demographic Research Unit, released May 1, 2020

Table 2: 2020 U.S. Census Tracts within MCWD Service Area

Census Tract	Service Area	Jurisdiction	Subdivision	Description
141.02	Ord Community	Marina	Dunes, Sea Haven, Abrams, Preston, Airport	Marina-Ord minus CSUMB
141.04	Ord Community	Marina, Seaside, County	CSUMB	CSUMB Campus
141.05	Ord Community	County	CSUMB, East Garrison	County N. of Inter-Garrison
141.08	Ord Community	Seaside	POM Hayes & Stilwell, Seaside Highlands, FODSP	Seaside-Ord W. of GJMB
141.09	Ord Community	Seaside, County	POM Fitch & Marshall, East Garrison	Ord W of GJMB, S. of Inter-Garrison
142.01	Central Marina	Marina	Central Marina	South of Carmel Ave
142.02	Central Marina	Marina	Central Marina	Btwn Carmel and Reservaton
143.01	Central Marina	Marina	Central Marina	West of Del Monte
143.02	Central Marina	Marina	Central Marina	E. of Del Monte, N. of Reservation

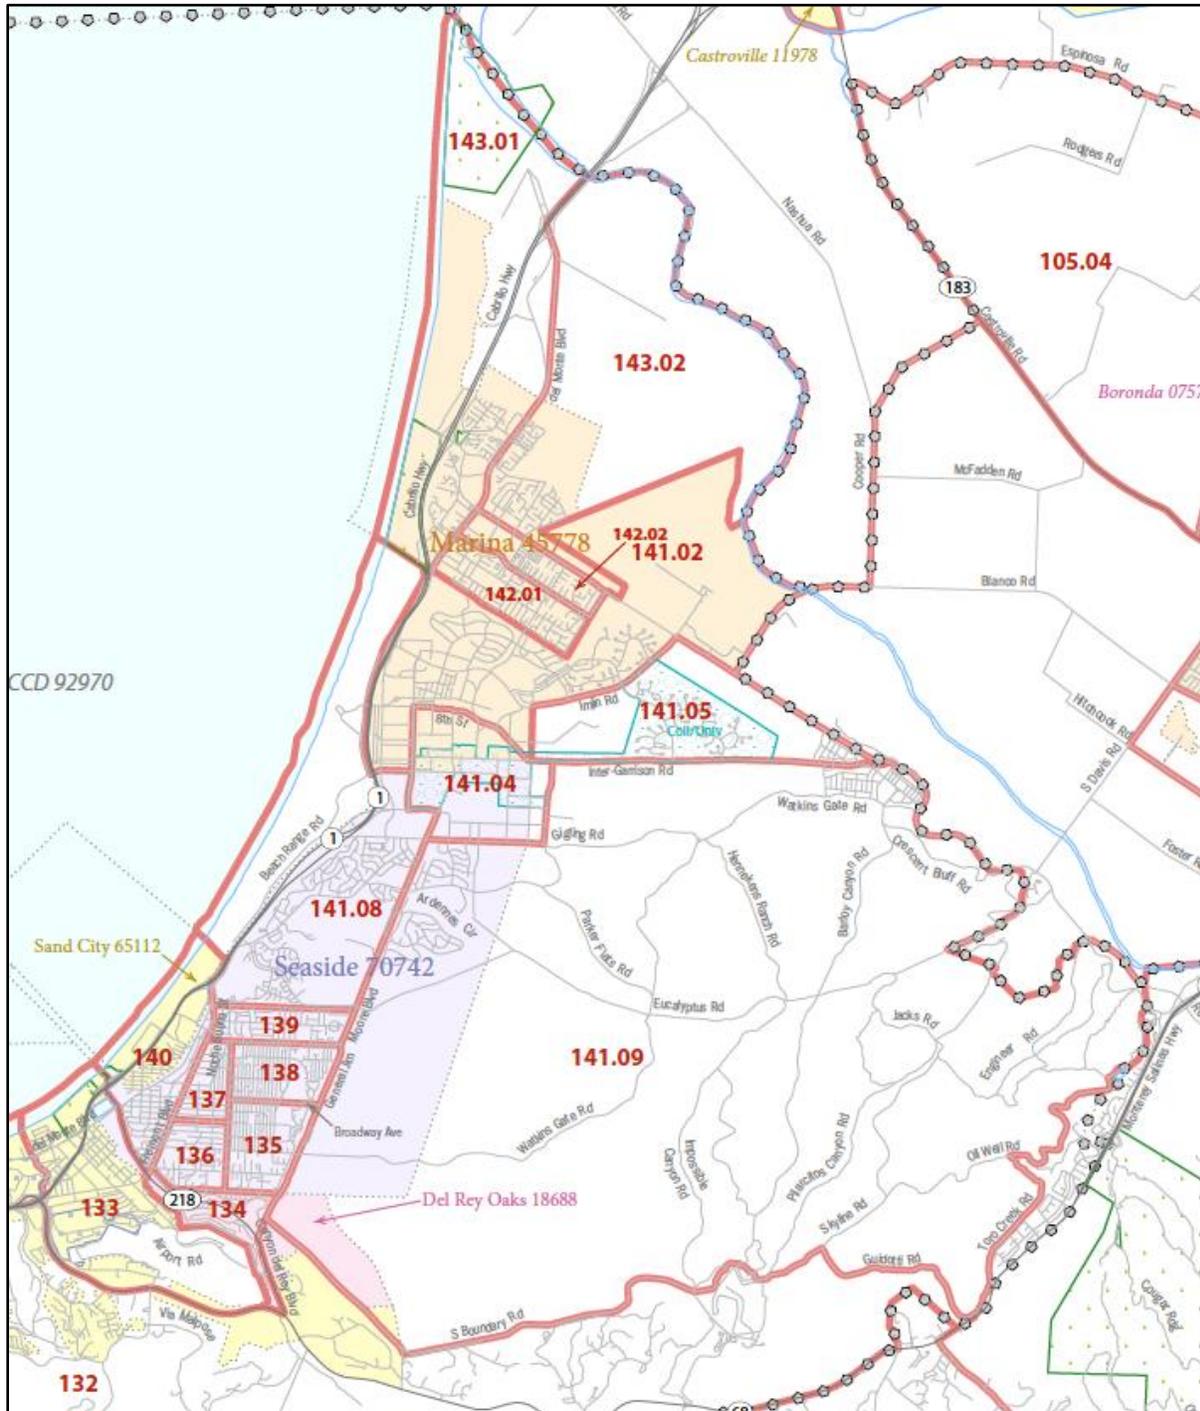


Figure 1: Excerpt from 2020 Census - Census Tract Reference Map: Monterey County, CA

Table 3: Excerpt from AMBAG 2022 Subregional Growth Forecast

	POPULATION								Change 2015-2045	
	2010	2015	2020	2025	2030	2035	2040	2045	Numeric	%
AMBAG Region	732,708	762,241	774,729	800,726	824,992	842,189	857,828	869,776	107,535	14%
Monterey County	415,057	430,310	441,143	452,761	467,068	476,028	483,884	491,443	61,133	14%
Carmel-By-The-Sea	3,722	3,854	3,949	3,946	3,954	3,964	3,974	3,984	130	3%
Del Rey Oaks	1,624	1,663	1,662	1,693	1,734	1,859	2,330	2,650	987	59%
Gonzales	8,187	8,441	8,506	9,650	13,492	14,630	15,398	15,711	7,270	86%
Greenfield	16,330	17,172	18,284	19,342	19,734	19,961	20,202	20,433	3,261	19%
King City	12,874	13,736	14,797	15,376	16,101	16,689	16,881	17,064	3,328	24%
Marina	19,718	21,057	22,321	23,723	25,126	26,713	28,433	30,044	8,987	43%
Marina balance	19,084	20,037	21,371	22,293	22,841	23,238	23,768	24,237	4,200	21%
CSUMB	634	1,020	950	1,430	2,285	3,475	4,665	5,807	4,787	469%
Monterey	27,810	28,086	28,170	28,044	28,650	29,032	29,342	29,639	1,553	6%
Monterey balance	23,583	24,095	24,749	24,623	25,229	25,611	25,921	26,218	2,123	9%
DLI & Naval	4,227	3,991	3,421	3,421	3,421	3,421	3,421	3,421	-570	-14%
Pacific Grove	15,041	15,460	15,265	15,290	15,395	15,530	15,676	15,817	357	2%
Salinas	150,441	158,059	162,222	166,226	170,459	173,393	175,358	177,128	19,069	12%
Sand City	334	361	385	430	516	756	1,012	1,198	837	232%
Seaside	33,025	33,815	33,537	34,497	35,107	35,634	36,582	38,316	4,501	13%
Seaside balance	26,836	25,835	26,345	27,285	27,850	28,317	29,205	30,881	5,046	20%
Fort Ord	4,473	4,163	3,083	3,083	3,083	3,083	3,083	3,083	-1,080	-26%
CSUMB	1,716	3,817	4,109	4,129	4,174	4,234	4,294	4,352	535	14%
Soledad	25,738	24,597	25,301	26,112	26,824	27,697	28,419	29,133	4,536	18%
Soledad balance	15,690	16,298	17,190	18,001	18,713	19,586	20,308	21,022	4,724	29%
SVSP & CTF	10,048	8,299	8,111	8,111	8,111	8,111	8,111	8,111	-188	-2%
Balance Of County	100,213	104,009	106,744	108,432	109,976	110,170	110,277	110,326	6,317	6%
San Benito County	55,269	58,138	62,353	69,324	73,778	77,638	80,788	83,366	25,228	43%
Hollister	34,928	37,314	40,646	42,604	43,327	44,421	45,345	45,599	8,285	22%
San Juan Bautista	1,862	1,945	2,112	2,269	2,315	2,374	2,410	2,436	491	25%
Balance Of County	18,479	18,879	19,595	24,451	28,136	30,843	33,033	35,331	16,452	87%
Santa Cruz County	262,382	273,793	271,233	278,641	284,146	288,523	293,156	294,967	21,174	8%
Capitola	9,918	10,224	10,108	10,485	10,794	10,957	11,049	11,126	902	9%
Santa Cruz	59,946	64,223	64,424	68,845	72,218	75,257	78,828	79,534	15,311	24%
Santa Cruz balance	43,614	46,947	45,324	47,845	49,118	49,957	50,828	51,534	4,587	10%
UCSC	16,332	17,276	19,100	21,000	23,100	25,300	28,000	28,000	10,724	62%
Scotts Valley	11,580	11,946	11,693	11,718	11,837	11,867	11,868	12,010	64	1%
Watsonville	51,199	52,410	51,515	52,918	54,270	55,138	55,786	56,344	3,934	8%
Balance Of County	129,739	134,990	133,493	134,675	135,027	135,304	135,625	135,953	963	1%

Source: Association of Monterey Bay Area Governments, Final 2022 Regional Growth Forecast, 11/18/2020

Table 4: Excerpt from Report P-2A, Total Estimated and Projected Population for California and Counties: July 1, 2010 to 2060

Geography	Estimates			Projections							
	2010	2015	2020	2025	2030	2035	2040	2045	2050	2055	2060
California	37,366,938	39,007,121	39,782,419	40,808,001	41,860,549	42,718,403	43,353,414	43,785,947	44,049,015	44,176,739	44,228,057
Alameda County	1,516,721	1,622,375	1,671,855	1,725,911	1,785,496	1,836,364	1,877,766	1,909,308	1,933,085	1,948,730	1,959,165
Alpine County	1,175	1,154	1,115	1,153	1,185	1,171	1,135	1,115	1,047	1,020	1,006
Amador County	37,678	36,168	37,577	38,679	39,394	39,756	39,743	39,539	39,360	39,281	39,465
Butte County	220,359	224,023	206,362	230,691	236,874	242,240	246,453	249,457	252,567	255,389	258,144
Calaveras County	45,542	44,907	44,286	44,443	44,919	45,087	44,860	44,368	43,966	43,874	44,106
Colusa County	21,330	21,612	22,075	23,163	23,670	24,164	24,471	24,653	24,635	24,604	24,652
Contra Costa County	1,052,554	1,118,662	1,149,800	1,197,341	1,244,173	1,283,681	1,312,536	1,331,431	1,342,620	1,347,877	1,351,284
Del Norte County	28,409	26,847	27,193	26,754	26,750	26,610	26,498	26,226	25,975	25,747	25,720
El Dorado County	181,151	182,583	192,012	193,540	200,004	205,978	210,196	213,236	215,511	217,995	222,219
Fresno County	933,249	979,625	1,026,358	1,053,955	1,096,638	1,135,837	1,170,525	1,200,150	1,226,158	1,249,858	1,272,559
Glenn County	28,233	28,286	29,507	29,510	30,068	30,562	30,769	30,890	30,881	30,801	30,708
Humboldt County	135,102	134,596	132,706	134,057	133,738	132,602	130,791	128,450	126,261	124,054	121,972
Imperial County	175,401	184,460	188,090	197,859	206,486	214,817	222,307	229,206	235,339	240,918	246,235
Inyo County	18,547	18,635	18,429	18,055	18,020	17,864	17,552	17,204	16,671	16,112	15,653
Kern County	842,069	881,129	912,975	961,629	1,019,221	1,075,952	1,127,781	1,174,771	1,217,086	1,256,599	1,295,502
Kings County	152,398	149,455	154,745	159,733	165,525	171,517	176,940	181,726	185,868	189,652	192,955
Lake County	65,056	64,690	63,771	64,259	64,764	65,237	65,505	65,769	66,151	66,737	67,561
Lassen County	34,789	30,200	28,872	29,526	28,894	28,106	27,293	26,400	25,569	24,818	24,082
Los Angeles County	9,845,931	10,155,982	10,171,593	10,258,572	10,322,678	10,331,803	10,286,350	10,193,978	10,061,774	9,891,603	9,697,634
Madera County	150,182	154,166	158,794	168,293	178,070	187,842	197,025	205,517	213,456	220,790	228,393
Marin County	252,655	262,041	258,956	257,394	257,024	256,131	253,549	249,270	243,838	237,458	231,338
Mariposa County	18,245	18,086	17,778	17,574	17,631	17,636	17,490	17,332	17,199	17,060	17,073
Mendocino County	87,755	88,091	87,491	88,746	89,232	89,106	88,205	86,956	85,573	84,360	83,305
Merced County	256,785	268,843	284,761	298,184	314,690	330,805	346,085	359,888	372,461	384,691	396,956
Modoc County	9,688	9,542	9,416	9,320	9,134	8,896	8,567	8,307	8,028	7,803	7,587
Mono County	14,020	13,744	13,447	13,985	14,118	14,130	14,009	13,726	13,367	12,871	12,422
Monterey County	416,005	434,604	441,290	453,956	464,124	471,901	477,265	480,694	481,305	479,785	476,734
Napa County	136,587	141,390	138,711	140,748	143,223	145,444	146,602	146,641	146,050	144,968	144,261
Nevada County	98,709	97,836	97,439	99,131	101,004	102,479	103,193	103,639	103,775	104,905	106,944
Orange County	3,016,796	3,154,363	3,190,832	3,249,431	3,291,863	3,314,115	3,315,726	3,299,179	3,268,048	3,222,492	3,166,309
Placer County	350,664	371,896	397,469	414,544	437,655	458,999	476,434	490,609	501,591	512,040	522,567
Plumas County	19,969	18,225	18,246	18,864	18,493	17,974	17,289	16,534	15,924	15,496	15,277
Riverside County	2,198,479	2,327,112	2,449,299	2,593,906	2,728,068	2,840,775	2,933,038	3,004,816	3,059,095	3,099,770	3,129,833
Sacramento County	1,422,960	1,488,917	1,562,242	1,615,713	1,687,220	1,751,463	1,808,307	1,857,394	1,901,507	1,941,201	1,979,204
San Benito County	55,527	58,464	62,789	63,604	66,355	68,908	70,866	72,395	73,558	74,607	75,620
San Bernardino County	2,044,890	2,118,684	2,184,112	2,273,291	2,368,002	2,456,262	2,536,592	2,611,160	2,681,796	2,750,180	2,818,707
San Diego County	3,104,732	3,275,036	3,352,145	3,398,922	3,461,883	3,508,919	3,543,663	3,567,892	3,583,006	3,587,294	3,583,085
San Francisco County	810,504	869,403	899,891	913,369	936,862	956,232	972,787	988,709	1,004,943	1,022,329	1,039,403
San Joaquin County	688,464	727,038	776,068	810,495	853,661	891,642	923,341	948,975	968,662	984,240	996,241
San Luis Obispo County	269,450	276,584	276,151	281,643	284,729	285,918	284,346	280,262	274,677	268,911	263,650
San Mateo County	721,354	765,820	775,132	787,161	800,006	808,253	813,098	815,187	814,643	811,379	805,479
Santa Barbara County	424,109	443,640	451,329	460,973	469,717	476,193	479,622	480,831	479,532	476,750	473,067
Santa Clara County	1,791,215	1,924,097	1,962,251	2,030,957	2,105,066	2,175,951	2,241,634	2,298,147	2,343,610	2,378,827	2,408,169
Santa Cruz County	262,813	274,514	270,067	279,617	284,670	288,195	289,843	290,001	289,138	288,190	287,606
Shasta County	177,376	178,496	177,692	178,006	180,498	182,530	183,482	183,672	184,110	184,511	185,208
Sierra County	3,233	3,152	3,117	3,037	2,903	2,862	2,757	2,673	2,591	2,491	2,456
Siskiyou County	44,855	44,540	43,792	42,979	42,707	42,195	41,434	40,605	39,874	39,471	39,395
Solano County	412,862	428,906	440,198	460,736	479,372	496,286	510,412	521,832	530,874	538,355	545,126
Sonoma County	484,055	501,512	491,134	509,995	521,303	529,766	533,600	533,191	529,338	524,423	519,518
Stanislaus County	516,583	536,530	555,955	581,308	606,128	627,883	645,069	658,448	668,224	675,118	680,311
Sutter County	94,888	96,796	101,160	101,757	105,245	108,595	111,246	113,752	115,895	118,068	120,143
Tehama County	63,380	63,396	65,266	64,566	65,570	66,502	66,922	67,274	67,634	68,039	68,705
Trinity County	13,798	13,556	13,291	13,041	12,890	12,661	12,387	12,235	12,180	12,286	12,470
Tulare County	442,517	463,671	480,788	496,657	516,810	535,463	551,563	565,075	575,525	584,163	591,539
Tuolumne County	55,240	53,531	52,353	51,538	51,530	51,319	50,807	50,015	49,356	48,982	48,911
Ventura County	824,935	848,687	841,439	859,528	872,856	882,506	885,628	882,363	873,594	861,671	849,091
Yolo County	202,619	212,374	221,718	235,943	248,815	261,579	273,739	285,462	296,338	306,651	316,740
Yuba County	72,346	74,449	79,089	80,259	82,698	84,739	86,321	87,412	88,176	88,444	88,592

Projections Prepared by Demographic Research Unit, California Department of Finance, March 2021

MEMORANDUM

TO: File DATE: April 30, 2021
FROM: Andrew Sterbenz, PE JOB#: MCWD.46.17:010
SUBJECT: Jurisdictional Water Allocations within the Ord Community

The purpose of this memorandum is to summarize the potable water allocations within the Marina Coast Water District Ord Community service area, both from the Fort Ord Reuse Authority (FORA) to the respective jurisdictions and from the jurisdictions to specific projects. This is an update to the summary memorandum dated 5/18/2016 prepared for the MCWD 2015 Urban Water Management Plan.

Groundwater Supply

Potable water supply for the former Fort Ord (MCWD Ord Community service area) comes from the Monterey Subbasin of the Salinas Valley Groundwater Basin (SVGB). The Monterey Subbasin is managed by the Marina Coast Water District Groundwater Sustainability Agency, and the larger SVGB is managed by the Salinas Valley Basin Groundwater Sustainability Agency. Prior to the Sustainable Groundwater Management Act the SVGB was managed by the Monterey County Water Resources Agency (MCWRA). MCWRA operates two reservoirs which capture winter runoff and maintain year-round flow in the Salinas River, which recharges the groundwater basin. MCWRA established Zones 2 and 2A as benefit assessment zones to finance the construction and operation of Lakes Nacimiento and San Antonio, respectively. Under the "Agreement between the United States of America and the Monterey County Water Resources Agency concerning Annexation of Fort Ord into Zones 2 and 2A of the Monterey County Water Resources Agency, Agreement No. A-06404", dated September 21, 1993, the U.S. Army may withdraw up to 6,600 acre-feet per year from the Salinas Valley Groundwater Basin for use on the former Fort Ord, including those portions of the former Fort Ord that overly the Seaside Groundwater Basin. The MCWD Central Marina service area was similarly annexed into Zones 2/2A in 1996.

On October 24, 2001, the United States quitclaimed the water and sewer infrastructure on the former Fort Ord, including the SVGB groundwater allocation, through FORA to the Marina Coast Water District. The U.S. retained 1,729 AFY for use in the Presidio of Monterey Annex (military housing and facilities within the Ord Community) and the Bureau of Land Management. Under agreements between the U.S. Army and FORA (2000), and between MCWD and FORA (1998), the FORA Board allocated the remaining water supply among the land use jurisdictions in the Ord Community. MCWD owns and operates the water system and the underlying groundwater extraction rights, except for the rights reserved to the U.S. Army. MCWD provides water and sewer service to the Presidio of Monterey Annex under direct contract with the U.S. Army.

Allocations to Land Use Jurisdictions

The original and current allocations of potable water supply among the Ord Community Land Use Jurisdictions is shown in Table 1, below. FORA initially allocated supply among the jurisdictions on April 12, 1996, under the Development and Reuse Management Plan, adopted as part of the Base Reuse Plan. At that time, FORA held out a strategic reserve of 785 AFY. On August 14, 1998, the allocations were adjusted, and the strategic reserve reduced to 755 AFY. In 2001, the U.S. Army allocated 38 AFY to Brostram Park in Seaside, reducing the retained total to 1,691 AFY. In 2005, the U.S. Army allocated 114 AFY to Seaside as part of a real estate exchange between the Army and the City, reducing the retained total to 1,577 AFY. In 2018, the U.S. Army transferred 15 AFY to the City of Marina for the Veterans Transition Center housing expansion, reducing the retained total to 1,562 AFY. As the jurisdictions developed specific plans for the redevelopment of Ord Community, FORA made several "loans" from the strategic reserve to jurisdictions. On January 12, 2007, FORA made these loans permanent. FORA ceased to exist on July 1, 2020, so future transfers between jurisdictions must be tracked by MCWD.

Table 1. Salinas Valley Groundwater Allocations

Jurisdiction	Original Allocation (1996) Acre-feet/year	Current Allocation (2007)₂ Acre-feet/year
U.S. Army (retained) _{1,2}	1,410	1,562
City of Seaside	710	1,012
City of Del Rey Oaks	75	242.5
City of Monterey	65	65
City of Marina ₂	1,185	1,340
Monterey County	545	710
CSUMB	1,055	1,035
UCMBEST	165	230
State Parks	45	45
County/Marina Sphere (Polygon 8a)	50	10
Line Loss	530	348.5
FORA Strategic Reserve ₃	785	0

Notes:

1. The U.S. Army retained 1,729 AFY of groundwater rights for the POM Annex, but it is accounted for in the original allocation table as 1,410 AFY for POM Annex use, 160 AFY as a portion of the strategic reserve, and 159 AFY (10%) as a portion of the line loss allowance.
2. The current total reflects a 15 AFY transfer made in 2018 from the US Army to the City of Marina.
3. The original strategic reserve included 160 AFY for the POM Annex, 125 AFY for CSUMB, 230 AFY for Seaside and 270 AFY of unencumbered supply.

The County/Marina Sphere of influence area (included in the table above) is defined as County Planning Area 8a in the Base Reuse Plan. This area is bounded by Imjin Parkway on the north, Inter-Garrison Road on the south, the Marina City Limit on the west (7th Avenue alignment) and the CSUMB property on the east (includes a short portion of Abrams Drive). This is generally the landfill parcel, but it includes the Ord Market (former shoppette) at the corner of Imjin Parkway and Abrams Drive. This area is included in the Monterey County total in the UWMP and in Table 2.

The existing Bayonet/Black Horse Golf Courses on the former Fort Ord uses up to 540 AFY for landscape irrigation. This water is supplied from existing wells in the Seaside Groundwater Basin. The Base Reuse Plan assumed that supply from these wells would continue indefinitely, or until it could be replaced with recycled water. In 2005 the Seaside Groundwater Basin was adjudicated, which increased the urgency to convert the system to recycled water.

The assumed line loss of 348.5 AFY represents 5.3% of the total water allocation, which is an ambitious target. Actual water losses over the last five years have ranged from 6% to 10%. Losses include unmetered uses such as line flushing and hydrant flow testing.

Sub-Allocations by Land Use Jurisdictions

MCWD maintains a listing of water sub-allocations made by land use jurisdictions to specific projects. When publishing a water supply assessment report, the list is updated for the affected jurisdiction(s) and included in the report. The current sub-allocation table is attached.

Some of the water uses within the Ord Community were on-going at the time of the Base Closure (such as the public schools) or transitioned to new uses without formal allocations (such as the conversion of Preston Park military housing to affordable public housing). The values for existing uses that do not have formal allocations reflect the peak demand years.

Two jurisdictions, the City of Del Rey Oaks and the City of Monterey, have not yet formally approved development in the Ord Community, and therefore have not made any sub-allocations. Several other jurisdictions (CSUMB, UCMBEST, U.S. Army and State Parks) retain all of their property under single ownership and have not needed to sub-allocate water supply to internal projects. In 2007, State Parks allocated 5.5 AFY for the American Youth Hostel project in Seaside. In 2014, the U.S. Army allocated 5 AFY to the California Central Coast Veterans Cemetery Project in Seaside, with an additional 10 AFY for the first two years for landscape establishment. These project allocations are reflected in the summary table.

In the City of Marina, sub-allocations have been made for three specific plan areas: Marina Heights (now called Sea Haven), University Villages (now called Dunes on Monterey Bay) and Cypress Knolls. Project-specific allocations have also been made for the Monterey Peninsula College 12th Street Campus, the Rock Rose Gardens housing project, and the Promontory apartments. The table also includes several projects which are subsets of Specific Plan allocations.

In the City of Seaside, sub-allocations have been made to three specific plan areas: Seaside Highlands, Seaside Main Gate and Campus Town. Project-specific allocations have also been made for the Monterey College of Law, Monterey Peninsula College, Chartwell School, the American Youth Hostel and Seaside Senior Living. The water allocations for Sun Bay Apartments and Bay View Mobile Home Park were established through the MOA between the USA and FORA, as amended in 2001. The Water Supply Assessment for the Amended Seaside Main Gate Project identified a demand range of 250.4 AFY, but the City allocation was only for the initial retail portion of that project.

For the Seaside Campus Town Specific Plan, the City's Ordinance 1080 which approved the Specific Plan allocated 180.6 AFY of SVGB supply to the project, 45.83 AFY of recycled water and an additional 261

AFY of potable supply to be realized by providing recycled water to off-set existing landscape irrigation use within the City. A portion of the off-setting use will occur on the Bayonet/Blackhorse Golf Courses which are irrigated from wells in the Seaside Groundwater Basin. The mechanism for conveying Seaside Basin groundwater to MCWD has not yet been identified.

In Monterey County, a sub-allocation was made for the East Garrison Specific Plan area, and project-specific allocations were made for Monterey Peninsula College and for the Ord Market. The Ord Market is within the Marina Sphere sub-area.

Attachments

Table 2, Sub-Allocations by Jurisdiction

Table 3.11-2, Allocation of Existing Potable Water Supply by Jurisdiction, from the FORA Development and Resource Management Plan

References

Agreement between the United States of America and the Monterey County Water Resources Agency Concerning Annexation of Fort Ord into Zones 2 and 2A of the Monterey County Water Resources Agency, Agreement No. A-06404, September 21, 1993.

Fort Ord Reuse Authority, Development and Resource Management Plan portion of the Fort Ord Base Reuse Plan, 1997

Fort Ord Reuse Authority, Board Agenda Packet for January 12, 2007, item 8b: Resolution of the Authority Board changing the 150 AFY loans granted to Del Rey Oaks, Seaside, Marina, and Monterey County in October 1998 to permanent additions to their water allocations

Memorandum of Agreement Between the United States of America, Acting By and Through the Secretary of The Army, United States Department of the Army and the Fort Ord Reuse Authority for the Sale of Portions of the Former Fort Ord, Located in Monterey County, California, June 20, 2000

Annexation Agreement and Groundwater Mitigation Framework for Marina Area Lands, 1996

Assignment of Easements on Former Fort Ord and Ord Military Community, County of Monterey, and Quitclaim Deed for Water and Wastewater Systems, between Fort Ord Reuse Authority (Grantor) and Marina Coast Water District (Grantee), October 24, 2001

Table 2. Ord Community Water Sub-Allocations by Jurisdiction

Ord Community Land Use Jurisdiction	SVGB Allocation (AFY)	Suballocations To	Suballocation Amount (AFY)	Resolution No.	Date	Notes:
U.S. Army	1,562					
		Exisitng POM Annex	686			maximum annual use, DPW has not allocated by facility
		Veterans Cemetery	5	MOA	2014	Army to CDVA, 15 AFY for 2 years, 5 AFY permanent
CSUMB	1,035					
		None				Campus has not allocated by facility.
Del Rey Oaks	242.5					
		None				
City of Monterey	65					
		None				
County of Monterey	720		531.2			Includes 10 AFY for Coutny/Marina Sphere (Reuse Plan polygon 8a)
		East Garrison 1	470	05-268	10/4/2005	
		MPC	52.5	A-09217	12/10/2002	Agreement
		Ord Market	1.5	Lease	9/6/2006	Lease Agreement
		Veterans Cemetery	2.2	A-11407	4/28/2009	MOU w/Cemetery
		Whispering Oaks	0			Allocated 93 AFY, later revoked with the specific plan.
		Ord Market	5		3/27/2008	
UCMBEST	230					
		None				
City of Seaside	1,012.5		1011.8			
		Sunbay Apts (Thorson)	120.0	USA	10/23/2001	Amendment 1 to Agreement dated 6/20/2000 between USA and FORA
		Bay View Park (Brostram)	84.8	USA	10/23/2001	Amendment 1 to Agreement dated 6/20/2000 between USA and FORA
		Other Existing Use	3.0			Streetscape irrigation, other uses at time of base closure
		Seaside Senior Living	40	18-07	2/15/2018	
		Seaside Highlands	168.5	02-07	2002	43.1 AFY to be replaced with RW when available
		Seaside Resort	161.4	05-44	2005	
		Monterey College of Law	2.6	04-20	3/18/2004	
		Chartwell School	6.4	05-26	5/19/2005	
		Amer. Youth Hostel	5.5	07-XX	11/15/2007	Agreement to supply AYH with transferred supply
		Main Gate	149	08-32	5/15/2008	WSA totals 250.4 AFY. City allocated initial retail portion only.
		Monterey Penninsula College	9.0	09-36	7/16/2009	
		MPUSD	81.0	USA		existing at time of base closure
		Campus Town	180.6	Ord. 1080	3/19/2020	Finding 4 in the Ordinance approving the Specific Plan, also 45.83 AFY RW and 261 through wheeling/reallocation.
State Parks and Rec.	44.5					
		None				

Table 2. Ord Community Water Sub-Allocations by Jurisdiction

Ord Community Land Use Jurisdiction	SVGB Allocation (AFY)	Suballocations To	Suballocation Amount (AFY)	Resolution No.	Date	Notes:
City of Marina	1,340		1334.8			
		Existing use	233.1			Preston Park, Abrams Park, Airport, Veterans Housing, etc.
		Marina Heights	292.4	2004-41	3/3/2004	renamed Sea Haven
		University Villages	593.0	2005-129	5/31/2005	renamed Dunes on Monterey Bay
		Cypress Knolls	156.1	2006-289	11/8/2006	
		MPC - 12th St Campus	7.0	2007-xx	2/6/2007	
		Imjin Office Park	0.0			IS-MND projected 11.76 AFY. No formal allocation made
		CHOMP Wellness Center	0.0			21 AFY, Subset of University Villages
		Rock Rose Gardens	4.9	PC2011-07	6/9/2011	Planning commission, existing demand formalized as allocation
		Promontory Apartments	33.3	2013-86	7/2/2013	
		Veterans Transition Center	15.0	Agreement	1/5/2018	Army transferred supply for VTC in 2018
Assumed Line Loss	348.5					
Total GW:	6,600					

SVGB = Salinas Valley Groundwater Basin

AFY = acre-feet/year

XX = Resolution # not included in meeting minutes

RW = Recycled Water

Transfers/Exchanges

State Parks transfer for AYH	-5.5	07-XX	11/15/2007	Agreement to transfer supply to Seaside for this project
Army-Stilwell Kidney Land Exchange	109	Water Deed	8/28/2008	Agreement to transfer water to Seaside as part of a land exchange
Veterans Transition Center	15	Agreement	1/5/2018	Army to FORA to Marina

TABLE 3.11-2
Allocation of Existing Potable Water Supply
By Jurisdiction
(Based on FORA's April 12, 1996 Resolution)

JURISDICTION	TOTAL WATER ALLOCATION (AFY)	NOTES
City of Seaside	710	
County/City of Del Rey Oaks	75	Plus reclaimed water for golf course
County/City of Monterey	65	
City of Marina	1,185	
Monterey County	545	
ARMY	1,410	
CSUMB	1,055	Plus reclaimed water for irrigation
UCMBEST	165	Plus reclaimed water for irrigation
County/State Parks and Recreation	45	
County/Marina Sphere Polygon 8a	50	
<hr/>		
SUBTOTAL	5,295 AFY	
Line Loss (10%)	530	
FORA Strategic Receive	785	Encumbered Reserve: Army – 160 AFY1 CSUMB – 125 AFY1 Seaside – 230 AFY2 Unencumbered – 270 AFY
<hr/>		
TOTAL	6,600 AFY	

ENCUMBRANCES TO FORA'S STRATEGIC RESERVE

1. 160 AFY at the POM Annex and 125 AFY at CSUMB polygon 10 are available upon metering of existing dwelling units.
2. 230 AFY loaned to Seaside is available to Seaside for golf course irrigation until reclaimed replacement water is provided.

MEMORANDUM

TO: File DATE: April 30, 2021
FROM: Andrew Sterbenz, PE JOB#: MCWD.46.17:010
SUBJECT: MCWRA Zones of Benefit and Assessment

The purpose of this memorandum is to summarize the Monterey County Water Resources Agency Zones of Benefit and Assessment. This intended as a reference to understanding earlier agreements which use older Zone designations.

The Monterey County Water Resources Agency (MCWRA) and the Monterey County Board of Supervisors have created certain zones of benefit and assessment for water supply projects within the Salinas River Valley. Each zone has a specific purpose, as listed in Table 1.

Zones 2 and 2A were established to fund the construction and maintenance of Nacimiento and San Antonio Reservoirs, respectively. As can be seen in the attached figure from 1989, the zone 2/2A boundaries excluded the elevated areas west of the Salinas River, including the former Fort Ord and the City of Marina. Fort Ord was annexed into Zones 2/2A in 1993. MCWD and the City of Marina annexed into Zones 2/2A in 1996. Under that agreement, provisions were made for two properties north of the City, RMC-Lonestar (now Cemex) and the Armstrong Ranch to annex into Zones 2/2A at a later date.

In 1992, Zones 2B, 2Y and 2Z were formed to fund the Castroville Seawater Intrusion Project (CSIP), which reduced groundwater pumping in the Salinas Valley by constructing a tertiary treatment facility at the regional wastewater treatment plant and delivering recycled water for crop irrigation. Zone 2B is the area receiving the irrigation water supply. Zone 2A is the area benefitting from the reduced groundwater pumping. Zone 2Y is made up of Zones 2A and 2B, and funds the CSIP system. Zone 2Z is made up of Zones 2A and 2B, and funds the Salinas Valley Reclamation Plant.

In 2003, Zone 2C was formed to fund the Salinas Valley Water Project, which further reduced groundwater pumping in the Salinas Valley by modifying the reservoir operations to release flows in the summer months, and rediverting those flows from the river near Marina to augment the CSIP water supply. The boundary of Zone 2C is larger than Zone 2A, adding the Prunedale area in northern Monterey County as well as lands around San Antonio Reservoir. The assessments in Zones 2/2A for maintenance of the dams are now assessed under Zone 2C.

The effect of the 2003 change is that fees are no longer assessed for Zones 2 and 2A. The Zone 2A boundary is still used as a means of defining Zones 2Y and 2Z, which will continue to have annual assessments until the CSIP and SVRP are fully paid off.

With respect to the Cemex and Armstrong properties north of Marina, they have been included in Zone 2C since 2003, and are assessed as beneficiaries of the Salinas Valley Water Project and the two reservoirs. Per the most recent data from the County website, they have not annexed into Zones 2A/2Y/2Z and are not assessed as beneficiaries of the CSIP project. It is not clear if those lands must be annexed into Zones 2A/2Y/2Z in order to increase groundwater use as stated in the 1996 agreement.

Table 1. MCWRA Zones

Zone and Purpose	Formed	Approx. Size (acres)	Notes
Zone 2 , for the construction and maintenance of Nacimiento Reservoir	circa 1957	290,000	Boundary was the approximate limit of Salinas Valley groundwater basin
Zone 2A , for the construction and maintenance of San Antonio Reservoir	circa 1967	350,000	Boundary was the updated limit of Salinas Valley groundwater basin
Zone 2B , for the operation of the Castroville Irrigation System	1992 Ord. 3635	12,000	Ordinance 3635 establishes collecting assessments in Zones 2A and 2B for the benefit of the Castroville Irrigation System.
Zone 2Y , for the construction and maintenance of the Castroville Seawater Intrusion Project	1992 Ord. 3635	362,000	Ordinance 3635 establishes collecting assessments in Zones 2A and 2B for the benefit of the Castroville Irrigation System.
Zone 2Z , for the construction and maintenance of the Salinas Valley Reclamation Project	1992 Ord. 3636	362,000	Ordinance 3636 establishes collecting assessments in Zones 2A and 2B for the benefit of the Wastewater Reclamation System.
Zone 2C , for the construction and maintenance of the Salinas Valley Water Project	2003 Ord. 4203	432,000	Ordinance 04203 confirms approval of the Salinas Valley Water Project for the benefit of Zone 2C, establishing Zone 2C as the benefit zone for the project, Levying the assessments to fund the project and eliminating the water standby and availability charges in Zones 2/2A.
Zone 2D , for improvements to Nacimiento and San Antonio Reservoirs	<i>Proposed</i>	432,000	<i>Would fund needed capital repairs and improvements to the dams. Area would be coincident with Zone 2C</i>

Table data from MCWRA website, <https://www.co.monterey.ca.us/government/government-links/water-resources-agency/home/assessment-review-for-zones-2b-2y-2z-and-water-delivery-service-charges>

Attachments

Map of Zones 2 and 2A, attachment to Monterey County Flood Control and Water Conservation District Ordinance 3397, dated 6/20/1989

Map of Zones 2, 2A and 2B, prepared by Monterey County Water Resources Agency, dated 10/24/2014

Map of Zone 2C, prepared by Monterey County Water Resources Agency, dated 10/1/2016

Figure: MCWRA Zones 2A, 2B and 2C in the vicinity of MCWD

References


Agreement between the United States of America and the Monterey County Water Resources Agency Concerning Annexation of Fort Ord into Zones 2 and 2A of the Monterey County Water Resources Agency, Agreement No. A-06404, September 21, 1993.

Annexation Agreement and Groundwater Mitigation Framework for Marina Area Lands, 1996


Monterey County Water Resources Agency (formerly Monterey County Flood Control and Water Conservation District)

Ordinances 3397, 3635, 3636, 4203

Resolutions 00-172, 03-295

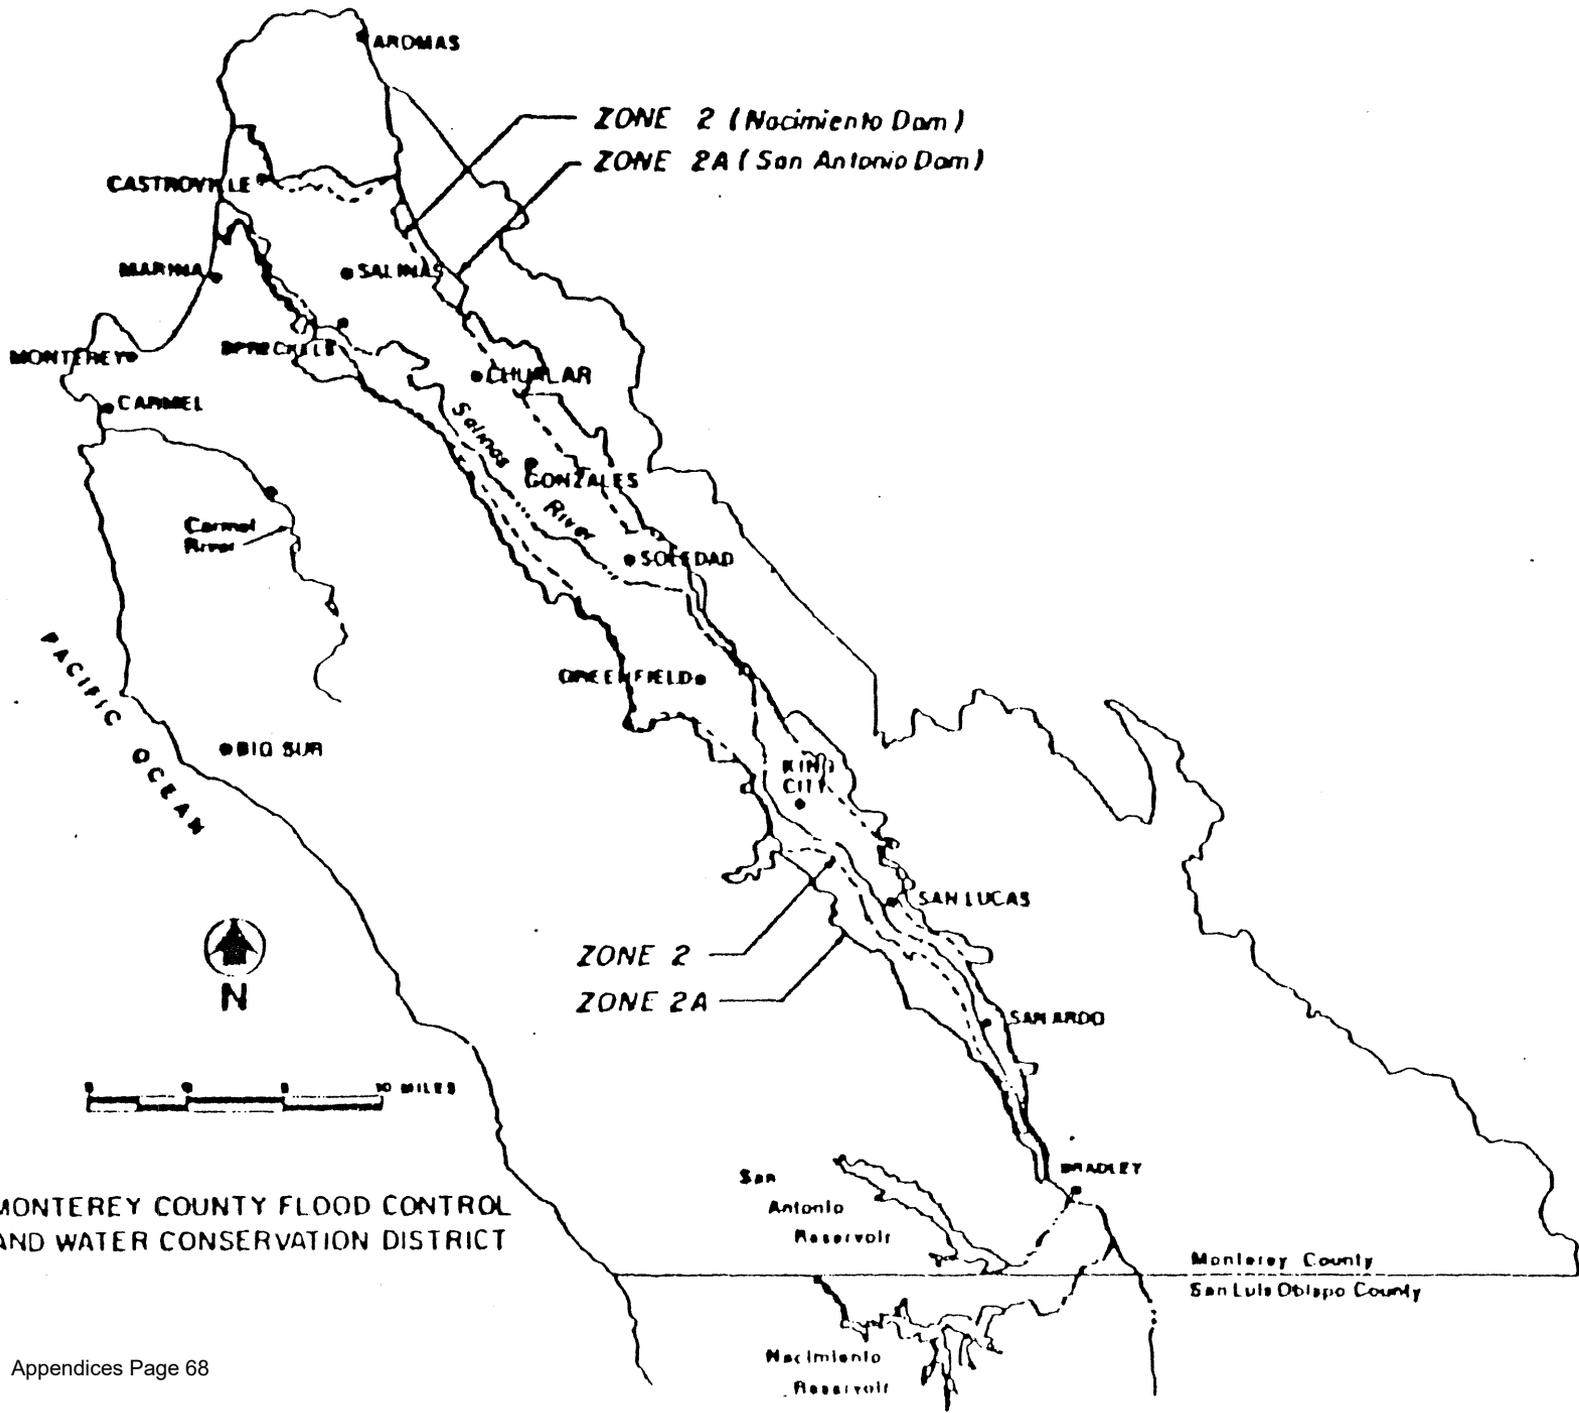

207

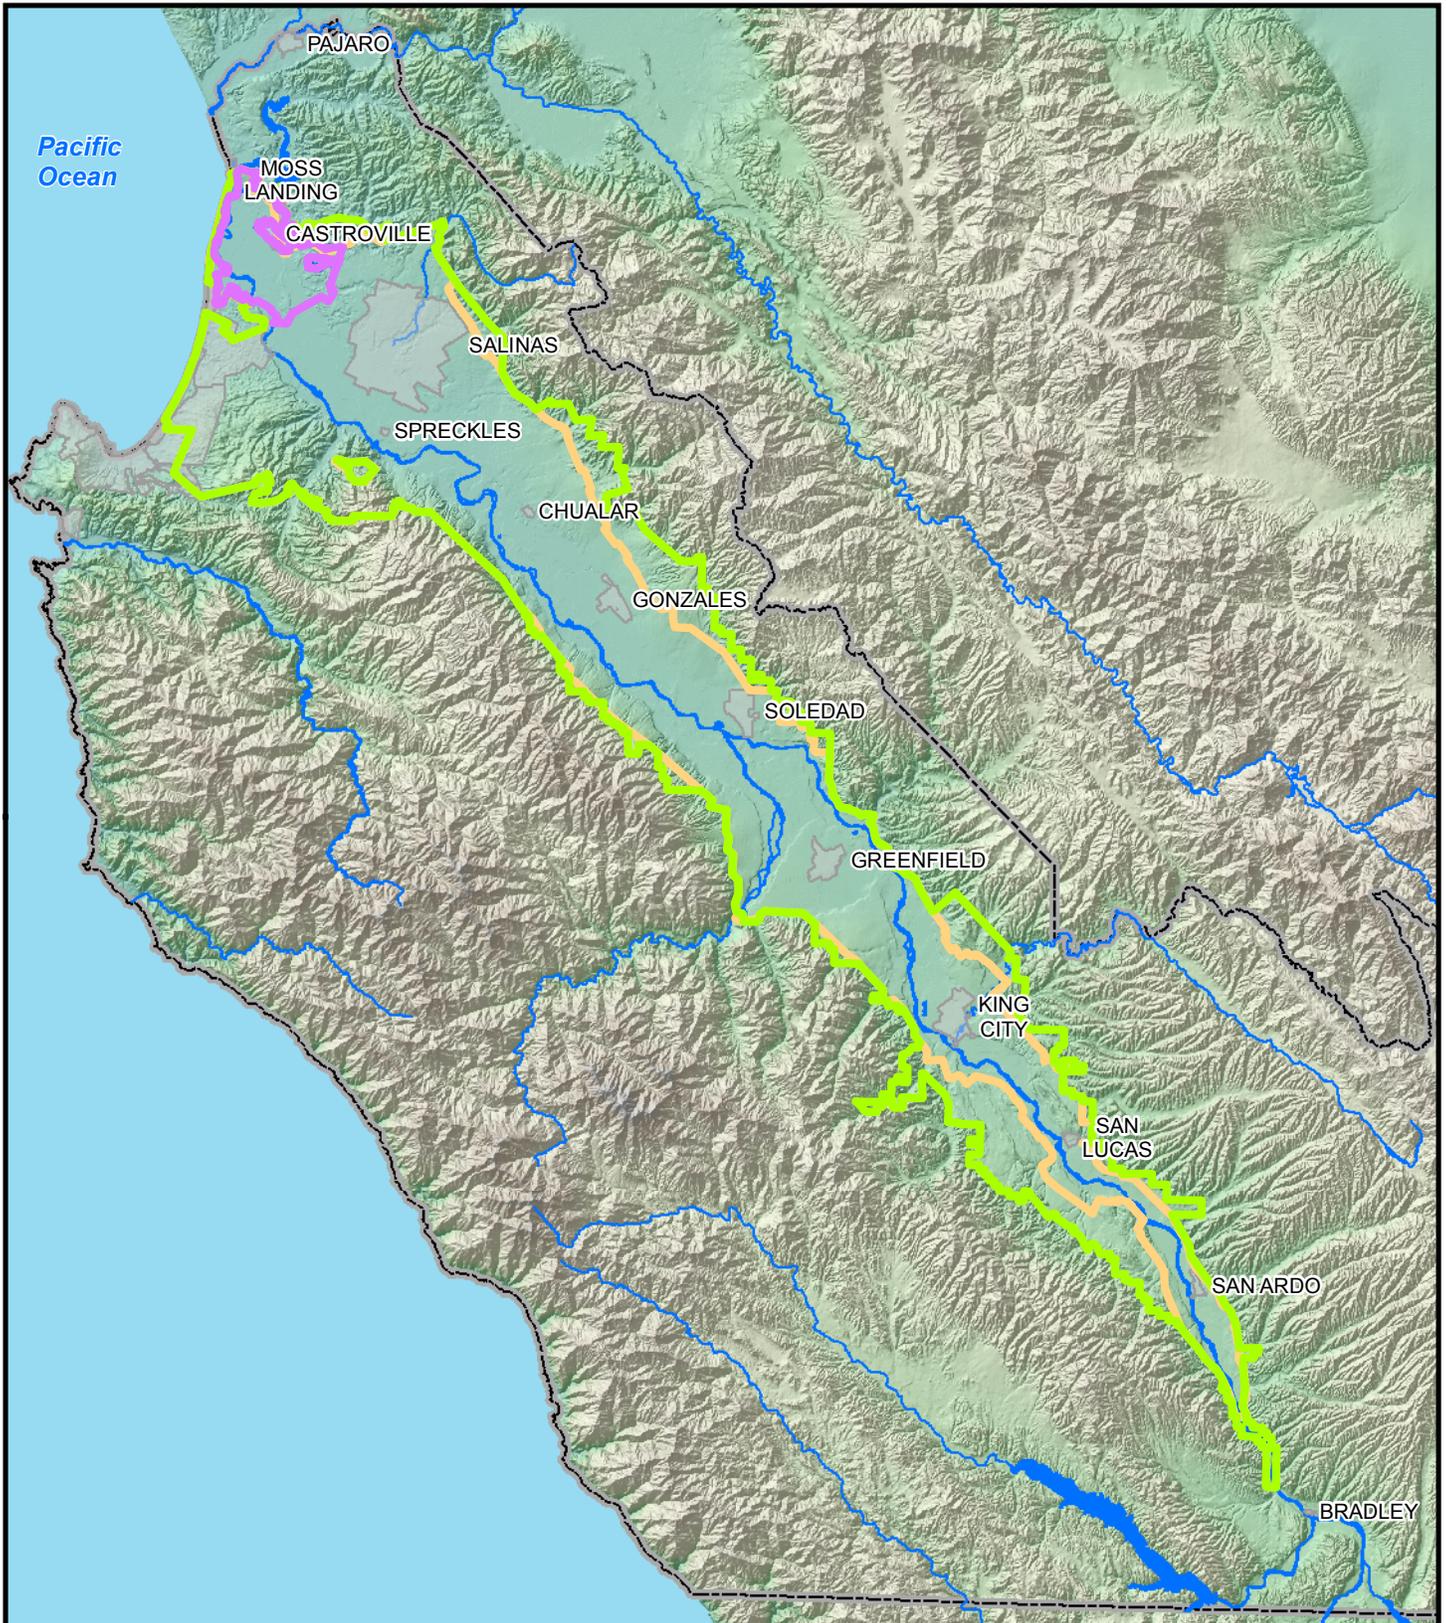

Legend

-  Zone 2
-  Zone 2A
-  Zone 2B
-  Rivers
-  Monterey County

Zones 2, 2A and 2B



The scale and configuration of all project boundaries and information shown herein are not intended as a guide for design or survey work.


Map Date: 10/24/2014


Monterey County Water Resources Agency Zone Boundaries

-  Zone 2C
-  Parcels
-  Monterey County




The scale and configuration of all project boundaries and information shown herein are not intended as a guide for design or survey work.
Image Source: ESRI Street Map (2016)
Map Date: 10/11/2016

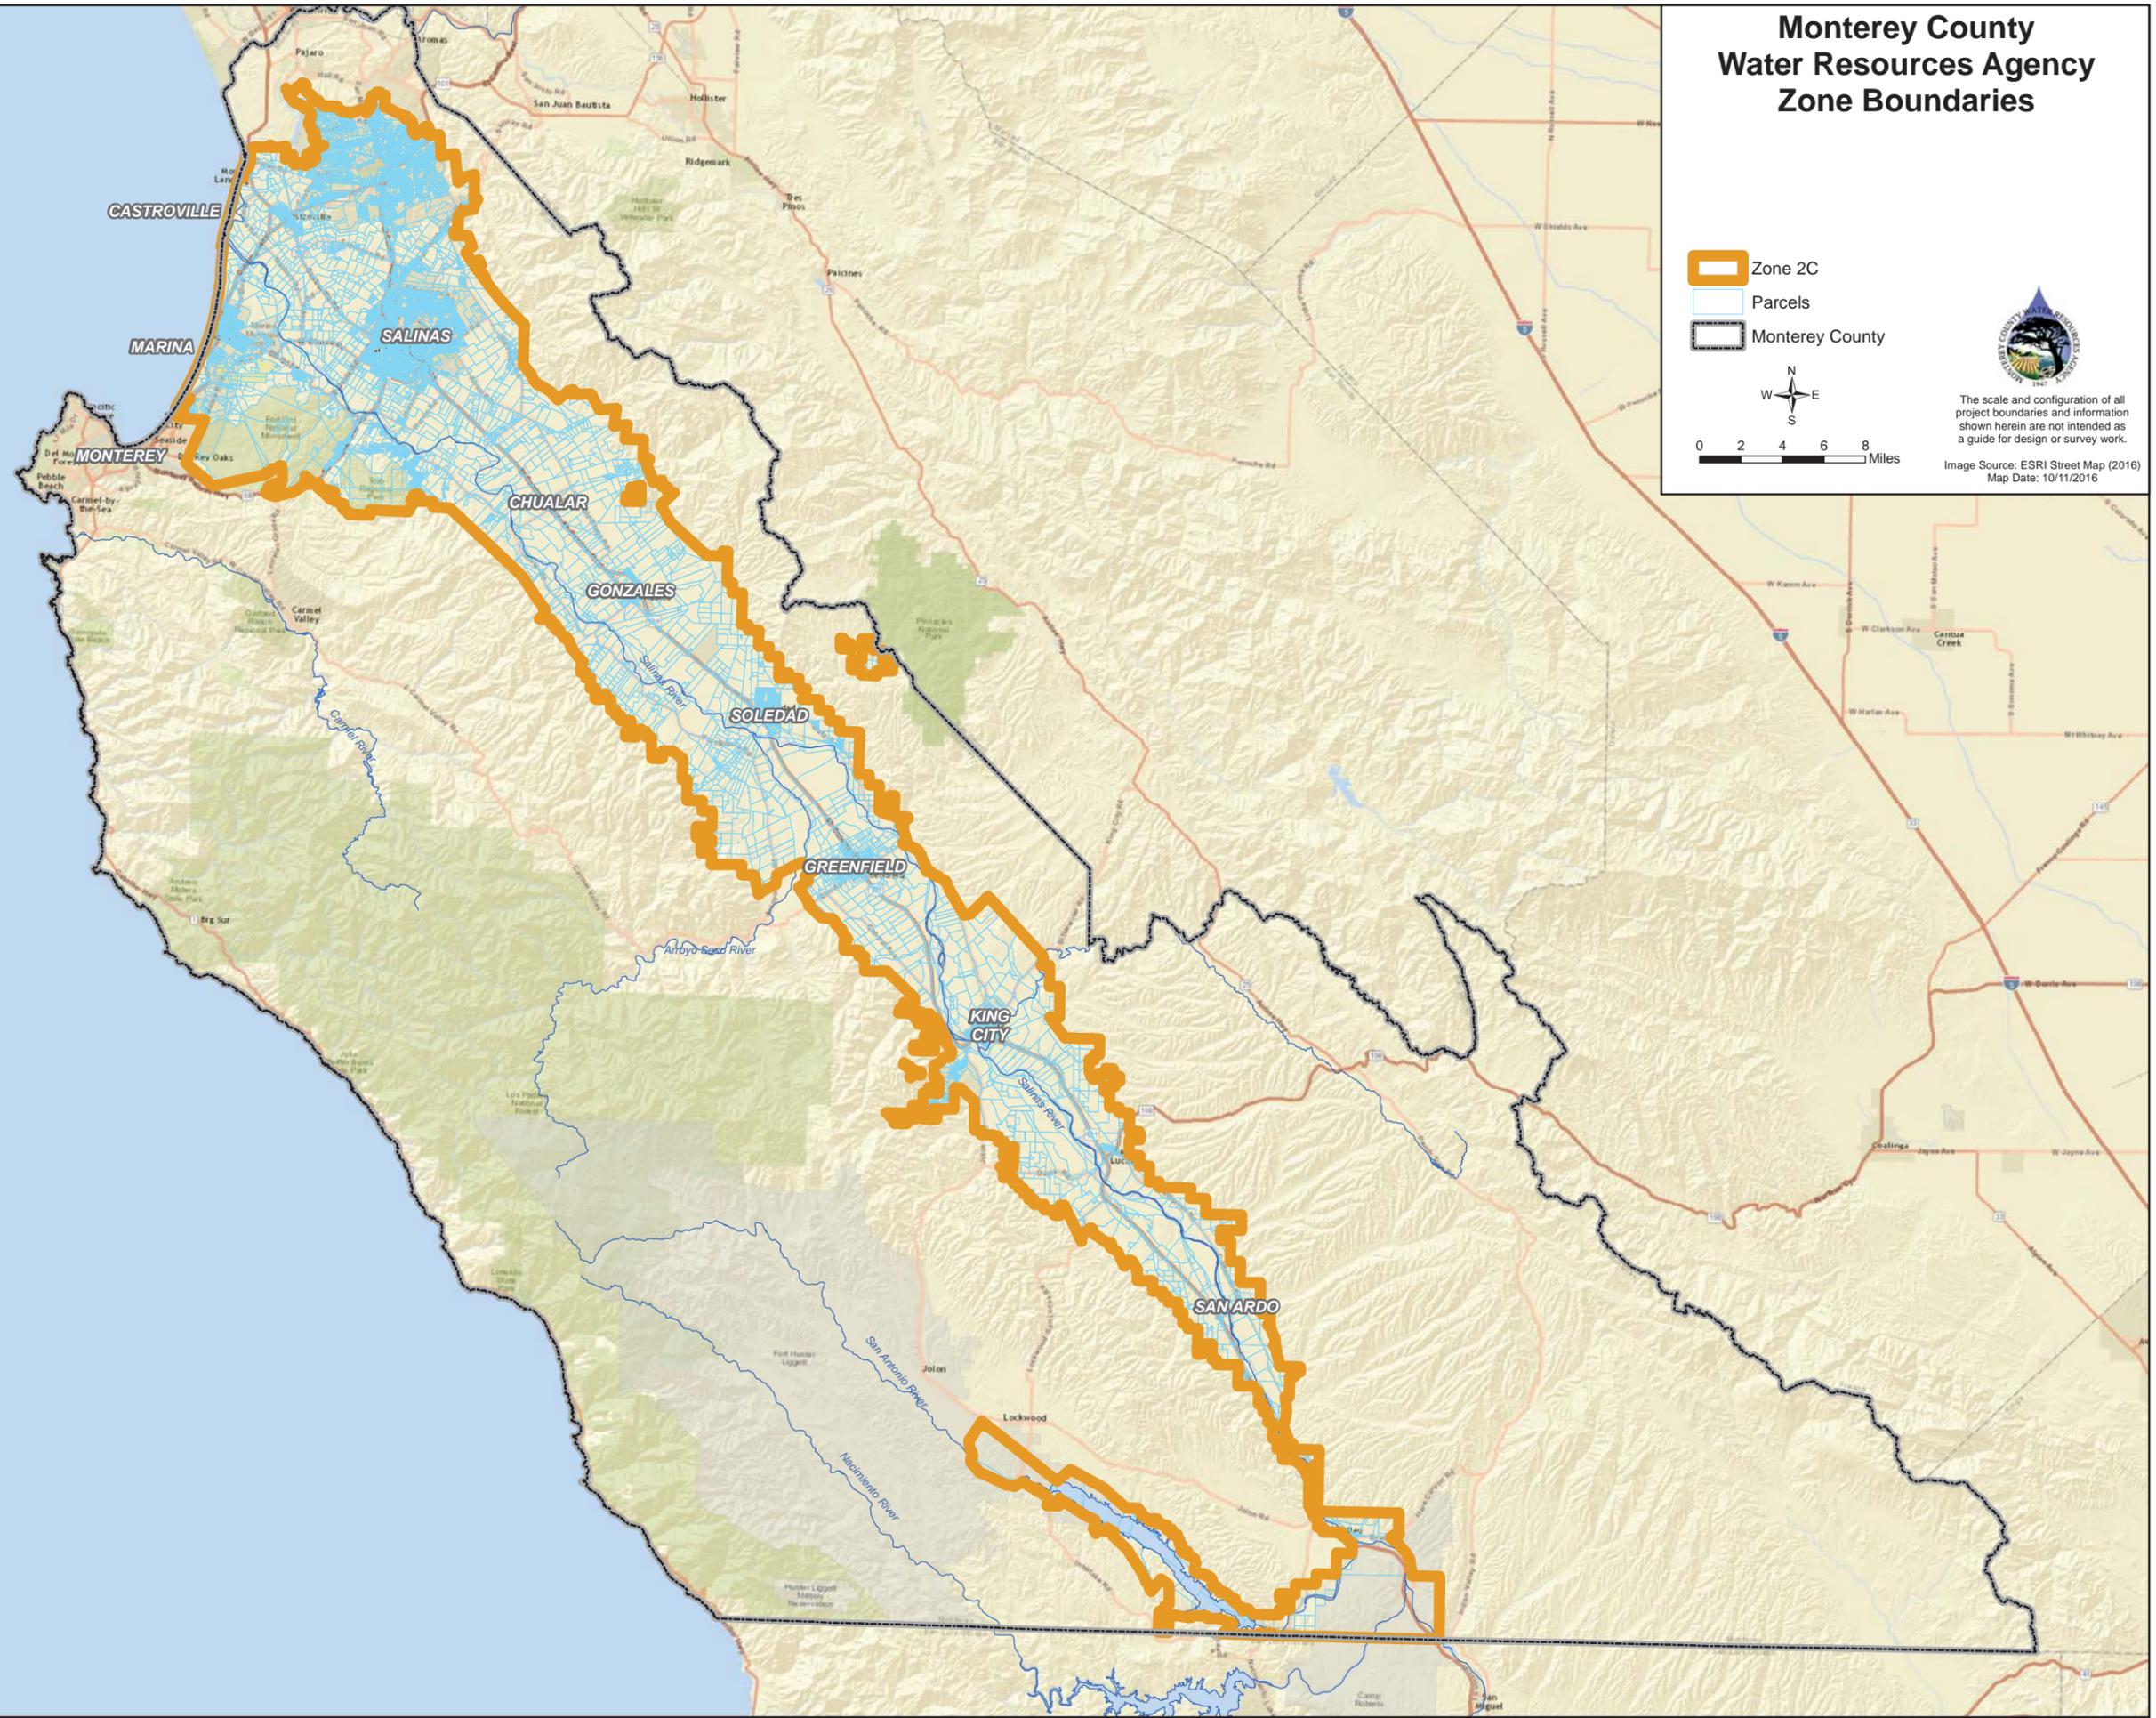

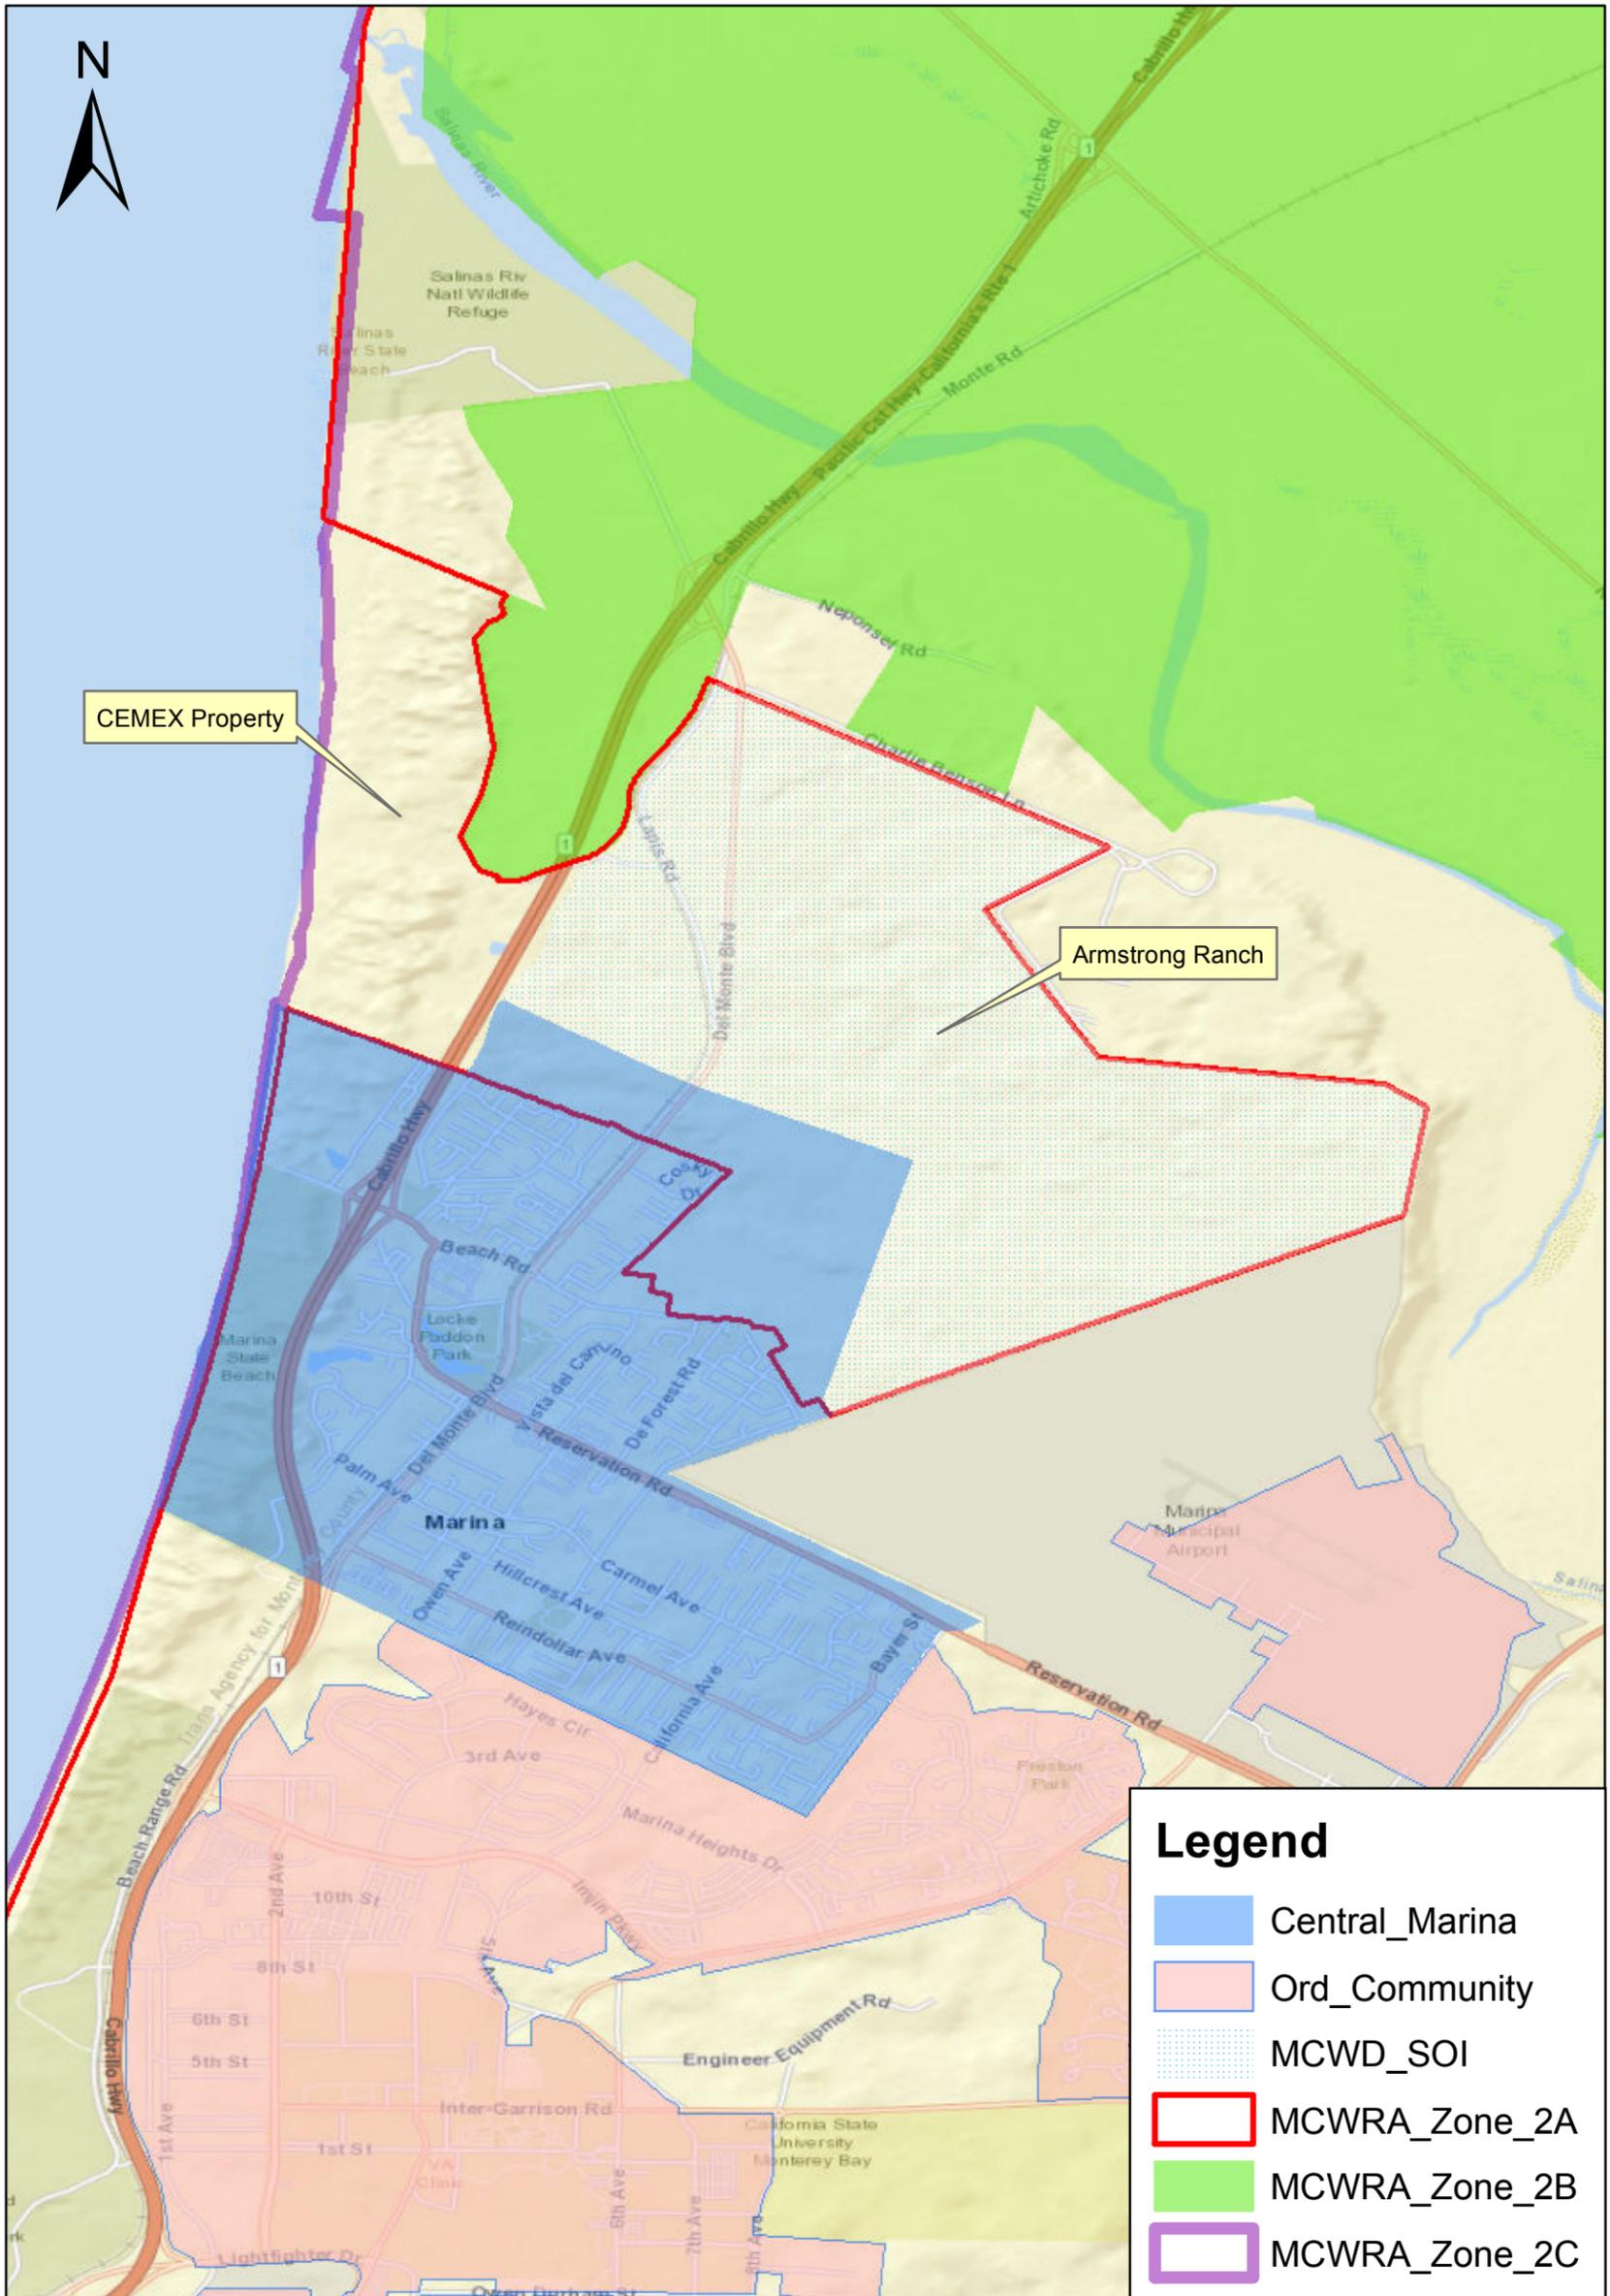

MCWRA Zones 2A, 2B and 2C in the vicinity of Marina Coast Water District



MEMORANDUM

TO: File DATE: May 14, 2021

FROM: Andrew Sterbenz, PE JOB#: MCWD.46.17:010

SUBJECT: MCWD Seismic Risk Assessment

The purpose of this memorandum is to summarize the seismic risks to the Marina Coast Water District's water facilities and supplies, as required for the Urban Water Management Plan.

The Marina Coast Water District (MCWD) serves the City of Marina and the former Fort Ord in northern Monterey County. California is seismically active, and the USGS states that an earthquake of magnitude 6.7 or higher may occur in the San Francisco/Monterey Bay area. Active faults in and near the District's service area include the Reliz-Rinconada, the Monterey Bay-Tularcitos, the San Gregorio and the Zayante-Vergeles (see attached map). The Reliz Fault crosses the former Fort Ord and City of Marina, but the rest of the Salinas Valley Groundwater Basin is contiguous.

The MCWD service area is considered at high risk of ground shaking¹ under a seismic event. The local surficial soils are not prone to liquefaction or lateral spreading². The Reliz fault zone crosses the service area but fault movements have not been identified in the overlying sand soils. The hazards to MCWD are therefore the effects of ground shaking on District facilities and the effect on supporting systems (roads, power and communication). Most affects are immediate, as listed in Table 1. The District maintains a detailed emergency response plan and water shortage contingency plan, which they would execute as needed. They work cooperatively with the public works and public safety staffs of the jurisdictions they serve (City of Marina, City of Seaside, Presidio of Monterey, CSUMB and County of Monterey).

Table 1, Facility Effects

Facility Type	Ground Shaking Effect	Mitigation / Response
Pipelines	Minimal	Inspect for leaks/damage following an event.
Pipelines	Above-grade appurtenances damaged (hydrants, air-vac valves, sampling stations)	Inspect after event.
Pressure Reducing Valves	Appurtenances damaged (air-vac valves, pressure sensors)	Inspect after event.
Wells	Pump Head/Motor displaced from pedestal	Anchor equipment per current building code. Inspect after event.

¹ Monterey County Multi-Jurisdictional Hazard Mitigation Plan, Figure E-6 (attached).

² Cornerstone Earth Group, Geotech Investigation for A1/A2 Reservoirs, Section 4.

Facility Type	Ground Shaking Effect	Mitigation / Response
Wells	Above-grade appurtenances damaged (air-vac valves, pressure sensors)	Inspect after event.
Wells	Electrical panel slides/tips over	Anchor equipment per current building code. Inspect after event.
Wells	Electrical building damage	Inspect after event.
Booster Pump Station	Pump/Motor displaced from pedestal	Anchor equipment per current building code. Inspect after event.
Booster Pump Station	Above-grade appurtenances damaged (air-vac valves, pressure sensors)	Inspect after event.
Booster Pump Station	Electrical panel slides/tips over	Anchor equipment per current building code. Inspect after event.
Water Tanks	Water sloshing into roof/rafters	Operate with required freeboard. Sample after event for bacterial contamination.
Water Tanks	Tank shifts off foundation.	Anchor equipment per current building code. Include flexible fittings on inlet/outlet piping. Inspect after event
Water Tanks	Structural damage due to movement.	Design per current building code. Provide redundant water storage. Inspect after event. Drain tank at controlled rate if visibly damaged.
Metered (Customer) Services	Building damage causes broken on-site plumbing	Respond to calls for temporary shut-downs. Check AMR system for water leak alerts. Patrol areas looking for water running out of vacant or damaged buildings.
All facilities	Loss of communications	Inspect after event. Staff the office 24/7 for customer access if phone service is lost. Operate equipment under local PLC control or operate in hand.
All facilities	Loss of Power	Generators installed at key facilities
All facilities	Extended loss of power due to power grid damage or PG&E safety shut-down	Contract for fuel delivery with multiple suppliers.

Facility Type	Ground Shaking Effect	Mitigation / Response
SCADA System	Loss of antenna or repeater station	Anchor equipment per current building code. Inspect after event.
Office/SCADA System	Building damage	Inspect after event. Relocate equipment to alternate office if needed.

Groundwater Supply Risks

The Salinas Valley Groundwater Basin is not crossed by fault zones which may interrupt or change groundwater flow paths if fault movements occur. The aquifer consists of alluvial sand and gravel layers, interbedded with clay aquitards. Ground shaking in a seismic event is not expected to decrease the storage and conveyance capacity of the aquifer. The Monterey County Multi-Jurisdictional Hazard Mitigation Plan does not identify earthquakes as a significant risk to water supply.

Monterey County owns and operates two reservoirs at the upper end of the Salinas River Valley, Nacimiento Reservoir and San Antonio Reservoir. These reservoirs provide both flood protection and water supply storage. They are both earth-fill embankment dams with concrete lined spillways. The Monterey County Multi-Jurisdictional Hazard Mitigation Plan does not identify these dams as being at risk of failure during a seismic event. However, loss of one or both of these reservoirs would have a significant effect on the water supply for the Salinas Valley, including MCWD.

Water is released from Nacimiento and San Antonio Reservoirs to provide environmental flows and to facilitate year-round recharge of the Salinas Valley Groundwater Basin. Monterey County Water Resources Agency also rediverts a portion of the released flow in north Marina and provides that water for irrigation within the Castroville Seawater Intrusion Project (CSIP). The CSIP area is 12,000 acres of farmland irrigated with recycled water and the above-mentioned rediverted streamflow to reduce groundwater pumping. Over-pumping of groundwater along the coast had led to seawater intrusion into the 180/400-Ft Aquifer. The Castroville Seawater Intrusion Project has operated for the last 30 years and has slowed but not stopped the advance of seawater into the groundwater basin.

Loss of one or both reservoirs to a seismic event would have the following effects:

1. Immediate term (days): Damage to facilities within the mapped inundation area (see attached map pages). MCWD's only facility at risk is Watkins Gate Well, which is at the edge of the Salinas Valley floodplain. Damage is likely to occur to roads, bridges and power lines near the Salinas River, including portions of Highway 1 and Highway 101.
2. Near term (months). Groundwater use for agriculture may decline due to flood damage to land and equipment. The extent of the flood damage will determine the location and amount of use changes.
3. Short term (1-5 years). Groundwater use for agriculture within the CSIP area will increase due to the loss of the surface water supply, unless pumping limits are imposed by a governmental

agency. Increased pumping in the CSIP area will eventually add to the seawater intrusion. Added pumping in that area will contribute to reduced groundwater levels in adjacent areas.

4. Long Term (5-50 years). If a replacement water supply project is not developed (replacement dam or project of similar size), groundwater levels would be expected to decline throughout the valley. The aquifer connects to the Monterey bay, so water levels along the coast will not decline but additional seawater would be drawn in. MCWD may need to desalinate brackish groundwater or relocate wells further inland if seawater intrusion moves toward their wells.

A project large enough to address the loss of an upper-valley reservoir would be either a replacement reservoir or a seawater (brackish groundwater) treatment plant of sufficient size to offset the lost reservoir yield. Such a project would need Monterey County as the lead agency, with assistance from state or federal funding sources. Such a project would take at least a decade to plan and design.

Recycled Water Supply Risks

Recycled and advanced treated water is produced at the Monterey One Water regional treatment plant north of Marina. The site is not in the dam failure inundation zone. The plant would be subject to the same types of immediate seismic effects as the MCWD systems, including extended power outages. The recycled water systems may be temporarily off-line following a seismic event but a long-term supply impact is not likely.

Attachments

Regional Fault Map, Figure 3 from Cornerstone Earth Group report

Earthquake Hazard Areas, Figure E-6 from Monterey County MJHMP

Nacimiento Inundation Maps, Sheets 29 and 31

References


Geotechnical Investigation, MCWD A1/A2 Reservoirs and B/C Booster Pump Station, 8th Street and 6th Avenue, Marina, CA, Prepared by Cornerstone Earth Group, 12/29/2020

Monterey County Multi-Jurisdictional Hazard Mitigation Plan, June 2015


Monterey County Water Resources Agency

San Antonio Dam – No. 1008.002, Embankment Failure Inundation Maps (Full Dam Breach), prepared by AECOM, 12/20/2017

Nacimiento Dam – No. 1008.000, Embankment Failure Inundation Maps (Full Dam Breach), prepared by AECOM, 8/28/2018

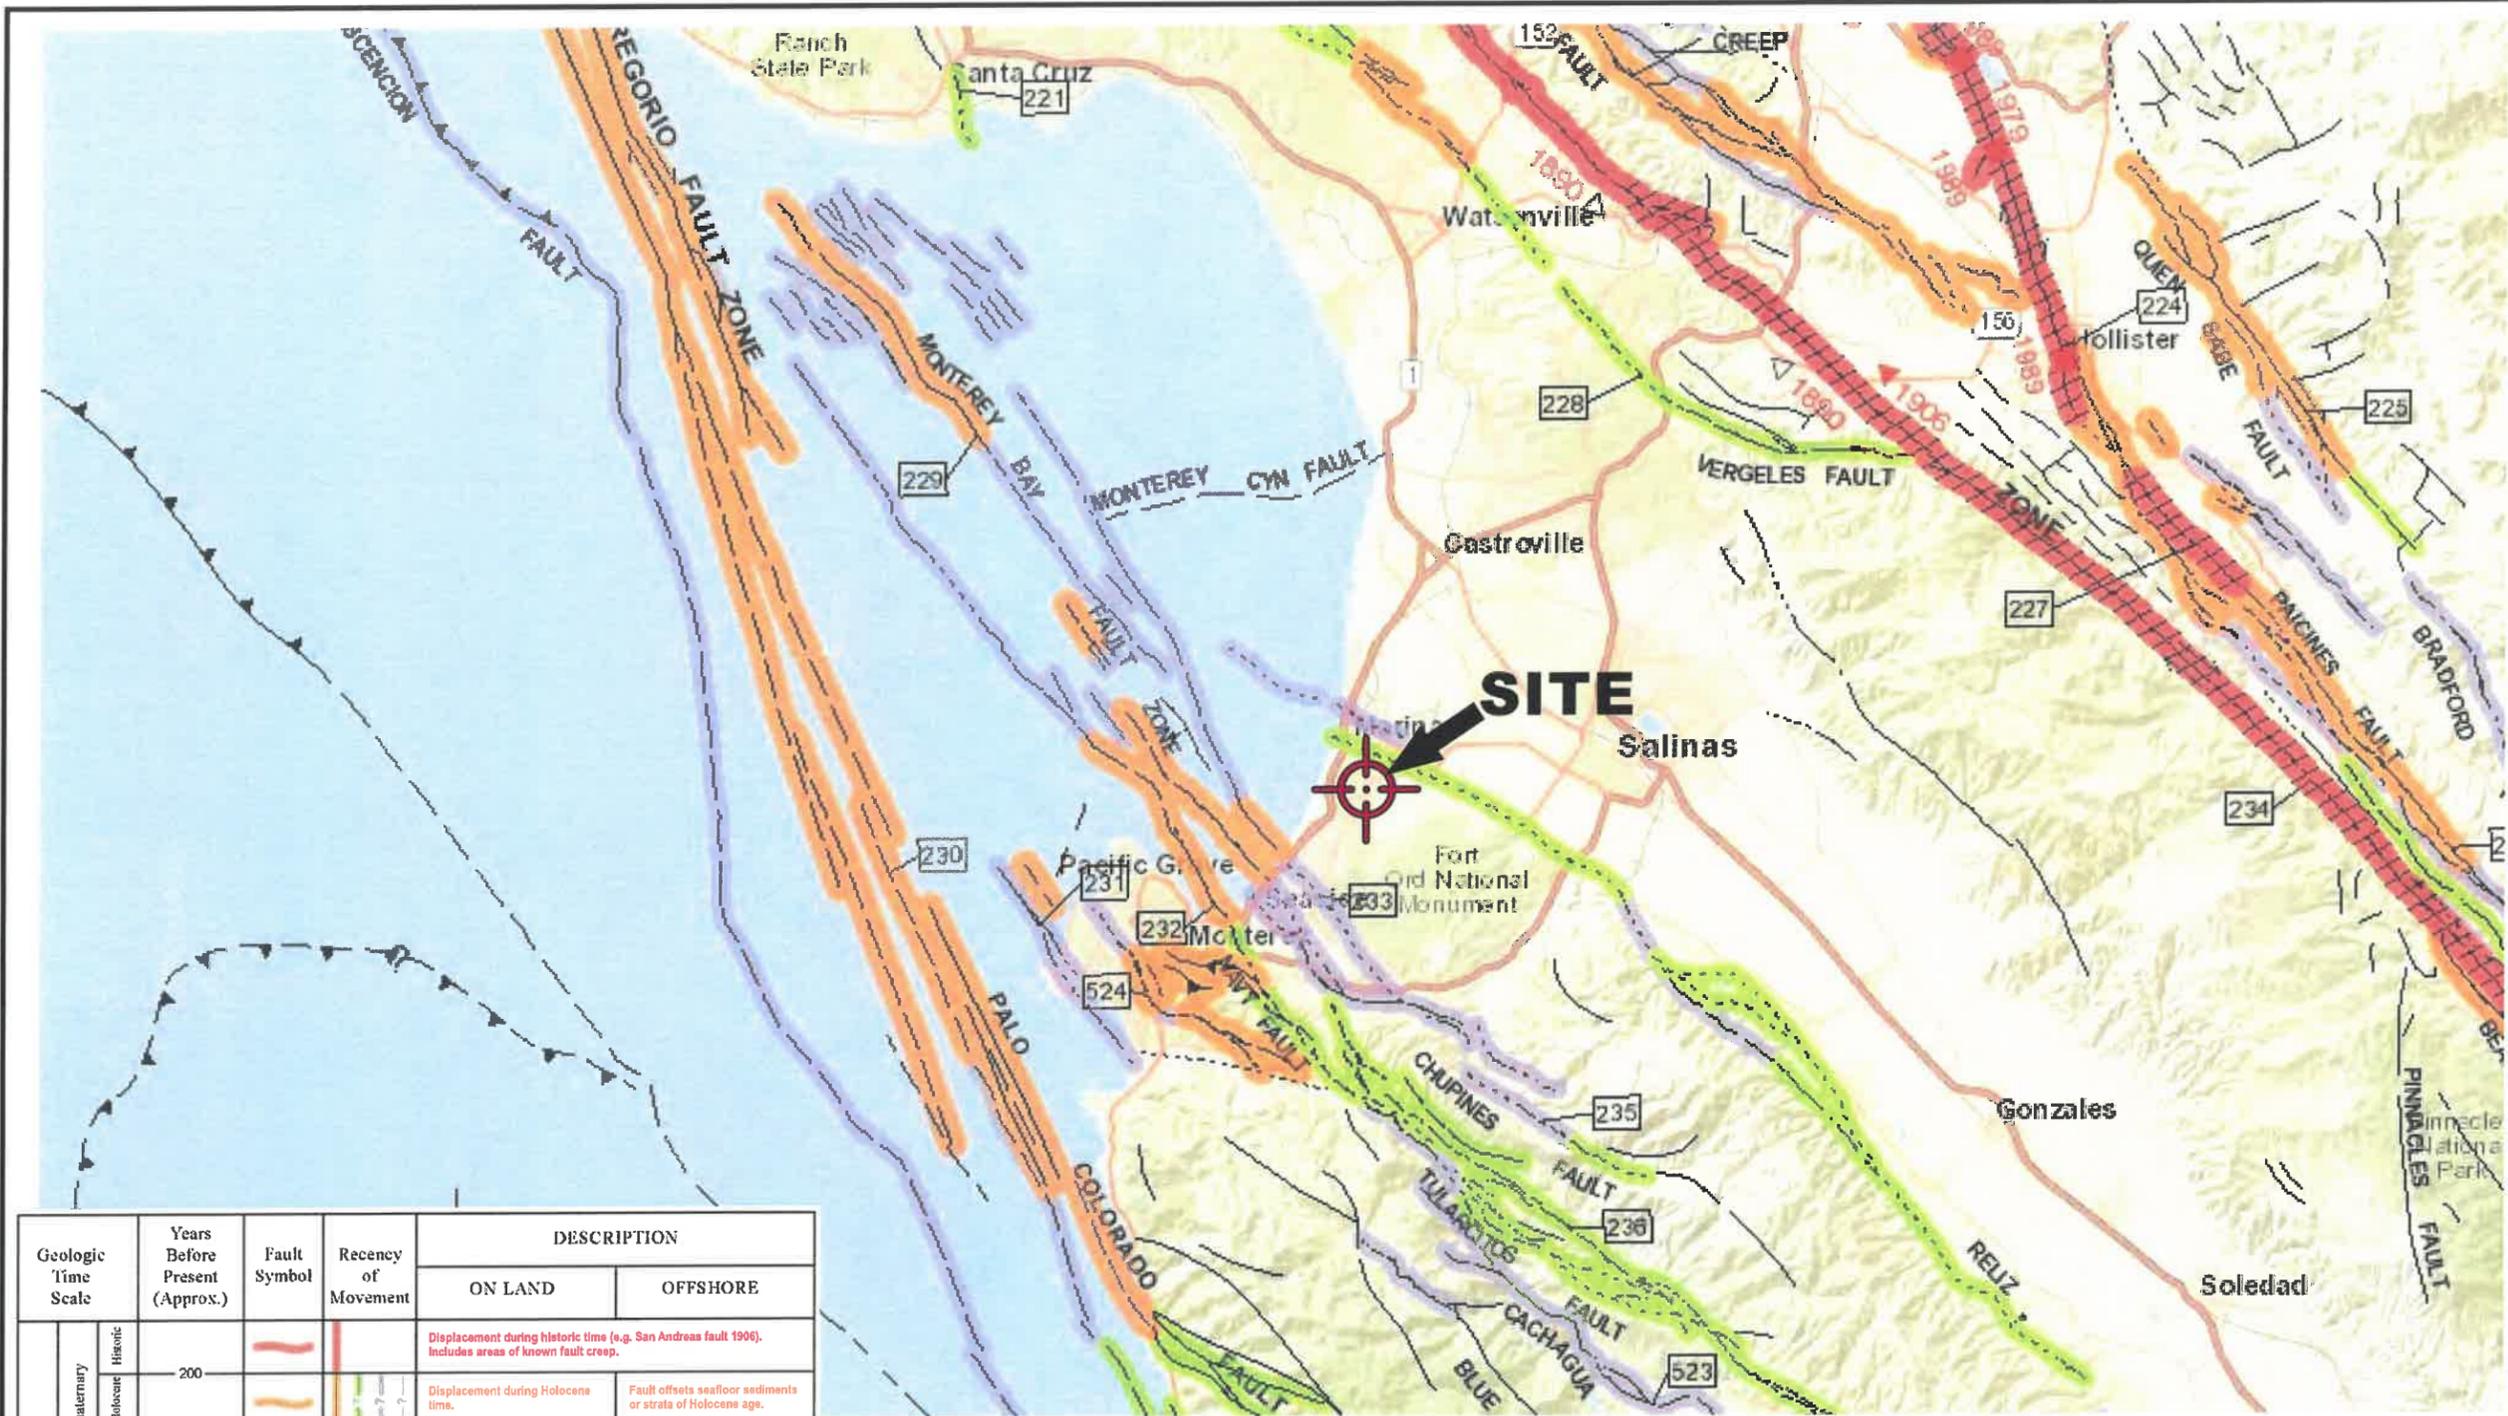

Geologic Time Scale	Years Before Present (Approx.)	Fault Symbol	Recency of Movement	DESCRIPTION	
				ON LAND	OFFSHORE
Quaternary	Late Quaternary	Holocene	[Symbol]	Displacement during historic time (e.g. San Andreas fault 1906). Includes areas of known fault creep.	Fault offsets seafloor sediments or strata of Holocene age.
				Faults showing evidence of displacement during late Quaternary time.	Fault cuts strata of Late Pleistocene age.
	Early Quaternary	Pleistocene	[Symbol]	Undivided Quaternary faults - most faults in this category show evidence of displacement during the last 1,600,000 years; possible exceptions are faults which displace rocks of undifferentiated Plio-Pleistocene age.	Fault cuts strata of Quaternary age.
Pre-Quaternary				4.5 billion (Age of Earth)	Faults without recognized Quaternary displacement or showing evidence of no displacement during Quaternary time. Not necessarily inactive.

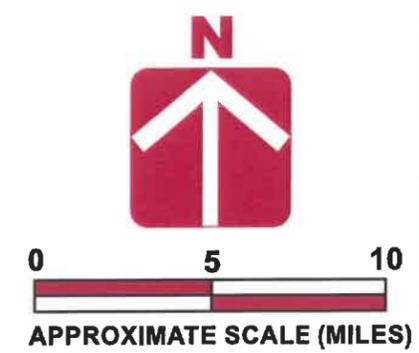

Appendix A
 Base map by California Geological Survey - 2010 Fault Activity Map of California (Jennings and Bryant, 2010)

Regional Fault Map

MCWD A1/A2 Reservoirs and B/C Booster Pump Station Marina, CA






CORNERSTONE EARTH GROUP

Project Number: 187-55-1
 Figure Number: Figure 3
 Date: August 2019
 Drawn By: RRN

Figure E-6. Earthquake Hazard Areas



Monterey County, California
Multi-Jurisdictional Hazard Mitigation Plan

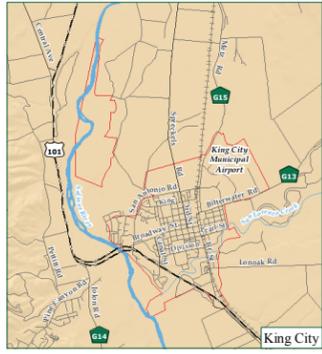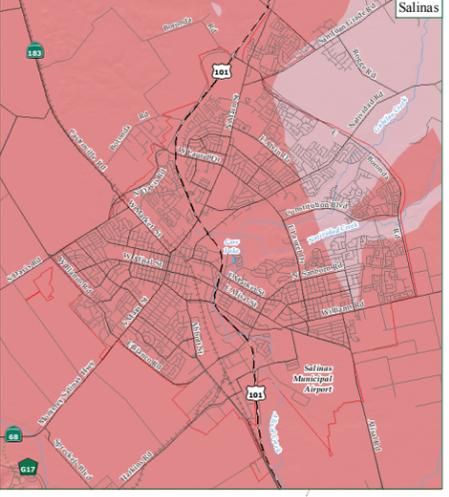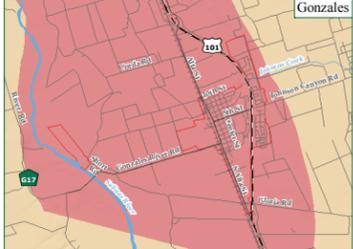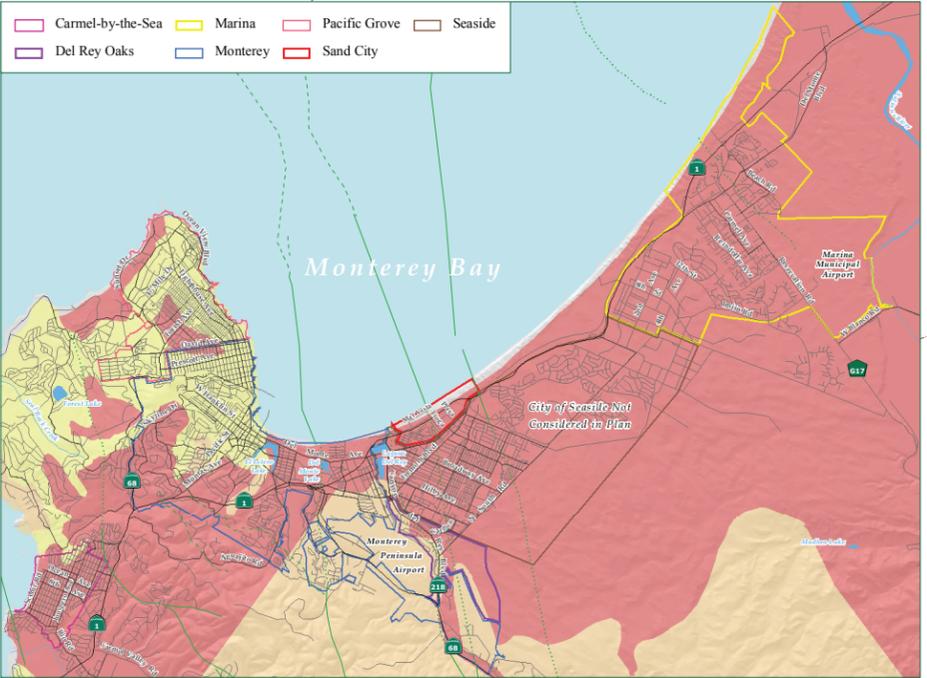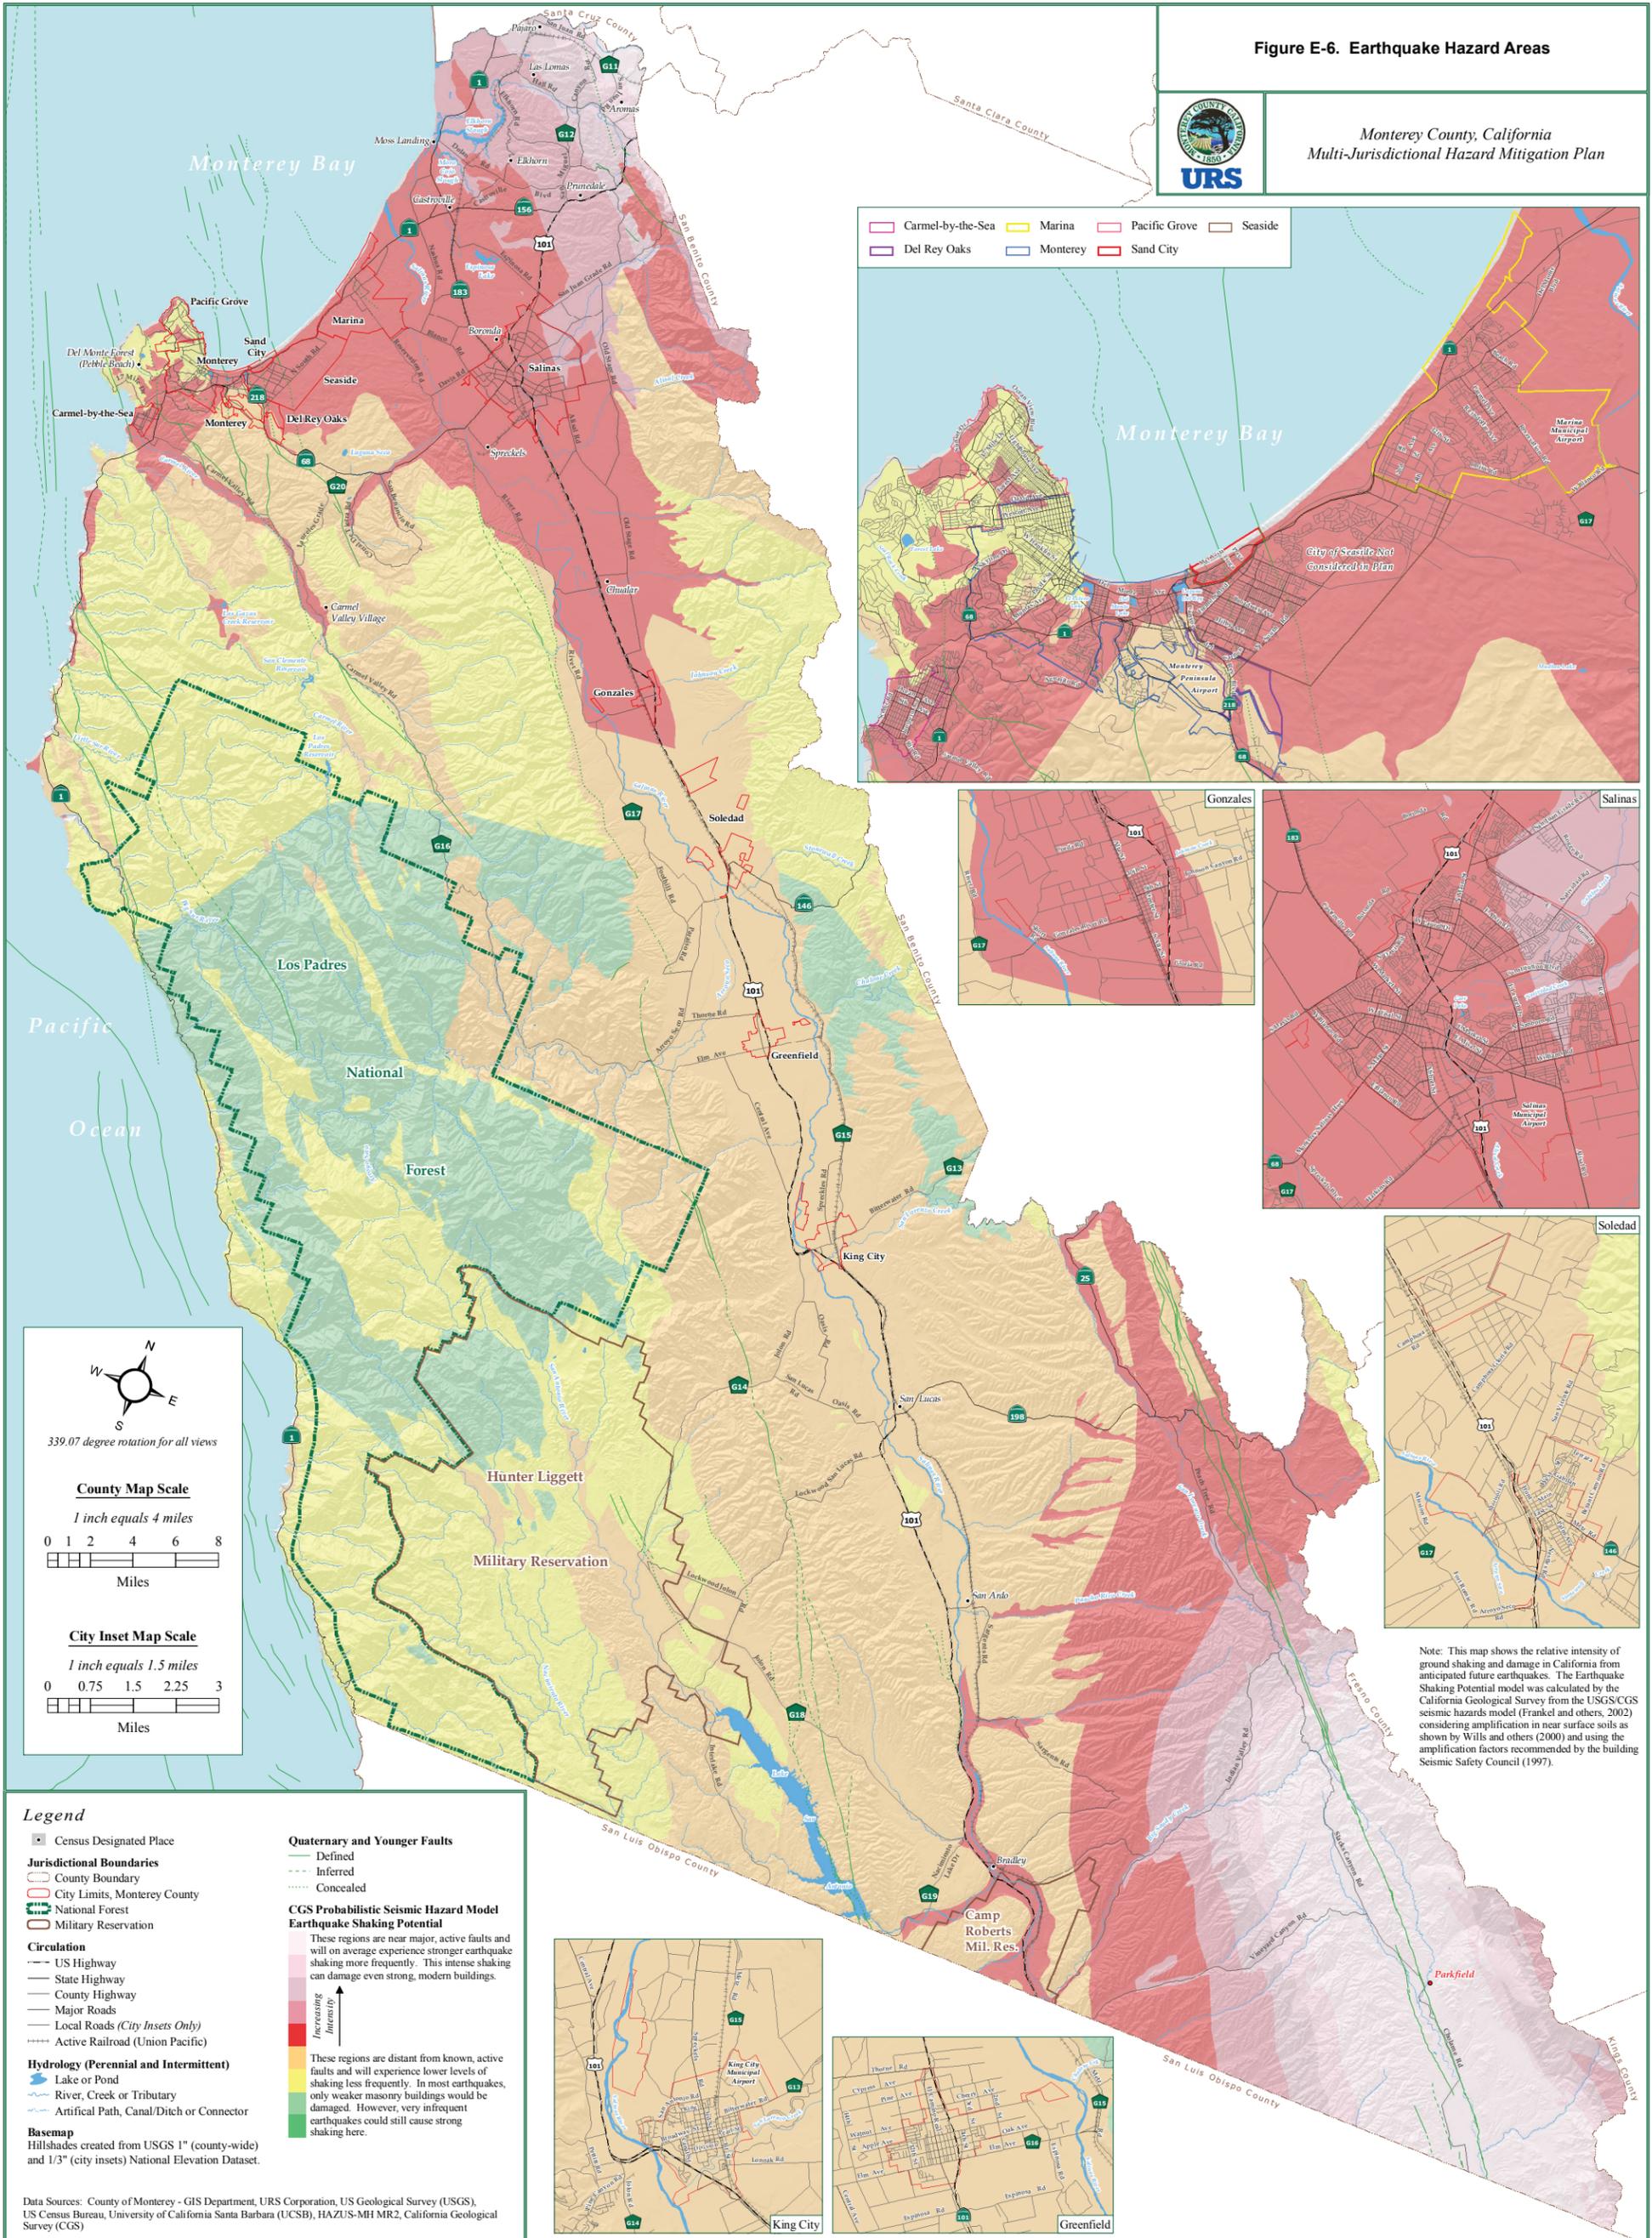

- Carmel-by-the-Sea
- Marina
- Pacific Grove
- Seaside
- Del Rey Oaks
- Monterey
- Sand City

339.07 degree rotation for all views

County Map Scale
1 inch equals 4 miles

0 1 2 4 6 8
Miles


City Inset Map Scale
1 inch equals 1.5 miles

0 0.75 1.5 2.25 3
Miles

- Legend**
- Census Designated Place
 - Jurisdictional Boundaries**
 - County Boundary
 - City Limits, Monterey County
 - National Forest
 - Military Reservation
 - Circulation**
 - US Highway
 - State Highway
 - County Highway
 - Major Roads (City Insets Only)
 - Active Railroad (Union Pacific)
 - Hydrology (Perennial and Intermittent)**
 - Lake or Pond
 - River, Creek or Tributary
 - Artificial Path, Canal/Ditch or Connector
 - Basemap**
Hillshades created from USGS 1" (county-wide) and 1/3" (city insets) National Elevation Dataset.
- Quaternary and Younger Faults**
- Defined
 - Inferred
 - Concealed
- CGS Probabilistic Seismic Hazard Model Earthquake Shaking Potential**
- These regions are near major, active faults and will on average experience stronger earthquake shaking more frequently. This intense shaking can damage even strong, modern buildings.
- These regions are distant from known, active faults and will experience lower levels of shaking less frequently. In most earthquakes, only weaker masonry buildings would be damaged. However, very infrequent earthquakes could still cause strong shaking here.

Note: This map shows the relative intensity of ground shaking and damage in California from anticipated future earthquakes. The Earthquake Shaking Potential model was calculated by the California Geological Survey from the USGS/CGS seismic hazards model (Frankel and others, 2002) considering amplification in near surface soils as shown by Wills and others (2000) and using the amplification factors recommended by the building Seismic Safety Council (1997).

Data Sources: County of Monterey - GIS Department, URS Corporation, US Geological Survey (USGS), US Census Bureau, University of California Santa Barbara (UCSB), HAZUS-MH MR2, California Geological Survey (CGS)

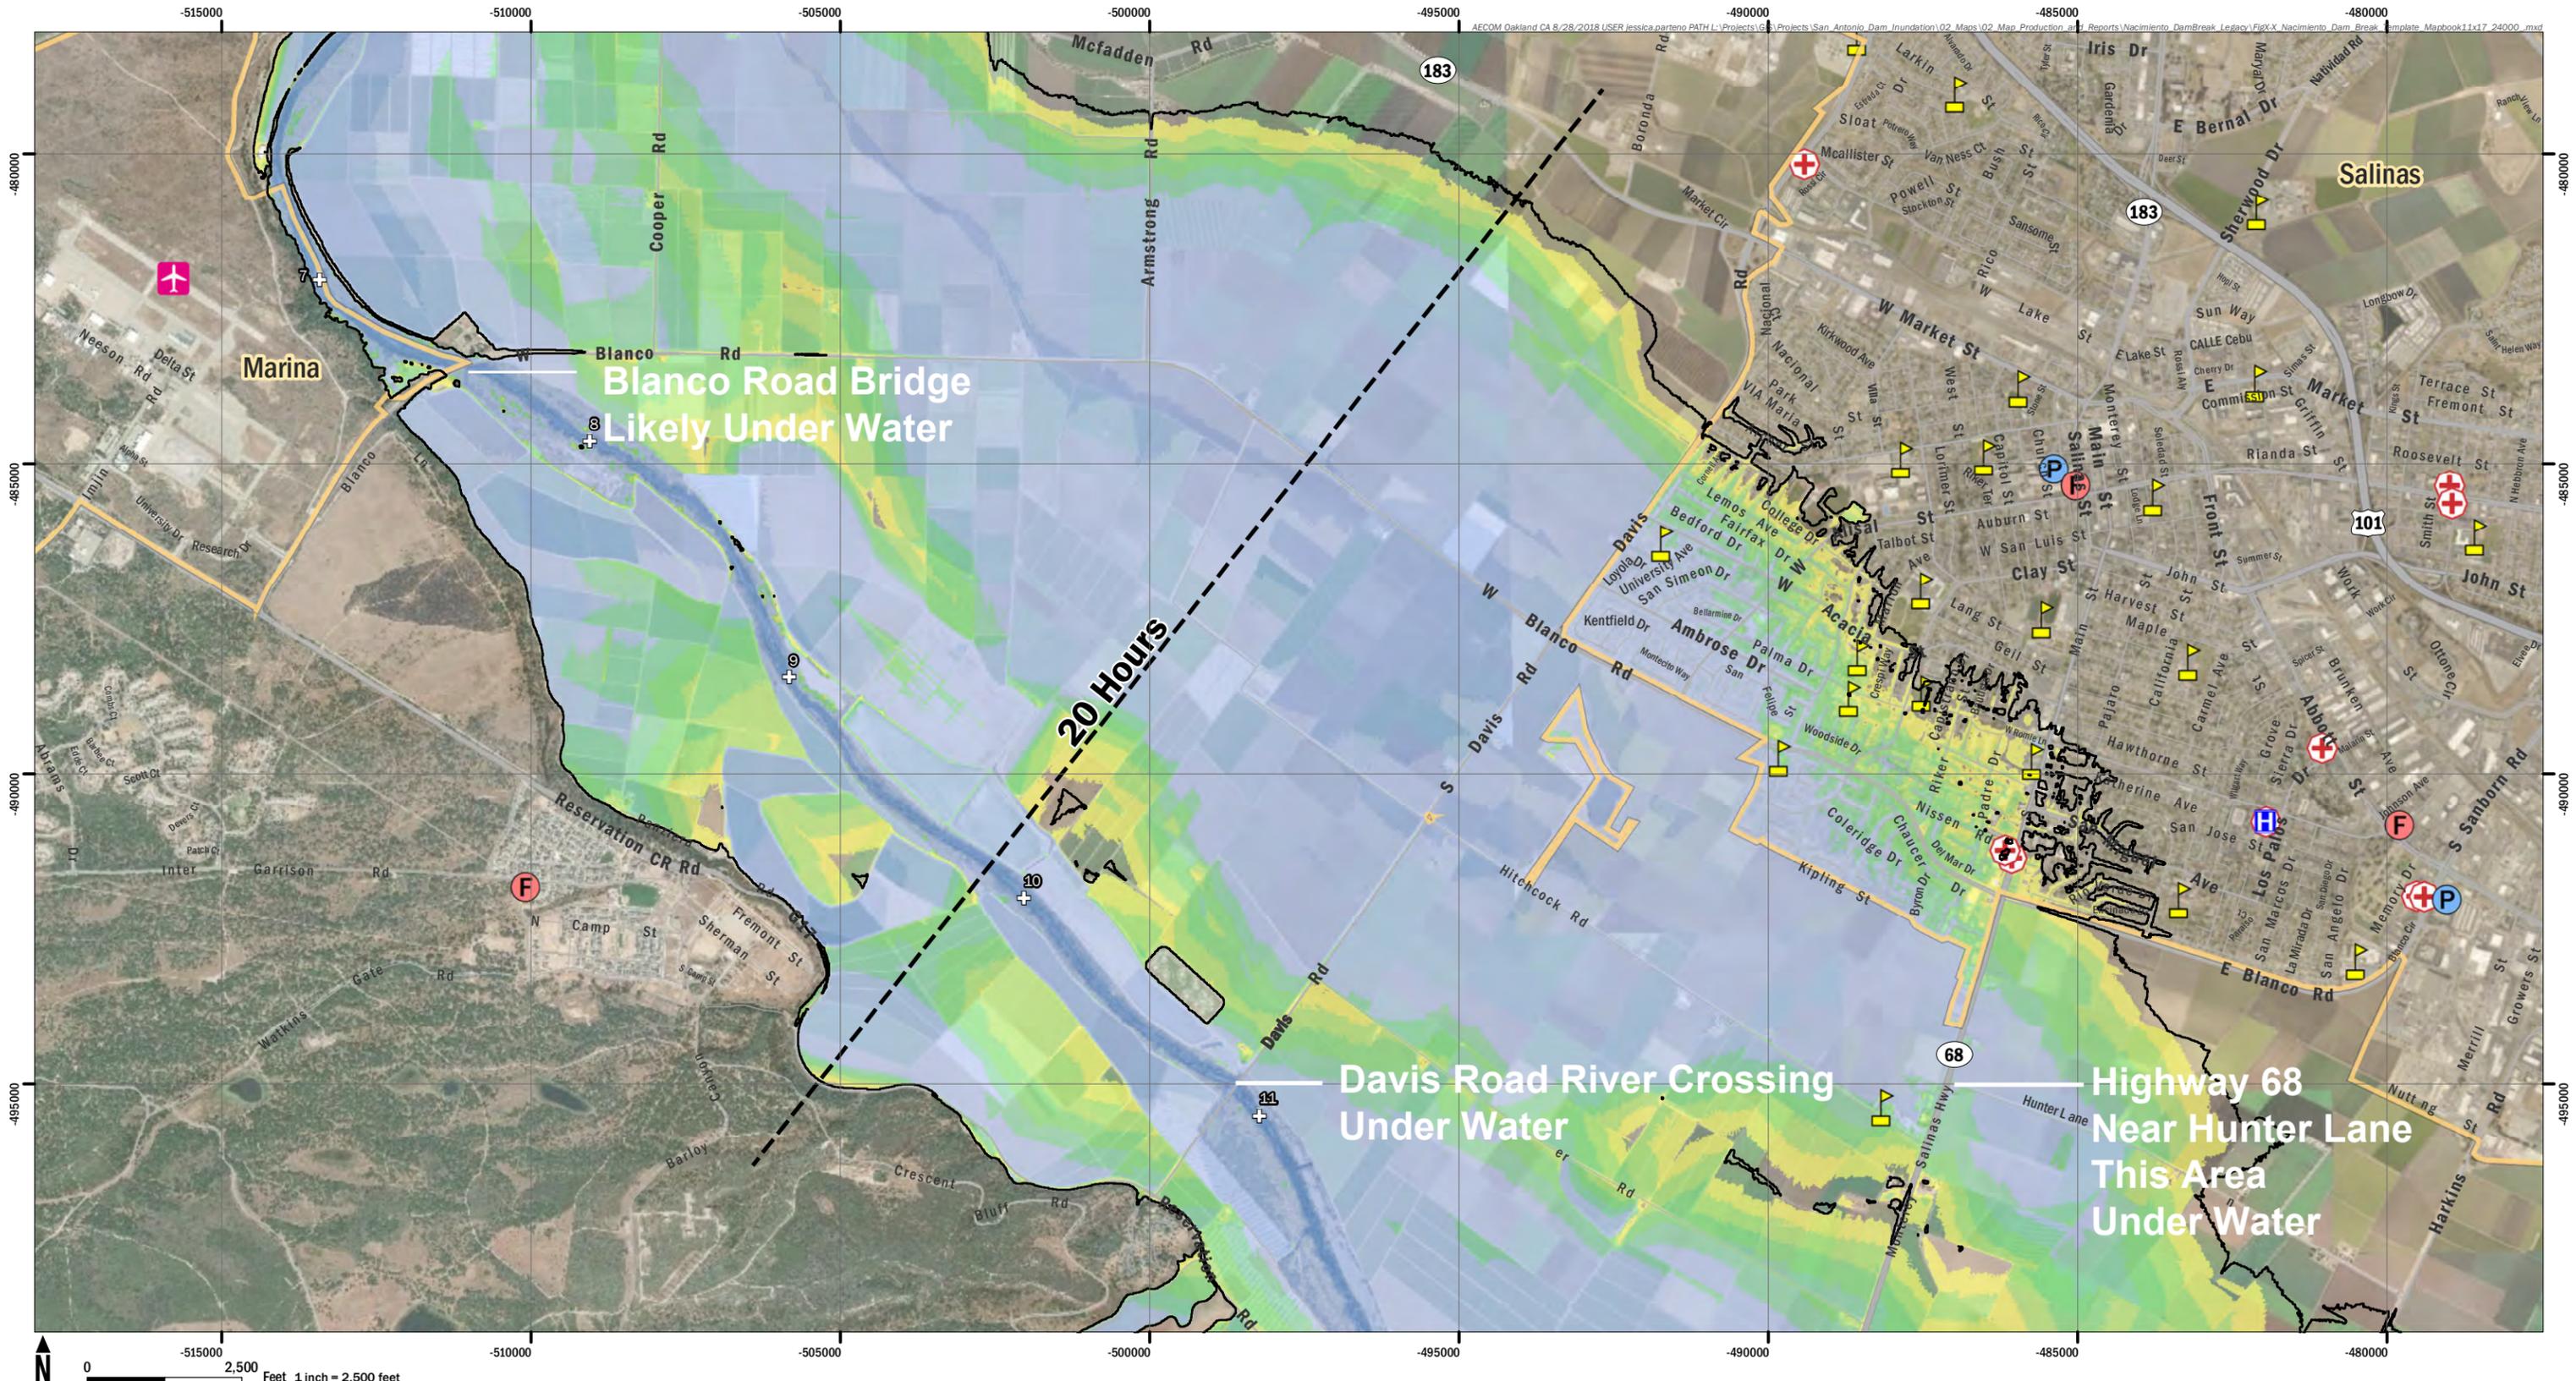

AECOM
 Monterey County Water Resources Agency
Nacimiento Dam Inundation

Name of the Dam: Nacimiento
 Department Dam number: 1008.000
 National Dam ID number: CA00812
 County where the dam is located: San Luis Obispo
 Failure Scenario: Full Dam Breach (Sunny-Day)

Horizontal Datum: NAD 1983 California Teale Albers (Ft US)
 Vertical Datum: NGVD29
 Date map was prepared: Date: 8/28/2018

Appendices Page 79



Fire Station	Clinics/Urgent Care	Major Highways	Maximum Flood Depth (ft) 0 - 1 1 - 2 2 - 3 3 - 4 4 - 5	5 - 10	35 - 40
Library	School	Highways		10 - 15	40 - 45
Police Station	River Mile Marker	Major Roads		15 - 20	45 - 50
Airport	City Boundary	Local Traffic		20 - 25	50 - 75
Hospitals	Arrival Time			25 - 30	75 - 100
			30 - 35	> 100 ft color swatch"/> > 100	

8/28/2018

FIGURE A-1: MAXIMUM FLOOD DEPTH
Nacimiento Dam Flood Inundation Map
 Page 29 of 34

Data Source: These maps were compiled using data prepared by Schaff and Wheeler for the "Nacimiento Failure Analysis," dated November 1990, and the "Flood Control Benefits Analysis," dated November 1997. Maps are based on Failure Analysis Inundation Maps developed by Schaff and Wheeler dated December 2013.

Disclaimer: The information shown is approximate and should be used as a guideline for emergency response and preparation purposes. The inundation map meets all applicable state and federal standards and has been prepared in consideration of all potential downstream hazards by a licensed civil engineer.



AECOM
 Monterey County Water Resources Agency
 Nacimiento Dam Inundation

Name of the Dam: Nacimiento
 Department Dam number: 1008.000
 National Dam ID number: CA00812
 County where the dam is located: San Luis Obispo
 Failure Scenario: Full Dam Breach (Sunny-Day)

Horizontal Datum: NAD 1983 California Teale Albers (Ft US)
 Vertical Datum: NGVD29
 Date map was prepared: Date: 8/28/2018

Appendices Page 80



Fire Station	Clinics/Urgent Care	Major Highways	Maximum Flood Depth (ft) 0 - 1 1 - 2 2 - 3 3 - 4 4 - 5	5 - 10	35 - 40
Library	School	Highways		10 - 15	40 - 45
Police Station	River Mile Marker	Major Roads		15 - 20	45 - 50
Airport	City Boundary	Local Traffic		20 - 25	50 - 75
Hospitals	Arrival Time			25 - 30	75 - 100
			30 - 35	> 100	

REGISTERED PROFESSIONAL ENGINEER
 PHILLIP MINEART
 No. CC 4487
 Exp. 12/31/19
 CIVIL
 STATE OF CALIFORNIA

8/28/2018

FIGURE A-1: MAXIMUM FLOOD DEPTH
 Nacimiento Dam Flood Inundation Map
 Page 31 of 34

Small Source: These maps were compiled using data prepared by Schaff and Wheeler for the "Nacimiento Failure Analysis," dated November 1990, and the "Flood Control Benefits Analysis," dated November 1997. Maps are based on Failure Analysis Inundation Maps developed by Schaff and Wheeler dated December 2013.

Disclaimer: The information shown is approximate and should be used as a guideline for emergency response and preparation purposes. The inundation map meets all applicable state and federal standards and has been prepared in consideration of all potential downstream hazards by a licensed civil engineer.

Appendix F: Water Shortage Contingency Plan with Resolution of Adoption

The following documents are included in this appendix:

1. Resolution 2015-33, dated July 6, 2015, Adopting an Updated Water Shortage Contingency Plan
2. MCWD Water Shortage Contingency Plan, dated July 6, 2015
3. Resolution 2014-34, dated November 3, 2014, Declaring Water Conservation Stage 3 (included as an example of an implementing resolution)

July 6, 2015

Resolution No. 2015-33
Resolution of the Board of Directors
Marina Coast Water District
Adopting an Updated Water Shortage Contingency Plan

RESOLVED by the Board of Directors (“Directors”) of the Marina Coast Water District (“MCWD”), at a regular meeting duly called and held on July 6, 2015, at 211 Hillcrest Avenue, Marina, California as follows:

WHEREAS, Section 10632 of the California Water Code requires the Marina Coast Water District to maintain a Water Shortage Contingency Plan within its Urban Water Management Plan; and,

WHEREAS, the District maintains a Water Shortage Contingency Plan and desires to update said plan in accordance with the Water Code and provide a guidance document for management of water shortages within the District; and,

WHEREAS, due to ongoing historic drought conditions, the District desires to incorporate current mandatory water conservation measures into an updated Water Shortage Contingency Plan.

NOW, THEREFORE, BE IT RESOLVED, that the Board of Directors of the Marina Coast Water District does hereby:

1. Approve and adopt the attached Water Shortage Contingency Plan, and,
2. Authorize the Interim General Manager to file the Water Shortage Contingency Plan with the California Department of Water Resources.


PASSED AND ADOPTED on July 6, 2015 by the Board of Directors of the Marina Coast Water District by the following roll call vote:

Ayes: Directors Shriner, Moore, Lee, Le

Noes: Directors None

Absent: Directors Gustafson

Abstained: Directors None



Peter Le, Vice President

ATTEST:



Bill Kocher, Secretary

CERTIFICATE OF SECRETARY

The undersigned Secretary of the Board of the Marina Coast Water District hereby certifies that the foregoing is a full, true and correct copy of Resolution No. 2015-33 adopted July 6, 2015.



Bill Kocher, Secretary

MARINA COAST WATER DISTRICT WATER SHORTAGE CONTINGENCY PLAN

1.0 INTRODUCTION AND BACKGROUND

This Water Shortage Contingency Plan is developed in compliance with California Water Code Section 10632. Requirements of subsections (a)(1)-(a)(9) and (b) are identified below and are accompanied by the required elements and information.

The Marina Coast Water District (MCWD) obtains its water supply from the Salinas Valley Groundwater Basin (SVGB). The SVGB is not adjudicated and provides water for growers, municipalities and other municipal and industrial uses in the Salinas Valley. Due to cumulative basin pumping, coastal aquifers are experiencing seawater intrusion. MCWD continues to work with Monterey County Water Resources Agency (MCWRA) in developing plans to coordinate and encourage preservation of the SVGB aquifers by all municipal and agricultural users.

In 2005, MCWD interconnected its two service areas, Central Marina and the Ord Community. The interconnection has improved system-wide reliability, making maximum use of available water storage tanks in the Ord Community and allowing both areas to be served by any of the eight District wells. In 2007, the District consolidated the two systems under a single Public Water System Permit.

The District continues its participation as a member of the Water Awareness Committee of Monterey County (WAC). Through the WAC, representatives from several agencies throughout Monterey County work together coordinating conservation and other water awareness efforts including education programs, information booths for special events and public understanding of Monterey County water challenges and opportunities.

California Water Code Section 10632(a)(3) Actions to be undertaken by the urban water supplier to prepare for, and implement during, a catastrophic interruption of water supplies, including but not limited to, a regional power outage, an earthquake or other disaster.

The MCWD developed and adopted an Emergency Response Plan¹ for emergency and disaster occurrences with guidelines and agreements for cooperative efforts with other State and local agencies, as required by the State Water Resources Control Board, Division of Drinking Water (DDW). This Plan contains actions MCWD would initiate in the event of a catastrophic reduction in its water supply.

2.0 STAGES OF ACTION

California Water Code Section 10632(a)(1) Stages of action to be undertaken by the urban water supplier in response to water supply shortages, including up to a 50 percent reduction in water supply and an outline of specific water supply conditions which are applicable to each stage.

¹ Ordinance 44, adopted in 2007

The MCWD has developed a five-stage Water Conservation Plan that includes two voluntary and three mandatory stages. Table 1 generally describes the various stages. Specific water supply conditions applicable to each stage, referred to as “triggering mechanisms” herein, are discussed in the next section.

Table 1: Water Conservation Stages and Demand Reduction Goals

<u>Stage</u>	<u>Water Shortage Level</u>	<u>Demand Reduction Goal</u>	<u>Type Program</u>
Stage 1	0 – 10%	10% reduction	Voluntary Compliance
Stage 2	>10 - 25%	20% reduction	Voluntary Compliance
Stage 3	>25 - 35%	30% reduction	Mandatory Compliance
Stage 4	>35 – 50%	40% reduction	Mandatory Compliance
Stage 5	>50%	50%+ reduction	Mandatory Compliance
<p>Priorities for use of available water, based on California Water Code Chapter 3 are:</p> <ol style="list-style-type: none"> 1. Health and Safety - interior residential and fire fighting 2. Commercial, Industrial, and Governmental - maintain jobs & economic base 3. Existing Landscaping - especially trees and shrubs 4. New Demand - projects without permits when shortage declared 			

California Water Code Section 10632(a)(2) An estimate of the minimum water supply available during each of the next three water years based on the driest three-year historic sequence for the agency’s water supply.

This requirement is oriented toward water supply systems that are primarily supplied with surface water and are therefore directly affected by short-term fluctuations in hydrology (i.e., drought conditions). MCWD’s current water supply is produced through groundwater pumping from the large SVGB. MCWD supply availability from this basin has not historically varied due to short-term hydrologic conditions. MCWD’s wells are located in the Pressure Sub-Area of the SVGB. Within the Pressure Sub-Area, the historic difference between water levels under average and drought conditions is only 10- to 20-feet. The minimum water supply available during the driest three-year sequence is expected to match demands as discussed in the Urban Water Management Plan.

3.0 TRIGGERING MECHANISMS

The SVGB is currently the most important source of water for MCWD. In 2004, the MCWD's groundwater withdrawals of about 4,600 acre-feet accounted for less than one percent (1%) of the estimated basin-wide annual extractions of roughly 550,000 acre-feet. Given this relatively small percentage, MCWD conservation and contingency management activities can play only a small part within the SVGB. The foremost concern in developing appropriate triggers is achieving the maximum practical protection of an adequate long-term water supply of acceptable quality for MCWD customers. To that end, triggering mechanisms should be tied to factors that, directly or indirectly, have the greatest potential effect on the quality and quantity of available groundwater. Two general types of threats could cause MCWD to experience water shortages:

1. Unanticipated catastrophic system failure due to an earthquake, terrorist attack or sudden contamination of water supply, or
2. Chronic system shortage due to seawater intrusion reaching water supply wells in

concentrations such that those wells would have to be removed from service.

In the case of a catastrophic failure, the MCWD would assess the nature and extent of the failure, and the General Manager would identify the appropriate Conservation Stage in accordance with the expected level of water supply shortage. Should shortages be anticipated in amounts beyond fifty percent of normal demands, emergency actions will be taken in accordance with the MCWD's Emergency Response Plan, including enacting emergency ordinances as may be required by MCWD Board of Directors.

The chronic system threat to MCWD's present water supplies is seawater intrusion, which has occurred along the coastal margin of the Salinas Valley in response to historic over-drafting of the basin. Contamination from volatile organic compounds (VOCs) has also affected MCWD wells and could pose additional problems. Although seawater intrusion has not yet affected the deep zone (900-Foot Aquifer) of the SVGB (which is the source of supply for District Wells No.10, 11, 12 and 34), it is possible that continued extractions in the 900-Foot Aquifer could ultimately lead to contamination of these water supplies by seawater. MCWD monitors the rate of seawater intrusion and plans to develop alternative water resources that would be insulated from intrusion. However, it is possible for intrusion to appear in a relatively short time span and reduce overall supplies available. Consequently, the MCWD has structured this Water Shortage Contingency Plan with the primary goal of reducing water demands to allow time for alternative water supply measures, including the drilling of alternate wells in areas unaffected by intrusion and/or contamination. A specific triggering mechanism for various levels of conservation is tied to concentrations of chlorides in MCWD wells and possible concentrations of VOCs, such as trichloroethylene (TCE) which was previously observed at low levels in Well No. 9 (no longer in service) in Central Marina and is occasionally detected at Wells No. 29, 30 and 31 in the Ord Community. Chloride concentration is directly related to the seawater intrusion problem, and both parameters (chloride and VOCs) are related to the overall basin viability as a secure source of water supply.

Chloride concentration is a key indicator of water quality degradation due to seawater intrusion. Tests for statistically significant changes in chloride concentrations assist in the detection of the earliest stages of intrusion and are appropriate indicators of a water supply emergency. In addition, MCWD currently monitors its Ord Community wells for the presence of TCE and other organic compounds, and works with the U.S. Army regarding the Army's groundwater cleanup actions in the Ord Community.

Climate conditions are monitored by the State of California and by Monterey County. Monterey County specifically monitors water levels in the Salinas Valley Groundwater Basin. During prolonged or extended periods of drought, the State of California, acting through the Legislature, the State Water Resources Control Board (SWRCB) and/or the Department of Water Resources may enact rules or legislation directing urban water suppliers to implement demand reduction measures. Similarly, the County of Monterey, acting through the Board of Supervisors and/or the Monterey County Water Resources Agency may enact rules or ordinances directing urban water suppliers to implement demand reduction measures. Such legislation, rules or ordinances shall be considered as triggering mechanisms under this Plan.

TRIGGERING MECHANISMS FOR CONSERVATION STAGES

These Triggering mechanisms shall be interpreted as guidelines and are summarized in Table 2. The General Manager and/or Board of Directors may impose any of the following conservation stages based upon facts and circumstances which may not have been otherwise anticipated in this plan.

Table 2 Conservation Level Triggering Mechanisms

Conservation Stage and Water Shortage Level	Triggering Mechanism
Stage One 0-10% Water Shortage Voluntary Compliance	1) system malfunction resulting in up to 10% shortage 2) increase in chlorides which do not threaten to exceed drinking water quality standard 3) increase in VOC concentrations which do not threaten to exceed standards with blending 4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions
Stage Two >10-25% Water Shortage Voluntary Compliance	1) system malfunction resulting in greater than 10% shortage 2) increase in chlorides which may threaten to exceed drinking water quality standard 3) increase in VOC concentrations which do not threaten to exceed standards with blending 4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions
Stage Three >25-35% Water Shortage Mandatory Compliance	1) system malfunction resulting in greater than 25% shortage 2) increase in chlorides which are expected to exceed drinking water quality standard 3) increase in VOC concentrations which do not threaten to exceed standards with blending or when remaining capacity is reduced by up to 25% 4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions
Stage Four >35-50% Water Shortage Mandatory Compliance	1) system malfunction resulting in greater than 35% shortage 2) increase in chlorides which are expected to exceed drinking water quality standard 3) increase in VOC concentrations which do not threaten to exceed standards with blending or when remaining capacity is reduced more than 35% 4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions
Stage Five >50% Water Shortage Mandatory Compliance	1) system malfunction resulting in greater than 50% shortage 2) increase in chlorides which are expected to exceed drinking water quality standard

	<p>3) increase in VOC concentrations which do not threaten to exceed standards with blending or when remaining capacity is reduced more than 50%</p> <p>4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions</p>
--	--

STAGE 1 Triggers: Up to 10% Water Supply Shortage

Stage 1 conservation measures may be called for as a result of malfunction of all or portions of the water system that reduces supplies by up to 10% on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey, and/or the determination that there is a need to focus public attention on water conservation.

Further triggering could also be based on:

- 1) detection of a statistically significant increase in chloride concentrations but where such concentrations do not threaten to exceed the DDW “Upper Level” secondary (aesthetics) drinking water standard currently set at 500 mg/l at the well(s) in question, or
- 2) detection of a statistically significant increase in VOC concentrations but where such concentrations do not threaten to exceed the primary drinking water maximum contaminant level (MCL) for each VOC at the well(s) in question and/or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards.

STAGE 2 Triggers: >10% to 25% Water Supply Shortage

Stage 2 conservation measures may be called for due to malfunction or failure of all or portions of the water system that reduces supplies by greater than 10% on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey, and/or the determination that there is a need to focus public attention on water conservation.

Further triggering could also be based on:

- 1) detection of a statistically significant increase in chloride concentrations where such concentrations may threaten to exceed the DDW “Upper Level” secondary (aesthetics) drinking water standard currently set at 500 mg/l at the well(s) in question, or
- 2) detection of a statistically significant increase in VOC concentrations, but where such concentrations do not threaten to exceed the primary drinking water MCL for each VOC at the well(s) in question and/or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards.

STAGE 3 Triggers: >25% to 35% Water Supply Shortage

Stage 3 conservation measures may be called for due to malfunction or failure of all or portions of the water system that reduces supplies by greater than 25% on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey.

Further triggering could also be based on:

- 1) detection of an increase in chloride concentrations where such concentrations are expected to exceed the DDW “Upper Level” secondary (aesthetics) drinking water standard currently set at 500 mg/l at the well(s) in question, or
- 2) detection of VOC concentrations, but where such concentrations do not threaten to exceed the primary drinking water MCL for each VOC, and/or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards, and/or when gross reduced well production of up to 25% is necessary to maintain adequate water quality.

STAGE 4 Triggers: >35% to 50% Water Supply Shortage

Stage 4 conservation measures may be called for due to malfunction or failure of all or portions of the water system that reduces supplies by greater than 35% on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey.

Further triggering could also be based on:

- 1) detection of an increase in chloride concentrations where such concentrations are expected to exceed the DDW “Upper Level” secondary (aesthetics) drinking water standard currently set at 500 mg/l at the well(s) in question, or
- 2) detection of VOC concentrations, but where such concentrations do not threaten to exceed the primary drinking water MCL for each VOC, and/or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards, and/or gross reduced well production of up to 35% is necessary to maintain adequate water quality.

STAGE 5 Triggers: >50% Water Supply Shortage

Stage 5 conservation measures may be called for due to in malfunction or failure of all or portions of the water system that reduces supplies by 50 % or more on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey.

Further triggering could also be based on:

- 1) detection of an increase in chloride concentrations where such concentrations are expected to exceed the short term primary drinking water standard of 600 mg/l at

- the well(s) in question, or
- 2) detection of VOC concentrations but where such concentrations do not threaten to exceed the primary drinking water MCL for each VOC, and /or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards, and/or gross reduced well production of over 50% is necessary to maintain adequate water quality.

4.0 CONSERVATION REQUIREMENTS AND APPEAL PROCEDURES

The following are MCWD's conservation requirements by customer type and stage and the appeal procedures. These requirements and procedures are adopted as part of MCWD's Water Shortage Contingency Plan.

STAGE 1 Actions: Voluntary – Minimal Conservation Requirement, 10% Demand Reduction Goal

MCWD shall:

- notify all customers of the water shortage
- mail information to every customer and reasonably available potential water user explaining the importance of significant water use reductions
- provide technical information to customers on ways to improve water use efficiency
- conduct media campaign to remind consumers of the need to save water
- publicize the showerhead, toilet rebate and other efficiency programs
- enforce mandatory restrictions on water waste as provided in MCWD Code, Chapter 3

Stage 1 actions shall apply under any triggering event.

STAGE 2 Actions: Voluntary – Moderate Conservation Requirement, 20% Demand Reduction Goal

In addition to the actions listed in Stage 1, MCWD shall call for voluntary reductions of up to 25% for each connection based on the average use during a base period proposed by the Water Conservation Commission and adopted by MCWD's Board of Directors. Stage 2 actions shall apply under any triggering event.

STAGE 3 Actions: Mandatory – Severe Conservation Requirement, 30% Demand Reduction Goal

In addition to the actions listed in Stage 1 and 2, MCWD shall establish mandatory annual allotments for each connection based on the average use of all connections within that category during a base period proposed by the Water Conservation Commission and adopted by MCWD's Board of Directors. When Stage 3 use reductions become necessary, administration and enforcement of the District's mandatory restrictions on water waste become the major focus of MCWD. If necessary, additional temporary personnel may be hired and special meetings of the Water Conservation Commission and /or Board of Directors may be scheduled.

Stage 3 actions shall be applied based upon triggering event, as noted below.

1. Each water service connection shall receive an allotted quantity of water, typically specified in hundred cubic feet (hcf) units per billing cycle. The Board of Directors may elect not to impose this action in response to a drought if the supply reduction trigger is not met.
2. The Board of Directors may pass an emergency ordinance increasing the usage rate for potable water consumed over a connections allocation, and/or in order to ensure stable revenues for operation and maintenance of MCWD. The Board of Directors may elect not to impose this action if water service allocations are not imposed.
3. As individual customers are notified of allotments, it is expected that many requests for special consideration will be received. These petitions must be processed rapidly, efficiently and fairly. Every application for waiver must be heard, evaluated and acted upon by the Water Conservation Commission as rapidly as possible. Every action by the Water Conservation Commission shall be referred to MCWD's Board of Directors for consideration. The procedures for appeal are defined, below. Appeals shall be considered under any Stage in which mandatory restrictions or allocations are imposed.
4. No building permits will be issued or meters installed for new accounts that had not received building permits before the "Severe Shortage" was declared. The Board of Directors may elect not to impose this action in response to a drought if the supply reduction trigger is not met.
5. The following water use restrictions shall be imposed.

Stage	Type Use	Restriction	Applies
3	Existing, Irrigated Landscapes Commercial Complexes, Residential Units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water shall be subject to the following limits: (1) Landscape watering using sprinklers or automated irrigation systems is permitted only two days per week, Wednesdays and Saturdays, before 10:00 a.m. or after 5:00 p.m. The Board of Directors may choose to assign different watering days to specific areas if daily system-wide usage limits are required. (2) With on-site supervision, including supervision by a professional gardener/landscaper, landscapes may be manually watered with drip irrigation, a soaker hose, a handheld hose with a positive action shut-off nozzle, or a watering can/bucket at any time, on any day, not more than 2 days per week. (3) Irrigation of ornamental turf in roadway medians and parkway strips is prohibited. Plantings of trees, shrubs, ornamental grasses, and ground covers with low water demand, watered by drip irrigation, are encouraged.	During both Water Shortage and Drought Conditions
3	New, Irrigated Landscapes Commercial Complexes, Residential units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water shall be subject to the following limits: (1) Landscape watering is permitted three (3) days a week to maintain adequate growth on newly installed landscapes, for a period generally up to five (5) weeks. Watering days for new landscapes are Monday, Wednesday, and Saturday. Property owners must notify the District of the address where new landscape is installed and the date of installation. (2) Following the initial establishment period, landscape watering using sprinklers or automated irrigation systems is permitted only on the days associated with the current conservation stage in effect.	During both Water Shortage and Drought Conditions

Stage	Type Use	Restriction	Applies
3	Golf Courses	<p>Landscape watering with recycled water or other non-potable water sources may continue without restriction.</p> <p>Landscape watering with potable water shall be subject to the following limits:</p> <ul style="list-style-type: none"> (1) All landscape out-of-play areas such as may be found around a clubhouse or entryway shall follow the general landscape irrigation restrictions. (2) All in-play areas may be irrigated during the standard watering hours (before 10:00 a.m. or after 5:00 p.m.). (3) Course operators shall implement a plan to achieve a twenty (20) percent reduction in monthly irrigation water use. 	During both Water Shortage and Drought Conditions
3	Hotels, motels and bed and breakfasts	Hotels, motels and B&B's must offer and clearly notify guests of a "limited linen/towel exchange" program.	During both Water Shortage and Drought Conditions
3	Swimming pools, hot tubs	Initially filling new and existing swimming pools is prohibited. Draining and refilling existing swimming pools is permitted only if repairing a pool leak or repairing, maintaining or replacing a pool component that has become hazardous. All pools and tubs shall be covered when not in use to reduce evaporation.	During both Water Shortage and Drought Conditions
3	Decorative fountains, ponds and waterfalls over 20 gallons in size	Initially filling new and existing decorative fountains, ponds and waterfalls is prohibited. Adding water to make up for evaporative loss is allowed only for ponds and fountains that serve as aquarium tanks for fish or aquatic animals.	During both Water Shortage and Drought Conditions
3	Industrial and Commercial	Reduction of water use by any means is encouraged. Compliance with mandatory demand reduction measures is required for outdoor water uses including landscape irrigation, swimming pools, and vehicle washing.	During both Water Shortage and Drought Conditions
3	Vehicle and Equipment Washing	<p>Washing of vehicles and mobile equipment (e.g., washing vehicle at a residence) is permitted on any day, any time of the day, with the use of a positive action shut-off nozzle.</p> <p>All customers are encouraged to only wash those vehicles as is necessary for health and safety utilizing commercial car wash facilities.</p>	During both Water Shortage and Drought Conditions

Stage	Type Use	Restriction	Applies
3	Heavy Construction	The use of potable water for dust control shall be reduced to the greatest extent possible.	During both Water Shortage and Drought Conditions

STAGE 4 Actions: Mandatory – Critical Conservation Requirement, 40% Demand Reduction Goal

In addition to the actions listed in the previous stages, MCWD shall establish allotments based upon a 35% -50% curtailment of water use. All new and previous appeals for waiver shall be evaluated by field audit and shall be reheard by the Water Conservation Commission, if necessary, upon recommendation of MCWD staff. Water rates may be increased by the Board of Directors.

The following water use restrictions shall be imposed.

Stage	Type Use	Restriction	Applies
4	Existing, Irrigated Landscapes Commercial Complexes, Residential units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water shall be subject to the following limits: (1) Landscape watering using sprinklers or automated irrigation systems is permitted only one day per week, on Wednesdays before 10:00 a.m. or after 5:00 p.m. The Board of Directors may choose to assign different watering days to specific areas if daily system-wide usage limits are required. (2) With on-site supervision, including supervision by a professional gardener/landscaper, landscapes may be manually watered with drip irrigation, a soaker hose, a handheld hose with a positive action shut-off nozzle, or a watering can/bucket at any time, on any day, not more than 1 day per week. (3) Irrigation of ornamental turf in roadway medians and parkway strips is prohibited. Plantings of trees, shrubs, ornamental grasses, and ground covers with low water demand, watered by drip irrigation, are encouraged.	During both Water Shortage and Drought Conditions
4	New, Irrigated Landscapes	Landscape watering with recycled or other non-potable water sources water may continue without restriction.	During both Water

Stage	Type Use	Restriction	Applies
	Commercial Complexes, Residential units, Public Parks, and Athletic Fields	<p>The installation of new landscapes irrigated with potable water is discouraged.</p> <p>Landscape watering with potable water shall be subject to the following limits:</p> <ul style="list-style-type: none"> (1) Landscape watering is permitted three (3) days a week to maintain adequate growth on newly installed landscapes, for a period generally up to five (5) weeks. Watering days for new landscapes are Monday, Wednesday, and Saturday. Property owners must notify the District of the address where new landscape is installed and the date of installation. (2) Following the initial establishment period, landscape watering using sprinklers or automated irrigation systems is permitted only on the days associated with the current conservation stage in effect. 	Shortage and Drought Conditions
4	Golf Courses	<p>Landscape watering with recycled water or other non-potable water sources may continue without restriction.</p> <p>Landscape watering with potable water shall be subject to the following limits:</p> <ul style="list-style-type: none"> (1) All landscape out-of-play areas such as may be found around a clubhouse or entryway shall follow the general landscape irrigation restrictions. (2) All in-play areas may be irrigated during the standard watering hours (before 10:00 a.m. or after 5:00 p.m.). <p>Course operators shall implement a plan to achieve a thirty (30) percent reduction in monthly irrigation water use.</p>	During both Water Shortage and Drought Conditions
4	Hotels, motels and bed and breakfasts	Hotels, motels and B&B's must limit linen/towel changes to once every two (2) nights or for the entire stay, whichever is shorter, except for health and safety.	During both Water Shortage and Drought Conditions
4	Swimming pools, hot tubs	Initially filling new and existing swimming pools is prohibited. Draining and refilling existing swimming pools is permitted only if repairing a pool leak or repairing, maintaining or replacing a pool component that has become hazardous. All pools and tubs shall be covered when not in use to reduce evaporation.	During both Water Shortage and Drought Conditions

Stage	Type Use	Restriction	Applies
4	Decorative fountains, ponds and waterfalls over 20 gallons in size	Filling or refilling new and existing decorative fountains, ponds and waterfalls is prohibited. Adding water to make up for evaporative loss is allowed only for ponds and fountains that serve as aquarium tanks for fish or aquatic animals. Owners are encouraged to move fish and aquatic animals to indoor tanks less subject to evaporation.	During both Water Shortage and Drought Conditions
4	Vehicle and Equipment Washing	Washing of vehicles and mobile equipment (e.g., washing vehicle at a residence) is permitted on any day, any time of the day, with the use of a positive action shut-off nozzle. All customers are encouraged to only wash those vehicles as is necessary for health and safety utilizing commercial car wash facilities.	During both Water Shortage and Drought Conditions
4	Industrial and commercial	Reduction of water use by any means is encouraged. The Board of Directors may establish mandatory use reduction targets, if needed. Compliance with mandatory demand reduction measures is required for outdoor water uses including landscape irrigation, swimming pools, and vehicle washing.	During both Water Shortage and Drought Conditions
4	Heavy Construction	The use of potable water for dust control shall be reduced to the greatest extent possible.	During both Water Shortage and Drought Conditions

STAGE 5 Actions: Mandatory – Emergency Conservation Requirement, 50% Demand Reduction Goal

Appropriate 50% water shortage allotments shall be calculated and noticed to customers. Appropriate administration and enforcement of this stringent program shall be the highest priority of MCWD activity. All resources of MCWD will be directed toward improvement and increase of water supply to the system. Water rates may be further increased by the Board of Directors.

The following water use restrictions shall be imposed:

Stage	Type Use	Restriction	Applies
5	Existing, Irrigated Landscapes Commercial Complexes, Residential units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water is prohibited.	During both Water Shortage and Drought Conditions
5	New, Irrigated Landscapes Commercial Complexes, Residential units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. The installation of new landscapes irrigated with potable water is prohibited during Conservation Stage 5. New landscapes installed prior to declaration of Conservation Stage 5 may water two (2) days a week to maintain adequate growth on newly installed landscapes, for the remainder of the initial five (5) week establishment period. Watering days for new landscapes are Wednesday and Saturday. Property owners must notify the District of the address where new landscape is installed and the date of installation	During both Water Shortage and Drought Conditions
5	Golf Courses	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water shall be subject to the following limits: (3) All landscape out-of-play areas such as may be found around a clubhouse or entryway shall follow the general landscape irrigation restrictions. (4) All in-play areas may be irrigated during the standard watering hours (before 10:00 a.m. or after 5:00 p.m.). Course operators shall implement a plan to achieve a forty (40) percent reduction in monthly irrigation water use.	During both Water Shortage and Drought Conditions
5	Hotels, motels and bed and breakfasts	Hotels, motels and B&B's must limit linen/towel changes to once every three (3) nights or for the entire stay, whichever is shorter, except for health and safety.	During both Water Shortage and Drought Conditions

Stage	Type Use	Restriction	Applies
5	Swimming pools, hot tubs	Filling new swimming pools and/or draining and refilling existing swimming pools is prohibited. All pools and tubs shall be covered when not in use to reduce evaporation. Contact District conservation staff if an existing swimming pool must be repaired and refilled during Conservation Stage 5.	During both Water Shortage and Drought Conditions
5	Decorative fountains, ponds and waterfalls over 20 gallons in size	Filling or refilling new and existing decorative fountains, ponds and waterfalls is prohibited. Adding water to make up for evaporative loss is allowed only for ponds and fountains that serve as aquarium tanks for fish or aquatic animals. Owners are encouraged to move fish and aquatic animals to indoor tanks less subject to evaporation.	During both Water Shortage and Drought Conditions
5	Vehicle and Equipment Washing	Washing of vehicles and mobile equipment is prohibited. Only commercial facilities with water recycling systems may be used.	During both Water Shortage and Drought
5	Industrial and commercial	Reduction of water use by any means is encouraged. The Board of Directors may establish mandatory use reduction targets, if needed. Compliance with mandatory demand reduction measures is required for outdoor water uses including landscape irrigation, swimming pools, and vehicle washing.	During both Water Shortage and Drought Conditions
5	Heavy Construction	The use of potable water for dust control shall be reduced to the greatest extent possible. The District may establish mandatory construction water budgets, if needed.	During both Water Shortage and Drought Conditions

Appeals Procedure

1. Any person who wishes to appeal a customer classification or allotment shall do so in writing by using the forms provided by MCWD.
2. Appeals will be reviewed by the District staff. Site visits may be scheduled if required.
3. A condition of granting an appeal shall be that all plumbing fixtures or irrigation systems be replaced or modified for maximum water conservation.
4. Examples of appeals that may be considered are as follows:
 - a. Substantial medical requirements.

- b. Commercial/Industrial/Institutional accounts where any additional water supply reductions will result in unemployment or inappropriate hardship, after confirmation by the MCWD staff that the account has instituted all applicable water efficiency improvements.
5. In the event an appeal is requested for irrigation of trees or vegetation, MCWD staff may use the services of a qualified consultant in determining the validity of the request. Costs for such consulting services shall be paid by the party or parties making the request.
 6. District staff shall refer all appeals to the Water Conservation Commission. The Water Conservation Commission may refer appeals to MCWD's Board of Directors.
 7. If the Water Conservation Commission and the applicant are unable to reach accord, then the appeal shall be heard by the MCWD Board of Directors, who will make the final determination.
 8. All appeals shall be reported monthly to the Board as a part of the Water Supply Report.

5.0 MANDATORY PROHIBITIONS ON WATER USE

California Water Code Section 10632(a)(4) Additional, mandatory prohibitions against specific water use practices during water shortages, including, but not limited to, prohibiting the use of potable water for street cleaning. Section 10632(b) Commencing with the urban water management plan update due December 31, 2015, for purposes of developing the water shortage contingency analysis pursuant to subdivision (a), the urban water supplier shall analyze and define water features that are artificially supplied with water, including ponds, lakes, waterfalls, and fountains, separately from swimming pools and spas, as defined in subdivision (a) of Section 115921 of the Health and Safety Code. Section 10632(a)(5) Consumption reduction methods in the most restrictive stages. Each urban water supplier may use any type of consumption reduction methods in its water shortage contingency analysis that would reduce water use, are appropriate for its area, and have the ability to achieve a water use reduction consistent with up to a 50 percent reduction in water supply.

The MCWD adopted a "Water Waste/Water Conservation" Ordinance (Ordinance No. 20) in April of 1990, which prohibits water waste and promotes water conservation. Since the initial adoption, revisions were adopted by the Board of Directors on April 14, 1992 and October 4, 1993. The ordinance has most recently been revised on and now appears as Chapter 3.36 of MCWD Code. Section 3.36.030, Mandatory Restrictions on Water Waste, details the applicable prohibitions of use. These prohibitions are in force at all times. Additional water use reduction methods available to water users or MCWD to adopt in order to comply with use reductions during the more restrictive stages of water shortages (Stages 4 and 5) include, but are not limited to, the following:

- a) elimination of turf irrigation with potable supplies;
- b) restriction of landscape watering to shrubs and trees by hand or drip irrigation only;
- c) elimination of vehicle washing except in car washes that have water recirculation

systems;

- d) prohibition on filling or topping off of swimming pools where damage to pumping equipment will not result;
- e) elimination of the issuance of construction meters;
- f) shut-off of dedicated landscape irrigation meters; and
- g) moratorium on provision of new supply meters.

If water use reductions called for in Stages 3-5 are not achieved, the MCWD may amend this Water Shortage Contingency Plan to make any of the above available conservation tactics mandatory.

6.0 PENALTIES OR CHARGES FOR EXCESSIVE USE

California Water Code Section 10632(a)(6) Penalties or charges for excessive use.

Section 3.36.050 of MCWD Code provides for a system of violations and notices. Violation of provisions of this Water Shortage Contingency Plan shall be enforced under Section 3.36.050 of MCWD Code.

7.0 REVENUE AND EXPENDITURE IMPACTS

California Water Code Section 10632(a)(7) – An analysis of the impacts of each of the actions and conditions described in subdivisions (a)(1) to (a)(6), inclusive, on the revenues and expenditures of the urban water supplier, and proposed measures to overcome those impacts, such as the development of reserves and rate adjustments.

Enforcement of the Water Shortage Contingency Plan is assumed to be covered by enhanced revenues from application of excess use charges and penalties. MCWD reserves may be used temporarily should revenues remain below expectations. MCWD’s rate structure is based upon adopted rate ranges and allows for modification of rates on short notice within those ranges. MCWD retains the ability to modify rates to meet all legitimate MCWD needs. Revenue impacts from water sales losses are estimated as follows, based upon Tier 2 rates of \$2.79/hcf in Central Marina and \$3.27/hcf in the Ord Community, and recognizing approximately 10% of MCWD’s customers are not metered as of 2013.

Table 3: Potential Revenue Impacts of Implementation of WSCP

	Stage 1	Stage 2	Stage 3	Stage 4	Stage 5
Assumed Reduction	10 percent	20 percent	30 percent	40 percent	50 percent
Water Sales Loss	\$579,804	\$1,159,607	\$1,739,411	\$2,319,215	\$2,899,018
Revenue Source: Pumping savings at \$135/af	\$57,807	\$115,614	\$173,421	\$231,228	\$289,035
Net Revenue Reduction	\$521,997	\$1,043,993	\$1,565,990	\$2,087,987	\$2,609,983

Percent of Total Annual Water System Revenue	6%	12%	18%	24%	30%
--	----	-----	-----	-----	-----

* Table based on FY2012-13 water sales, \$8,839,268 for 4,282 acre-feet

8.0 WATER SHORTAGE CONTINGENCY PLAN IMPLEMENTATION

California Water Code Section 10632 (a)(8) A draft water shortage contingency resolution or ordinance.

MCWD Board of Directors adopted the Water Shortage Contingency Plan in Resolution No. 2014-___, which enables implementation of the Plan upon advice of staff based in part on the triggering mechanisms discussed herein. The resolution is attached as Appendix A to this Plan.

Chapter 3.36.035 of the MCWD Code of Ordinances² provides for enforcement of the current Water Shortage Contingency Plan. Chapter 2.09 of the Code of Ordinances³ contains a sample ordinance which may be adopted in the event of a local emergency, including a water shortage.

9.0 WATER USE MONITORING PROCEDURES

California Water Code Section 10632 (a)(9) A mechanism for determining actual reductions in water use pursuant to the urban water shortage contingency plan.

Normal Monitoring Procedure:

In normal water supply conditions, production figures are recorded daily by MCWD O&M personnel. Totals are reported monthly to the O&M Superintendent. Production figures are reported in the Annual Report to the Drinking Water Program, which is submitted to the SWRCB Division of Drinking Water each year.

Stage 1 and 2 Water Shortages

During a Stage 1 or 2 water shortage, daily production figures will be reported to the O&M Superintendent. The O&M Superintendent compares the weekly production to the target weekly production to verify that the reduction goal is being met. Monthly reports are forwarded to the District Engineer and the General Manager, the Water Conservation Commission and the MCWD Board of Directors. If reduction goals are not met, the General Manager may notify the Board of Directors so that corrective action can be taken.

Stage 3 and 4 Water Shortages

During a Stage 3 or 4 water shortage, the procedure listed above will be followed, with the addition of a daily production report to the General Manager and weekly reports to the Water Conservation Commission and Board of Directors. Special meetings may be called for administration of the

² Ordinance 41, adopted in 2005

³ Ordinance 44, adopted in 2007

Water Shortage Contingency Plan.

Stage 5 Water Shortage

During a Stage 5 shortage, production figures will be reported to the O&M Superintendent hourly, and to the General Manager daily. Reports will also be provided to MCWD's Board of Directors, the Monterey County Office of Emergency Services, and land use jurisdictions located within MCWD's service territory.

November 3, 2014

Resolution No. 2014-34
Resolution of the Board of Directors
Marina Coast Water District
Declaring Water Conservation Stage 3 as Required by the State Water Resource Control Board's
Emergency Mandatory Water Conservation Regulations

RESOLVED by the Board of Directors ("Directors") of the Marina Coast Water District ("MCWD"), at a regular meeting duly called and held on November 3, 2014, at 211 Hillcrest Avenue, Marina, California as follows:

WHEREAS, the State Water Resources Control Board (SWRCB) adopted Mandatory Water Conservation Regulations (Emergency Regulations), which went into effect on July 29, 2014; and,

WHEREAS, the District supplies more than 3,000 acre-feet of water annually and, therefore, the District is classified as an "urban water supplier" pursuant to Water Code Section 10617; and,

WHEREAS, the Emergency Regulations specifically require the following:

To promote water conservation, each urban water supplier shall implement all requirements and actions of the stage of its water shortage contingency plan that imposes mandatory restrictions on outdoor irrigation of ornamental landscapes or turf with potable water.

WHEREAS, on November 3, 2014, the District adopted a Water Shortage Contingency Plan (District Plan) pursuant to Water Code Section 10632; and,

WHEREAS, under the District Plan, mandatory restrictions on outdoor irrigation of ornamental landscapes or turf with potable water are not required until Stage 3; and,

WHEREAS, the District' water supply is not actually experiencing a severe water shortage; and,

WHEREAS, the Emergency Regulations require the Board of Directors to declare a Water Conservation Stage 3 even though the District is not actually experiencing a severe water shortage.

NOW, THEREFORE, BE IT RESOLVED, that the Board of Directors of the Marina Coast Water District does hereby do the following:

1. Declare a Water Conservation Stage 3 under the District Plan as mandated by the SWRCB.

2. Find that since the District’s water supply is not actually experiencing a severe water shortage, the following Stage 3 requirements shall **not** be implemented at this time, but shall be subject to periodic review by the Board of Directors:

a. “Each water service connection shall receive an allotted quantity of water, typically specified in hundred cubic feet (hcf) units per billing cycle.”

b. “No building permits will be issued or meters installed for new accounts that had not received building permits before the ‘Severe Shortage’ was declared.”

3. The Stage 3 mandatory water use restrictions set forth in the District Plan’s restrictions table for Stage 3 shall be implemented effective with the adoption of this Resolution.

4. Direct staff to notify all customers in writing of this decision within 10 days of the date of adoption.

PASSED AND ADOPTED on November 3, 2014 by the Board of Directors of the Marina Coast Water District by the following roll call vote:

Ayes: Directors Le, Shriner, Moore

Noes: Directors None

Absent: Directors Gustafson, Lee

Abstained: Directors None


Thomas P. Moore, President

ATTEST:


Brian C. Lee, Deputy Secretary

CERTIFICATE OF SECRETARY

The undersigned Secretary of the Board of the Marina Coast Water District hereby certifies that the foregoing is a full, true and correct copy of Resolution No. 2014-34 adopted November 3, 2014.


Brian C. Lee, Deputy Secretary

This page is intentionally blank.

Appendix G: DWR Urban Water Management Plan Checklist

Checklist arranged by Water Code Section

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Chapter 1	10615	A plan shall describe and evaluate sources of supply, reasonable and practical efficient uses, reclamation and demand management activities.	Introduction and Overview	Sections 5 and 7
Chapter 1	10630.5	Each plan shall include a simple description of the supplier's plan including water availability, future requirements, a strategy for meeting needs, and other pertinent information. Additionally, a supplier may also choose to include a simple description at the beginning of each chapter.	Summary	Section 1
Section 2.2	10620(b)	Every person that becomes an urban water supplier shall adopt an urban water management plan within one year after it has become an urban water supplier.	Plan Preparation	Resolution of Plan Adoption is in Appendix A
Section 2.6	10620(d)(2)	Coordinate the preparation of its plan with other appropriate agencies in the area, including other water suppliers that share a common source, water management agencies, and relevant public agencies, to the extent practicable.	Plan Preparation	Section 2.2 and Appendix D
Section 2.6.2	10642	Provide supporting documentation that the water supplier has encouraged active involvement of diverse social, cultural, and economic elements of the population within the service area prior to and during the preparation of the plan and contingency plan.	Plan Preparation	Section 2.2 and Appendix D

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 2.6, Section 6.1	10631(h)	Retail suppliers will include documentation that they have provided their wholesale supplier(s) - if any - with water use projections from that source.	System Supplies	Section 2.3 & Appendix D
Section 2.6	10631(h)	Wholesale suppliers will include documentation that they have provided their urban water suppliers with identification and quantification of the existing and planned sources of water available from the wholesale to the urban supplier during various water year types.	System Supplies	N/A
Section 3.1	10631(a)	Describe the water supplier service area.	System Description	Section 3.1
Section 3.3	10631(a)	Describe the climate of the service area of the supplier.	System Description	Section 3.2
Section 3.4	10631(a)	Provide population projections for 2025, 2030, 2035, 2040 and optionally 2045.	System Description	Section 3.3
Section 3.4.2	10631(a)	Describe other social, economic, and demographic factors affecting the supplier's water management planning.	System Description	Section 3.4
Sections 3.4 and 5.4	10631(a)	Indicate the current population of the service area.	System Description and Baselines and Targets	Section 3.3 & 4.4
Section 3.5	10631(a)	Describe the land uses within the service area.	System Description	Section 3.4
Section 4.2	10631(d)(1)	Quantify past, current, and projected water use, identifying the uses among water use sectors.	System Water Use	Section 4.1
Section 4.2.4	10631(d)(3)(C)	Retail suppliers shall provide data to show the distribution loss standards were met.	System Water Use	Appendix G Table 4-4
Section 4.2.6	10631(d)(4)(A)	In projected water use, include estimates of water savings from adopted codes, plans, and other policies or laws.	System Water Use	Section 4.2

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 4.2.6	10631(d)(4)(B)	Provide citations of codes, standards, ordinances, or plans used to make water use projections.	System Water Use	Section 4.2
Section 4.3.2.4	10631(d)(3)(A)	Report the distribution system water loss for each of the 5 years preceding the plan update.	System Water Use	Appendix G Table 4-4
Section 4.4	10631.1(a)	Include projected water use needed for lower income housing projected in the service area of the supplier.	System Water Use	Section 4, Table 4.7
Section 4.5	10635(b)	Demands under climate change considerations must be included as part of the drought risk assessment.	System Water Use	Section 6.8
Chapter 5	10608.20(e)	Retail suppliers shall provide baseline daily per capita water use, urban water use target, interim urban water use target, and compliance daily per capita water use, along with the bases for determining those estimates, including references to supporting data.	Baselines and Targets	Section 4.4
Chapter 5	10608.24(a)	Retail suppliers shall meet their water use target by December 31, 2020.	Baselines and Targets	Section 4.4
Section 5.2	10608.24(d)(2)	If the retail supplier adjusts its compliance GPCD using weather normalization, economic adjustment, or extraordinary events, it shall provide the basis for, and data supporting the adjustment.	Baselines and Targets	N/A
Section 5.5	10608.22	Retail suppliers' per capita daily water use reduction shall be no less than 5 percent of base daily per capita water use of the 5-year baseline. This does not apply if the suppliers base GPCD is at or below 100.	Baselines and Targets	Section 4.4

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 5.5 and Appendix E	10608.4	Retail suppliers shall report on their compliance in meeting their water use targets. The data shall be reported using a standardized form in the SBX7-7 2020 Compliance Form.	Baselines and Targets	Compliance tables are in Appendix G
Sections 6.1 and 6.2	10631(b)(1)	Provide a discussion of anticipated supply availability under a normal, single dry year, and a drought lasting five years, as well as more frequent and severe periods of drought.	System Supplies	Section 6.1
Sections 6.1	10631(b)(1)	Provide a discussion of anticipated supply availability under a normal, single dry year, and a drought lasting five years, as well as more frequent and severe periods of drought, including changes in supply due to climate change.	System Supplies	Section 6.1
Section 6.1	10631(b)(2)	When multiple sources of water supply are identified, describe the management of each supply in relationship to other identified supplies.	System Supplies	N/A
Section 6.1.1	10631(b)(3)	Describe measures taken to acquire and develop planned sources of water.	System Supplies	Sections 5.4, 5.5, 5.6
Section 6.2.8	10631(b)	Identify and quantify the existing and planned sources of water available for 2020, 2025, 2030, 2035, 2040 and optionally 2045.	System Supplies	Sections 5.4, 5.5, 5.6, Appendix G Table 6-9
Section 6.2	10631(b)	Indicate whether groundwater is an existing or planned source of water available to the supplier.	System Supplies	Section 5.1, 5.2
Section 6.2.2	10631(b)(4)(A)	Indicate whether a groundwater sustainability plan or groundwater management plan has been adopted by the water supplier or if there is any other specific authorization for groundwater management. Include a copy of the plan or authorization.	System Supplies	Section 5.2

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 6.2.2	10631(b)(4)(B)	Describe the groundwater basin.	System Supplies	Section 5.2
Section 6.2.2	10631(b)(4)(B)	Indicate if the basin has been adjudicated and include a copy of the court order or decree and a description of the amount of water the supplier has the legal right to pump.	System Supplies	N/A
Section 6.2.2.1	10631(b)(4)(B)	For unadjudicated basins, indicate whether or not the department has identified the basin as a high or medium priority. Describe efforts by the supplier to coordinate with sustainability or groundwater agencies to achieve sustainable groundwater conditions.	System Supplies	Section 5.2
Section 6.2.2.4	10631(b)(4)(C)	Provide a detailed description and analysis of the location, amount, and sufficiency of groundwater pumped by the urban water supplier for the past five years	System Supplies	Section 5.2
Section 6.2.2	10631(b)(4)(D)	Provide a detailed description and analysis of the amount and location of groundwater that is projected to be pumped.	System Supplies	Section 5.2
Section 6.2.7	10631(c)	Describe the opportunities for exchanges or transfers of water on a short-term or long-term basis.	System Supplies	Section 5.3
Section 6.2.5	10633(b)	Describe the quantity of treated wastewater that meets recycled water standards, is being discharged, and is otherwise available for use in a recycled water project.	System Supplies (Recycled Water)	Section 5.5
Section 6.2.5	10633(c)	Describe the recycled water currently being used in the supplier's service area.	System Supplies (Recycled Water)	Section 5.5
Section 6.2.5	10633(d)	Describe and quantify the potential uses of recycled water and provide a determination of the technical and economic feasibility of those uses.	System Supplies (Recycled Water)	Section 5.5

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 6.2.5	10633(e)	Describe the projected use of recycled water within the supplier's service area at the end of 5, 10, 15, and 20 years, and a description of the actual use of recycled water in comparison to uses previously projected.	System Supplies (Recycled Water)	Section 5.5, Appendix G Tables 6-4, 6-5, 6-6
Section 6.2.5	10633(f)	Describe the actions which may be taken to encourage the use of recycled water and the projected results of these actions in terms of acre-feet of recycled water used per year.	System Supplies (Recycled Water)	Section 5.6
Section 6.2.5	10633(g)	Provide a plan for optimizing the use of recycled water in the supplier's service area.	System Supplies (Recycled Water)	Section 5.6
Section 6.2.6	10631(g)	Describe desalinated water project opportunities for long-term supply.	System Supplies	Section 5.7
Section 6.2.5	10633(a)	Describe the wastewater collection and treatment systems in the supplier's service area with quantified amount of collection and treatment and the disposal methods.	System Supplies (Recycled Water)	Section 5.6
Section 6.2.8, Section 6.3.7	10631(f)	Describe the expected future water supply projects and programs that may be undertaken by the water supplier to address water supply reliability in average, single-dry, and for a period of drought lasting 5 consecutive water years.	System Supplies	Sections 5.5, 5.6, 5.7
Section 6.4 and Appendix O	10631.2(a)	The UWMP must include energy information, as stated in the code, that a supplier can readily obtain.	System Suppliers, Energy Intensity	Appendix I
Section 7.2	10634	Provide information on the quality of existing sources of water available to the supplier and the manner in which water quality affects water management strategies and supply reliability	Water Supply Reliability Assessment	Section 5.2.5, 5.2.6 & 6.2

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 7.2.4	10620(f)	Describe water management tools and options to maximize resources and minimize the need to import water from other regions.	Water Supply Reliability Assessment	N/A – no imported supply.
Section 7.3	10635(a)	Service Reliability Assessment: Assess the water supply reliability during normal, dry, and a drought lasting five consecutive water years by comparing the total water supply sources available to the water supplier with the total projected water use over the next 20 years.	Water Supply Reliability Assessment	Section 6.4
Section 7.3	10635(b)	Provide a drought risk assessment as part of information considered in developing the demand management measures and water supply projects.	Water Supply Reliability Assessment	Section 6.7
Section 7.3	10635(b)(1)	Include a description of the data, methodology, and basis for one or more supply shortage conditions that are necessary to conduct a drought risk assessment for a drought period that lasts 5 consecutive years.	Water Supply Reliability Assessment	Section 6.1
Section 7.3	10635(b)(2)	Include a determination of the reliability of each source of supply under a variety of water shortage conditions.	Water Supply Reliability Assessment	Section 6.1
Section 7.3	10635(b)(3)	Include a comparison of the total water supply sources available to the water supplier with the total projected water use for the drought period.	Water Supply Reliability Assessment	Section 6.1
Section 7.3	10635(b)(4)	Include considerations of the historical drought hydrology, plausible changes on projected supplies and demands under climate change conditions, anticipated regulatory changes, and other locally applicable criteria.	Water Supply Reliability Assessment	Section 6.1

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Chapter 8	10632(a)	Provide a water shortage contingency plan (WSCP) with specified elements below.	Water Shortage Contingency Planning	Section 6.5 & Appendix F
Chapter 8	10632(a)(1)	Provide the analysis of water supply reliability (from Chapter 7 of Guidebook) in the WSCP	Water Shortage Contingency Planning	Section 6.8
Section 8.10	10632(a)(10)	Describe reevaluation and improvement procedures for monitoring and evaluation the water shortage contingency plan to ensure risk tolerance is adequate and appropriate water shortage mitigation strategies are implemented.	Water Shortage Contingency Planning	Section 6.5.2 & Appendix F
Section 8.2	10632(a)(2)(A)	Provide the written decision-making process and other methods that the supplier will use each year to determine its water reliability.	Water Shortage Contingency Planning	Appendix F
Section 8.2	10632(a)(2)(B)	Provide data and methodology to evaluate the supplier's water reliability for the current year and one dry year pursuant to factors in the code.	Water Shortage Contingency Planning	Section 6.8
Section 8.3	10632(a)(3)(A)	Define six standard water shortage levels of 10, 20, 30, 40, 50 percent shortage and greater than 50 percent shortage. These levels shall be based on supply conditions, including percent reductions in supply, changes in groundwater levels, changes in surface elevation, or other conditions. The shortage levels shall also apply to a catastrophic interruption of supply.	Water Shortage Contingency Planning	Section 6.5, Appendix F & Appendix G Table 8.1
Section 8.3	10632(a)(3)(B)	Suppliers with an existing water shortage contingency plan that uses different water shortage levels must cross reference their categories with the six standard categories.	Water Shortage Contingency Planning	Appendix G Table 8.1

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 8.4	10632(a)(4)(A)	Suppliers with water shortage contingency plans that align with the defined shortage levels must specify locally appropriate supply augmentation actions.	Water Shortage Contingency Planning	Appendix G Table 8.3
Section 8.4	10632(a)(4)(B)	Specify locally appropriate demand reduction actions to adequately respond to shortages.	Water Shortage Contingency Planning	Appendix G Table 8.2
Section 8.4	10632(a)(4)(C)	Specify locally appropriate operational changes.	Water Shortage Contingency Planning	Appendix F
Section 8.4	10632(a)(4)(D)	Specify additional mandatory prohibitions against specific water use practices that are in addition to state-mandated prohibitions are appropriate to local conditions.	Water Shortage Contingency Planning	Section 6.5 & Appendix F
Section 8.4	10632(a)(4)(E)	Estimate the extent to which the gap between supplies and demand will be reduced by implementation of the action.	Water Shortage Contingency Planning	Section 6.5 and Appendix G Table 8-2
Section 8.4.6	10632.5	The plan shall include a seismic risk assessment and mitigation plan.	Water Shortage Contingency Plan	Section 6.6 & Appendix E.4
Section 8.5	10632(a)(5)(A)	Suppliers must describe that they will inform customers, the public and others regarding any current or predicted water shortages.	Water Shortage Contingency Planning	Section 6.5 & Appendix F
Section 8.5 and 8.6	10632(a)(5)(B) 10632(a)(5)(C)	Suppliers must describe that they will inform customers, the public and others regarding any shortage response actions triggered or anticipated to be triggered and other relevant communications.	Water Shortage Contingency Planning	Section 6.5 & Appendix F
Section 8.6	10632(a)(6)	Retail supplier must describe how it will ensure compliance with and enforce provisions of the WSCP.	Water Shortage Contingency Planning	Section 6.5 & Appendix F
Section 8.7	10632(a)(7)(A)	Describe the legal authority that empowers the supplier to enforce shortage response actions.	Water Shortage Contingency Planning	Appendix F

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 8.7	10632(a)(7)(B)	Provide a statement that the supplier will declare a water shortage emergency Water Code Chapter 3.	Water Shortage Contingency Planning	Appendix F
Section 8.7	10632(a)(7)(C)	Provide a statement that the supplier will coordinate with any city or county within which it provides water for the possible proclamation of a local emergency.	Water Shortage Contingency Planning	Appendix F
Section 8.8	10632(a)(8)(A)	Describe the potential revenue reductions and expense increases associated with activated shortage response actions.	Water Shortage Contingency Planning	Section 6.5.4 & Appendix F
Section 8.8	10632(a)(8)(B)	Provide a description of mitigation actions needed to address revenue reductions and expense increases associated with activated shortage response actions.	Water Shortage Contingency Planning	Appendix F
Section 8.8	10632(a)(8)(C)	Retail suppliers must describe the cost of compliance with Water Code Chapter 3.3: Excessive Residential Water Use During Drought	Water Shortage Contingency Planning	Appendix F
Section 8.9	10632(a)(9)	Retail suppliers must describe the monitoring and reporting requirements and procedures that ensure appropriate data is collected, tracked, and analyzed for purposes of monitoring customer compliance.	Water Shortage Contingency Planning	Appendix F
Section 8.11	10632(b)	Analyze and define water features that are artificially supplied with water, including ponds, lakes, waterfalls, and fountains, separately from swimming pools and spas.	Water Shortage Contingency Planning	Section 6.5 & Appendix F
Sections 8.12 and 10.4	10635(c)	Provide supporting documentation that Water Shortage Contingency Plan has been, or will be, provided to any city or county within which it provides water, no later than 30 days after the submission of the plan to DWR.	Plan Adoption, Submittal, and Implementation	WSCP is in Appendix F of the UWMP, which is provided to cities and county

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 8.14	10632(c)	Make available the Water Shortage Contingency Plan to customers and any city or county where it provides water within 30 after adopted the plan.	Water Shortage Contingency Planning	WSCP/UWMP is available on MCWD's website
Sections 9.2 and 9.3	10631(e)(1)	Retail suppliers shall provide a description of the nature and extent of each demand management measure implemented over the past five years. The description will address specific measures listed in code.	Demand Management Measures	Section 7.2
Chapter 10	10608.26(a)	Retail suppliers shall conduct a public hearing to discuss adoption, implementation, and economic impact of water use targets (recommended to discuss compliance).	Plan Adoption, Submittal, and Implementation	Targets were adopted in 2011. Hearing was May 10, 2011
Section 10.2.1	10621(b)	Notify, at least 60 days prior to the public hearing, any city or county within which the supplier provides water that the urban water supplier will be reviewing the plan and considering amendments or changes to the plan. Reported in Table 10-1.	Plan Adoption, Submittal, and Implementation	Notices sent in January 2021. See Appendix D
Section 10.4	10621(f)	Each urban water supplier shall update and submit its 2020 plan to the department by July 1, 2021.	Plan Adoption, Submittal, and Implementation	Scheduled for adoption at the 6/21/2021 board meeting
Sections 10.2.2, 10.3, and 10.5	10642	Provide supporting documentation that the urban water supplier made the plan and contingency plan available for public inspection, published notice of the public hearing, and held a public hearing about the plan and contingency plan.	Plan Adoption, Submittal, and Implementation	Notices are in Appendix D
Section 10.2.2	10642	The water supplier is to provide the time and place of the hearing to any city or county within which the supplier provides water.	Plan Adoption, Submittal, and Implementation	Notices are in Appendix D

2020 Guidebook Location	Water Code Section	Summary as Applies to UWMP	Subject	2020 UWMP Location
Section 10.3.2	10642	Provide supporting documentation that the plan and contingency plan has been adopted as prepared or modified.	Plan Adoption, Submittal, and Implementation	Resolution of adoption is in Appendix A
Section 10.4	10644(a)	Provide supporting documentation that the urban water supplier has submitted this UWMP to the California State Library.	Plan Adoption, Submittal, and Implementation	Transmittal is in Appendix D
Section 10.4	10644(a)(1)	Provide supporting documentation that the urban water supplier has submitted this UWMP to any city or county within which the supplier provides water no later than 30 days after adoption.	Plan Adoption, Submittal, and Implementation	Transmittal is in Appendix D
Sections 10.4.1 and 10.4.2	10644(a)(2)	The plan, or amendments to the plan, submitted to the department shall be submitted electronically.	Plan Adoption, Submittal, and Implementation	Electronic submission will be made in July 2021
Section 10.5	10645(a)	Provide supporting documentation that, not later than 30 days after filing a copy of its plan with the department, the supplier has or will make the plan available for public review during normal business hours.	Plan Adoption, Submittal, and Implementation	Plan will be posted to the District website
Section 10.5	10645(b)	Provide supporting documentation that, not later than 30 days after filing a copy of its water shortage contingency plan with the department, the supplier has or will make the plan available for public review during normal business hours.	Plan Adoption, Submittal, and Implementation	Plan will be posted to the District website
Section 10.6	10621(c)	If supplier is regulated by the Public Utilities Commission, include its plan and contingency plan as part of its general rate case filings.	Plan Adoption, Submittal, and Implementation	N/A
Section 10.7.2	10644(b)	If revised, submit a copy of the water shortage contingency plan to DWR within 30 days of adoption.	Plan Adoption, Submittal, and Implementation	N/A

Appendix H: Standardized Data Tables and SB X7-7 Verification and Compliance Forms

The following tables are provided, as required by the Department of Water Resources 2020 UWMP Guidebook for Urban Water Suppliers. Only the tables applicable to MCWD are included, as listed below.

DWR Reporting Tables: 2-1, 2-2, 2-3, 2-4, 3-1, 4-1, 4-2, 4-3, 4-4, 4-5, 5-1, 5-2, 6-1, 6-2, 6-3, 6-4, 6-5, 6-6, 6-7, 6-8, 6-8ds, 6-9, 7-1, 7-2, 7-3, 7-4, 8-1, 8-2, 8-3, 10-1

SB X7-7 Verification Tables (from 2015 UWMP): 0, 1, 2, 3, 4, 4-A, 5, 6, 7, 7-E, 7-F, 8, 9

SB X7-7 Compliance Tables: 0, 2, 3, 4, 4-A, 5, 9

Submittal Table 2-1 Retail Only: Public Water Systems			
Public Water System Number	Public Water System Name	Number of Municipal Connections 2020	Volume of Water Supplied 2020 *
<i>Add additional rows as needed</i>			
CA 2710017	Marina Coast Water District	9,442	3,102
CA 2790009	MCWD - Recycled	-	0
TOTAL		9,442	3,102
* Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.			
NOTES:			

Submittal Table 2-2: Plan Identification		
Select Only One	Type of Plan	Name of RUWMP or Regional Alliance <i>if applicable</i> (select from drop down list)
<input checked="" type="checkbox"/>	Individual UWMP	
	<input type="checkbox"/>	Water Supplier is also a member of a RUWMP
	<input type="checkbox"/>	Water Supplier is also a member of a Regional Alliance
<input type="checkbox"/>	Regional Urban Water Management Plan (RUWMP)	
NOTES:		

Submittal Table 2-3: Supplier Identification	
Type of Supplier (select one or both)	
<input type="checkbox"/>	Supplier is a wholesaler
<input checked="" type="checkbox"/>	Supplier is a retailer
Fiscal or Calendar Year (select one)	
<input checked="" type="checkbox"/>	UWMP Tables are in calendar years
<input type="checkbox"/>	UWMP Tables are in fiscal years
If using fiscal years provide month and date that the fiscal year begins (mm/dd)	
Units of measure used in UWMP * (select from drop down)	
Unit	AF
<i>* Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.</i>	
NOTES:	

Submittal Table 2-4 Retail: Water Supplier Information Exchange
The retail Supplier has informed the following wholesale supplier(s) of projected water use in accordance with Water Code Section 10631.
Wholesale Water Supplier Name
<i>Add additional rows as needed</i>
Monterey One Water, System No. CA 2790002
NOTES:

Submittal Table 3-1 Retail: Population - Current and Projected						
Population Served	2020	2025	2030	2035	2040	2045(opt)
	36,646	50,131	58,012	66,717	73,183	
NOTES:						

Submittal Table 4-3 Retail: Total Water Use (Potable and Non-Potable)						
	2020	2025	2030	2035	2040	2045 (opt)
Potable Water, Raw, Other Non-potable <i>From Tables 4-1R and 4-2 R</i>	3,291	5,851	7,299	8,189	8,764	0
Recycled Water Demand ¹ <i>From Table 6-4</i>	0	600	953	1,140	1,270	0
Optional Deduction of Recycled Water Put Into Long-Term Storage ²						
TOTAL WATER USE	3,291	6,451	8,252	9,329	10,034	0
<p>¹ Recycled water demand fields will be blank until Table 6-4 is complete ² Long term storage means water placed into groundwater or surface storage that is not removed from storage in the same year. Supplier may deduct recycled water placed in long-term storage from their reported demand. This value is manually entered into Table 4-3.</p>						
<p>NOTES: 450 AFY of recycled water use is in lieu recharge for the Seaside Groundwater Basin. The City of Seaside will be providing an equal volume of potable supply in exchange.</p>						

Submittal Table 4-4 Retail: Last Five Years of Water Loss Audit Reporting

Reporting Period Start Date (mm/yyyy)	Volume of Water Loss ^{1,2}
01/2016	240.8
01/2017	260.3
01/2018	353.8
01/2019	342.6
01/2020	190.3

¹ Taken from the field "Water Losses" (a combination of apparent losses and real losses) from the AWWA worksheet. ²
Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.

NOTES: Year 2020 value is gross water loss. Auditted annual reprot has not yet been rprepared.

Submittal Table 4-5 Retail Only: Inclusion in Water Use Projections	
<p style="text-align: center;">Are Future Water Savings Included in Projections? (Refer to Appendix K of UWMP Guidebook) <i>Drop down list (y/n)</i></p>	No
<p>If "Yes" to above, state the section or page number, in the cell to the right, where citations of the codes, ordinances, or otherwise are utilized in demand projections are found.</p>	
<p style="text-align: center;">Are Lower Income Residential Demands Included In Projections? <i>Drop down list (y/n)</i></p>	Yes
<p>NOTES:</p>	

Submittal Table 5-1 Baselines and Targets Summary
From SB X7-7 Verification Form
Retail Supplier or Regional Alliance Only

Baseline Period	Start Year *	End Year *	Average Baseline GPCD*	Confirmed 2020 Target*
10-15 year	1999	2008	135	117
5 Year	2008	2008	133	

**All cells in this table should be populated manually from the supplier's SBX7-7 Verification Form and reported in Gallons per Capita per Day (GPCD)*

NOTES:

Submittal Table 5-2: 2020 Compliance SB X7-7 2020 Compliance Form <i>Retail Supplier or Regional Alliance Only</i>				From
2020 GPCD			2020 Confirmed Target GPCD*	Did Supplier Achieve Targeted Reduction for 2020? Y/N
Actual 2020 GPCD*	2020 TOTAL Adjustments*	Adjusted 2020 GPCD* <i>(Adjusted if applicable)</i>		
80.2	0	80.2	117	YES
<i>*All cells in this table should be populated manually from the supplier's SBX7-7 2020 Compliance Form and reported in Gallons per Capita per Day (GPCD)</i>				
NOTES:				

Submittal Table 6-1 Retail: Groundwater Volume Pumped						
<input type="checkbox"/>	Supplier does not pump groundwater. The supplier will not complete the table below.					
<input type="checkbox"/>	All or part of the groundwater described below is desalinated.					
Groundwater Type <i>Drop Down List</i> May use each category multiple times	Location or Basin Name	2016*	2017*	2018*	2019*	2020*
<i>Add additional rows as needed</i>						
Alluvial Basin	SVGB - Monterey Subbasin	3025	3238.6	3404.9	3189.5	3291.4
	TOTAL	3,025	3,239	3,405	3,190	3,291
* Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.						
NOTES:						

Submittal Table 6-2 Retail: Wastewater Collected Within Service Area in 2020						
<input type="checkbox"/>	There is no wastewater collection system. The supplier will not complete the table below.					
100	Percentage of 2020 service area covered by wastewater collection system <i>(optional)</i>					
100	Percentage of 2020 service area population covered by wastewater collection system <i>(optional)</i>					
Wastewater Collection			Recipient of Collected Wastewater			
Name of Wastewater Collection Agency	Wastewater Volume Metered or Estimated? <i>Drop Down List</i>	Volume of Wastewater Collected from UWMP Service Area 2020 *	Name of Wastewater Treatment Agency Receiving Collected Wastewater	Treatment Plant Name	Is WWTP Located Within UWMP Area? <i>Drop Down List</i>	Is WWTP Operation Contracted to a Third Party? <i>(optional)</i> <i>Drop Down List</i>
MCWD-Marina	Metered	1,205	Monterey One Water	M1W Regional Treatment Plant	No	No
MCWD-Ord	Metered	970	Monterey One Water	M1W Regional Treatment Plant	No	No
MCWD-Airport	Estimated	4	Monterey One Water	M1W Regional Treatment Plant	No	No
Total Wastewater Collected from Service Area in 2020:		2,179				
* Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3 .						
NOTES: two non-residential sites are on septic, but account for less than 0.1% of total annual water use.						

Submittal Table 6-3 Retail: Wastewater Treatment and Discharge Within Service Area in 2020											
<input checked="" type="checkbox"/> No wastewater is treated or disposed of within the UWMP service area. The supplier will not complete the table below.											
Wastewater Treatment Plant Name	Discharge Location Name or Identifier	Discharge Location Description	Wastewater Discharge ID Number (optional) ²	Method of Disposal <i>Drop down list</i>	Does This Plant Treat Wastewater Generated Outside the Service Area? <i>Drop down list</i>	Treatment Level <i>Drop down list</i>	2020 volumes ¹				
							Wastewater Treated	Discharged Treated Wastewater	Recycled Within Service Area	Recycled Outside of Service Area	Instream Flow Permit Requirement
Total							0	0	0	0	0

¹ Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.

² If the **Wastewater Discharge ID Number** is not available to the UWMP preparer, access the SWRCB CIWQS regulated facility website at <https://ciwqs.waterboards.ca.gov/ciwqs/readOnly/CiwqsReportServlet?inCommand=reset&reportName=RegulatedFacility>

NOTES:

Submittal Table 6-4 Retail: Recycled Water Direct Beneficial Uses Within Service Area											
<input type="checkbox"/> Recycled water is not used and is not planned for use within the service area of the supplier. The supplier will not complete the table below.											
Name of Supplier Producing (Treating) the Recycled Water:			Monterey One Water, System CA 279002								
Name of Supplier Operating the Recycled Water Distribution System:			Marina Coast Water District, System CA 2790009								
Supplemental Water Added in 2020 (volume) <i>Include units</i>			0 AF								
Source of 2020 Supplemental Water			NA								
Beneficial Use Type <i>additional rows if needed.</i>	<i>Insert</i>	Potential Beneficial Uses of Recycled Water (Describe)	Amount of Potential Uses of Recycled Water (Quantity) <i>Include volume units¹</i>	General Description of 2020 Uses	Level of Treatment <i>Drop down list</i>	2020 ¹	2025 ¹	2030 ¹	2035 ¹	2040 ¹	2045 ¹ (opt)
Agricultural irrigation											
Landscape irrigation (exc golf courses)			1500 AF		Advanced	0	150	503	690	820	
Golf course irrigation			450 AF		Advanced	0	450	450	450	450	
Commercial use											
Industrial use											
Geothermal and other energy production											
Seawater intrusion barrier											
Recreational impoundment											
Wetlands or wildlife habitat											
Groundwater recharge (IPR)											
Reservoir water augmentation (IPR)											
Direct potable reuse											
Other (Description Required)											
Total:						0	600	953	1,140	1,270	0
2020 Internal Reuse						0					
¹ <i>Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.</i>											
NOTES: Golf course use is in lieu recharge for the Seaside Groundwater Basin. The City of Seaside will provide an equal volume of potable water bask to MCWD to supply City of Seaside developments.											

Submittal Table 6-5 Retail: 2015 UWMP Recycled Water Use Projection Compared to 2020 Actual		
<input type="checkbox"/>	Recycled water was not used in 2015 nor projected for use in 2020. The supplier will not complete the table below. If recycled water was not used in 2020, and was not predicted to be in 2015, then check the box and do not complete the table.	
Beneficial Use Type	2015 Projection for 2020 ¹	2020 Actual Use ¹
<i>Insert additional rows as needed.</i>		
Agricultural irrigation		
Landscape irrigation (exc golf courses)	150	0
Golf course irrigation	450	0
Commercial use		
Industrial use		
Geothermal and other energy production		
Seawater intrusion barrier		
Recreational impoundment		
Wetlands or wildlife habitat		
Groundwater recharge (IPR)		
Reservoir water augmentation (IPR)		
Direct potable reuse		
Other (Description Required)		
Total	600	0
¹ Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.		
NOTE: MCWD was still constructing the recycled water distribution system in 2020.		

Submittal Table 6-6 Retail: Methods to Expand Future Recycled Water Use			
<input type="checkbox"/>	Supplier does not plan to expand recycled water use in the future. Supplier will not complete the table below but will provide narrative explanation.		
	Provide page location of narrative in UWMP		
Name of Action	Description	Planned Implementation Year	Expected Increase in Recycled Water Use *
<i>Add additional rows as needed</i>			
RUWAP Phase 1	Build RW Distribution System	2022	150
RUWAP Phase 2	Expand Treatment Plant	2030	891
In lieu recharge	Replace GW use for golf course with RW	2022	450
Total			1,491
*Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.			
NOTES:			

Submittal Table 6-7 Retail: Expected Future Water Supply Projects or Programs						
<input type="checkbox"/>	No expected future water supply projects or programs that provide a quantifiable increase to the agency's water supply. Supplier will not complete the table below.					
<input type="checkbox"/>	Some or all of the supplier's future water supply projects or programs are not compatible with this table and are described in a narrative format.					
	Provide page location of narrative in the UWMP					
Name of Future Projects or Programs	Joint Project with other suppliers?		Description (if needed)	Planned Implementation Year	Planned for Use in Year Type <i>Drop Down List</i>	Expected Increase in Water Supply to Supplier* <i>This may be a range</i>
	<i>Drop Down List (y/n)</i>	<i>If Yes, Supplier Name</i>				
<i>Add additional rows as needed</i>						
RUWAP Phase 2	Yes	Monterey One Water	Recycled Water	2030	All Year Types	891
RUWAP Desalination	No		Seawater Desalination	2030	All Year Types	1,500
*Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.						
NOTES: RUWAP = Regional Urban Water Augmentation Project						

OPTIONAL Table 6-8ds: Source Water Desalination										
<input checked="" type="checkbox"/>	Neither groundwater nor surface water are reduced in salinity prior to distribution.									
Plant Name or Well ID	Plant Capacity	Intake Type <i>Drop down list</i>	Source Water Type <i>Drop down list</i>	Influent TDS	Brine Discharge <i>Drop down list</i>	Volume of Water Desalinated				
						2016	2017	2018	2019	2020
Total						0	0	0	0	0
*Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.										
Notes:										

Submittal Table 6-9 Retail: Water Supplies — Projected											
Water Supply	Additional Detail on Water Supply	Projected Water Supply * Report To the Extent Practicable									
		2025		2030		2035		2040		2045 (opt)	
		Reasonably Available Volume	Total Right or Safe Yield (optional)	Reasonably Available Volume	Total Right or Safe Yield (optional)	Reasonably Available Volume	Total Right or Safe Yield (optional)	Reasonably Available Volume	Total Right or Safe Yield (optional)	Reasonably Available Volume	Total Right or Safe Yield (optional)
Drop down list May use each category multiple times. These are the only water supply categories that will be recognized by the WUEdata online submittal tool											
Add additional rows as needed											
Groundwater (not desalinated)	SVGB-M, Central Marina	3,020	3,020	3,020	3,020	3,020	3,020	3,020	3,020		
Groundwater (not desalinated)	SVGB-M, Ord Community	6,600	6,600	6,600	6,600	6,600	6,600	6,600	6,600		
Groundwater (not desalinated)	SVGB-M, Armstrong Ranch	680	920	680	920	680	920	680	920		
Groundwater (not desalinated)	SVGB-M, CEMEX	500	500	500	500	500	500	500	500		
Exchanges	SVGB-S Golf Course	450	450	450	450	450	450	450	450		
Recycled Water	M1W - AWPf	600	600	953	1,427	1,140	1,427	1,270	1,427		
Desalinated Water - Groundwater	Seawater-intruded groundwater	0	0	0	0	394	1,500	483	1,500		
Total		11,850	12,090	12,203	12,917	12,784	14,417	13,003	14,417	0	0
*Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.											
NOTES: SVGB-M = Groundwater from Salinas Valley Groundwater Basin - Monterey Subbasin SVGB-S = Groundwater from Salinas Valley Groundwater Basin - Seaside Subbasin (exchange recycled water for golf course irrigation for potable supply)											

Submittal Table 7-1 Retail: Basis of Water Year Data (Reliability Assessment)			
Year Type	Base Year If not using a calendar year, type in the last year of the fiscal, water year, or range of years, for example, water year 2019-2020, use 2020	Available Supplies if Year Type Repeats	
		<input type="checkbox"/>	Quantification of available supplies is not compatible with this table and is provided elsewhere in the UWMP. Location _____
		<input checked="" type="checkbox"/>	Quantification of available supplies is provided in this table as either volume only, percent only, or both.
		Volume Available *	% of Average Supply
Average Year	2012	10900	100%
Single-Dry Year	2013	10900	100%
Consecutive Dry Years 1st Year	2013	10900	100%
Consecutive Dry Years 2nd Year	2014	10900	100%
Consecutive Dry Years 3rd Year	2015	10900	100%
Consecutive Dry Years 4th Year	2016	10900	100%
Consecutive Dry Years 5th Year	2017	10900	100%
<p><i>Supplier may use multiple versions of Table 7-1 if different water sources have different base years and the supplier chooses to report the base years for each water source separately. If a Supplier uses multiple versions of Table 7-1, in the "Note" section of each table, state that multiple versions of Table 7-1 are being used and identify the particular water source that is being reported in each table.</i></p>			
<p>*Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.</p>			
<p>NOTES: Table includes existing groundwater supply plus Phase 1 recycled water project</p>			

Submittal Table 7-2 Retail: Normal Year Supply and Demand Comparison					
	2025	2030	2035	2040	2045 (Opt)
Supply totals <i>(autofill from Table 6-9)</i>	11,850	12,203	12,784	13,003	0
Demand totals <i>(autofill from Table 4-3)</i>	6,451	8,252	9,329	10,034	0
Difference	5,399	3,951	3,455	2,969	0
NOTES:					

Submittal Table 7-3 Retail: Single Dry Year Supply and Demand Comparison					
	2025	2030	2035	2040	2045 (Opt)
Supply totals*	10,900	10,900	10,900	10,900	
Demand totals*	6,121	7958	9,056	9,775	
Difference	4,779	2,942	1,844	1,125	0
*Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.					
NOTES:					

Submittal Table 7-4 Retail: Multiple Dry Years Supply and Demand Comparison						
		2025*	2030*	2035*	2040*	2045* (Opt)
First year	Supply totals	10,900	10,900	10,900	10,900	
	Demand totals	6,121	7,958	9,056	9,775	
	Difference	4,779	2,942	1,844	1,125	0
Second year	Supply totals	10,900	10,900	10,900	10,900	
	Demand totals	5,401	7,022	7,991	8,625	
	Difference	5,499	3,878	2,909	2,275	0
Third year	Supply totals	10,900	10,900	10,900	10,900	
	Demand totals	4,741	6,164	7,014	7,571	
	Difference	6,159	4,736	3,886	3,329	0
Fourth year	Supply totals	10,900	10,900	10,900	10,900	
	Demand totals	4,621	6,008	6,837	7,379	
	Difference	6,279	4,892	4,063	3,521	0
Fifth year	Supply totals	10,900	10,900	10,900	10,900	
	Demand totals	4,621	6,008	6,837	7,379	
	Difference	6,279	4,892	4,063	3,521	0
Sixth year <i>(optional)</i>	Supply totals					
	Demand totals					
	Difference	0	0	0	0	0
<p>*Units of measure (AF, CCF, MG) must remain consistent throughout the UWMP as reported in Table 2-3.</p>						
<p>NOTES:</p>						

2021		Total
Total Water Use		3,535
Total Supplies		10,900
Surplus/Shortfall w/o WSCP Action		7,365
Planned WSCP Actions (use reduction and supply augmentation)		
WSCP - supply augmentation benefit		0
WSCP - use reduction savings benefit		0
Revised Surplus/(shortfall)		7,365
Resulting % Use Reduction from WSCP action		0%

2022		Total
Total Water Use		3,712
Total Supplies		10,900
Surplus/Shortfall w/o WSCP Action		7,188
Planned WSCP Actions (use reduction and supply augmentation)		
WSCP - supply augmentation benefit		0
WSCP - use reduction savings benefit		0
Revised Surplus/(shortfall)		7,188
Resulting % Use Reduction from WSCP action		0%

2023		Total
Total Water Use		3,898
Total Supplies		10,900
Surplus/Shortfall w/o WSCP Action		7,002
Planned WSCP Actions (use reduction and supply augmentation)		
WSCP - supply augmentation benefit		0
WSCP - use reduction savings benefit		0
Revised Surplus/(shortfall)		7,002
Resulting % Use Reduction from WSCP action		0%

2024	Total
Total Water Use	4,093
Total Supplies	10,900
Surplus/Shortfall w/o WSCP Action	6,807
Planned WSCP Actions (use reduction and supply augmentation)	
WSCP - supply augmentation benefit	0
WSCP - use reduction savings benefit	0
Revised Surplus/(shortfall)	6,807
Resulting % Use Reduction from WSCP action	0%

2025	Total
Total Water Use	4,297
Total Supplies	10,900
Surplus/Shortfall w/o WSCP Action	6,603
Planned WSCP Actions (use reduction and supply augmentation)	
WSCP - supply augmentation benefit	0
WSCP - use reduction savings benefit	0
Revised Surplus/(shortfall)	6,603
Resulting % Use Reduction from WSCP action	0%

Submittal Table 8-1 Water Shortage Contingency Plan Levels		
Shortage Level	Percent Shortage Range	Shortage Response Actions <i>(Narrative description)</i>
1	Up to 10%	Baseline: offer rebate and retrofit programs Baseline: Enforce restrictions on Water Waste Provide public information mailers, e-mails and media events Call for voluntary reductions of up to 10%
2	Up to 20%	Add call for voluntary reductions of up to 25% Increase public information campaign Increase enforcement of prohibitions on water waste
3	Up to 30%	Add mandatory restrictions at 25%: Establish water budgets per customer type Limit landscape watering to 2x/week if using potable water Budget large landscapes (golf/sports) to 80% of normal
4	Up to 40%	Add mandatory restrictions at 35%: Establish water budgets per customer type Limit landscape watering to 1x/week if using potable water Budget large landscapes (golf/sports) to 70% of normal
5	Up to 50%	All above plus hotel linen exchange limits, prohibit fountain filling, consider moratorium on new connections, limit vehicle washing
6	>50%	Add mandatory restrictions at 50%: No landscape watering with potable water Budget large landscapes to 60% of normal Add limits on hotel linen, pool/fountain filling, construction
NOTES: MCWD's WSCP has 5 stages of action: 1 = 0 - 10%, 2 = 10 - 25%, 3 = 25 - 35%, 4 = 35 - 50%, 5 > 50%		

Submittal Table 8-2: Demand Reduction Actions				
Shortage Level	Demand Reduction Actions <i>Drop down list</i> <i>These are the only categories that will be accepted by the WUEdata online submittal tool. Select those that apply.</i>	How much is this going to reduce the shortage gap? <i>Include units used (volume type or percentage)</i>	Additional Explanation or Reference <i>(optional)</i>	Penalty, Charge, or Other Enforcement? <i>For Retail Suppliers Only</i> <i>Drop Down List</i>
<i>Add additional rows as needed</i>				
1	Provide Rebates on Plumbing Fixtures and Devices	1%	Incentive Program	No
1	Provide Rebates for Landscape Irrigation Efficiency	0.50%	Incentive Program	No
1	Provide Rebates for Turf Replacement	0.50%	Incentive Program	No
1	Offer Water Use Surveys	0.50%	Customer Service	No
1	Landscape - Restrict or prohibit runoff from landscape irrigation	Baseline under District code		Yes
1	Landscape - Limit landscape irrigation to specific times	Baseline under District code		Yes
1	CII - Lodging establishment must offer opt out of linen service	Baseline under District code		Yes
1	CII - Restaurants may only serve water upon request	Baseline under District code		Yes
1	CII - Commercial kitchens required to use pre-rinse spray valves	Baseline under District code		Yes
1	Water Features - Restrict water use for decorative water features, such as fountains	Baseline under District code	Decorative features must recirculate, not once through	Yes
1	Pools and Spas - Require covers for pools and spas	Baseline under District code		Yes
1	Other - Customers must repair leaks, breaks, and malfunctions in a timely manner	Baseline under District code		Yes
1	Other - Require automatic shut of hoses	Baseline under District code		Yes
1	Other - Prohibit use of potable water for washing hard surfaces	Baseline under District code		Yes
1	Expand Public Information Campaign	7.50%	Voluntary reductions	No
2	Expand Public Information Campaign	17.50%	Voluntary reductions	No
3	Landscape - Limit landscape irrigation to specific days	8%	2 days/week	Yes
3	Landscape - Other landscape restriction or prohibition	20% reduction for Large landscapes (golf/sports fields)	No restriction on recycled water	Yes
3	Landscape - Prohibit certain types of landscape irrigation	1%	No irrigation of parkway strips and medians	Yes
3	Landscape - Limit landscape irrigation to specific days	Newly planted landscapes exception	3 days/week for 5 weeks, levels 3-6	Yes
3	Other water feature or swimming pool restriction	Prevents added use	No initial filling of new pools and spas	Yes
3	Other water feature or swimming pool restriction	Prevents added use	No initial filling of fountains over 20 gallons	Yes
3	Moratorium or Net Zero Demand Increase on New Connections	Prevents added use	May occur at Level 3 or later	Yes
3	Reduce System Water Loss	1%		No
3	Increase Water Waste Patrols	Enforcement of codes		Yes
3	Implement or Modify Drought Rate Structure or Surcharge	1%	May occur at Level 3 or later	Yes
3	Expand Public Information Campaign	added public noticing		No
4	Landscape - Limit landscape irrigation to specific days	16% (up from 8%)	1 day/week	Yes
4	Landscape - Other landscape restriction or prohibition	30% reduction for Large landscapes (golf/sports fields)	No reduction on recycled water	Yes
4	CII - Other CII restriction or prohibition	1% Limit linen exchange at hotels to once every 2 days		Yes
4	Decrease Line Flushing	0.50%		No
4	Other	5%, set water budgets for large customers		No
6	Landscape - Prohibit all landscape irrigation	24% (up from 16%)		Yes
6	Landscape - Other landscape restriction or prohibition	40% reduction for Large landscapes (golf/sports fields)		Yes
6	CII - Other CII restriction or prohibition	1.5% Limit linen exchange at hotels to once every 3 days		Yes
6	Other - Prohibit vehicle washing except at facilities using recycled or recirculating water	1%	Recycled water facilities still allowed	Yes
<p>NOTES: Shortage Level 1 programs continue in all levels. Shortage Level 2 to 5 actions continue into higher levels MCWD Stage 4 is 35% to 50% shortage, which is State Levels 4 and 5, so all actions are listed in Level 4</p>				

Submittal Table 8-3: Supply Augmentation and Other Actions			
Shortage Level	Supply Augmentation Methods and Other Actions by Water Supplier <i>Drop down list</i> <i>These are the only categories that will be accepted by the WUdata online submittal tool</i>	How much is this going to reduce the shortage gap? <i>Include units used (volume type or percentage)</i>	Additional Explanation or Reference <i>(optional)</i>
<i>Add additional rows as needed</i>			
6	Other Actions (describe)	10%	Purchase and distribute bottled water (catastrophic system failure)
6	Other Actions (describe)	Maintains existing supply	Add treatment if seawater intrusion approaches wells
NOTES: MCWD is self supplied with groundwater. Obtaining supply from adjacent jurisdictions is an option during a brief system failure but not during an extended drought which would affect all suppliers.			

Submittal Table 10-1 Retail: Notification to Cities and Counties		
City Name	60 Day Notice	Notice of Public Hearing
<i>Add additional rows as needed</i>		
Marina	Yes	Yes
Seaside	Yes	Yes
Del Rey Oaks	Yes	Yes
Monterey	Yes	Yes
County Name <i>Drop Down List</i>	60 Day Notice	Notice of Public Hearing
<i>Add additional rows as needed</i>		
Monterey County	Yes	Yes
NOTES:		

SB X7-7 Table 0: Units of Measure Used in UWMP*
(select one from the drop down list)

Acre Feet
<i>*The unit of measure must be consistent with Table 2-3</i>
NOTES:

SB X7-7 Table-1: Baseline Period Ranges			
Baseline	Parameter	Value	Units
10- to 15-year baseline period	2008 total water deliveries	4,102	Acre Feet
	2008 total volume of delivered recycled water	0	Acre Feet
	2008 recycled water as a percent of total deliveries	0.00%	Percent
	Number of years in baseline period ¹	10	Years
	Year beginning baseline period range	1999	
	Year ending baseline period range ²	2008	
5-year baseline period	Number of years in baseline period	5	Years
	Year beginning baseline period range	2004	
	Year ending baseline period range ³	2008	
¹ If the 2008 recycled water percent is less than 10 percent, then the first baseline period is a continuous 10-year period. If the amount of recycled water delivered in 2008 is 10 percent or greater, the first baseline period is a continuous 10- to 15-year period.			
² The ending year must be between December 31, 2004 and December 31, 2010.			
³ The ending year must be between December 31, 2007 and December 31, 2010.			
NOTES:			

SB X7-7 Table 2: Method for Population Estimates	
Method Used to Determine Population (may check more than one)	
<input checked="" type="checkbox"/>	1. Department of Finance (DOF) DOF Table E-8 (1990 - 2000) and (2000-2010) and DOF Table E-5 (2011 - 2015) when available
<input checked="" type="checkbox"/>	2. Persons-per-Connection Method
<input type="checkbox"/>	3. DWR Population Tool
<input type="checkbox"/>	4. Other DWR recommends pre-review
NOTES: Service area crosses multiple jurisdictions. All of the City of	

SB X7-7 Table 3: Service Area Population		
Year		Population
10 to 15 Year Baseline Population		
Year 1	1999	28,657
Year 2	2000	29,137
Year 3	2001	29,416
Year 4	2002	29,648
Year 5	2003	29,613
Year 6	2004	29,633
Year 7	2005	29,477
Year 8	2006	29,154
Year 9	2007	29,065
Year 10	2008	29,533
<i>Year 11</i>		
<i>Year 12</i>		
<i>Year 13</i>		
<i>Year 14</i>		
<i>Year 15</i>		
5 Year Baseline Population		
Year 1	2004	29,633
Year 2	2005	29,477
Year 3	2006	29,154
Year 4	2007	29,065
Year 5	2008	29,533
2015 Compliance Year Population		
2015		32,375
NOTES:		

SB X7-7 Table 4: Annual Gross Water Use *								
	Baseline Year <i>Fm SB X7-7 Table 3</i>	Volume Into Distribution System <i>Fm SB X7-7 Table(s) 4-A</i>	Deductions					Annual Gross Water Use
			Exported Water	Change in Dist. System Storage (+/-)	Indirect Recycled Water <i>Fm SB X7-7 Table 4-B</i>	Water Delivered for Agricultural Use	Process Water <i>Fm SB X7-7 Table(s) 4-D</i>	
10 to 15 Year Baseline - Gross Water Use								
Year 1	1999	4637	0	0	0	0	0	4,637
Year 2	2000	4671.2	0	0	0	0	0	4,671
Year 3	2001	4513	0	0	0	0	0	4,513
Year 4	2002	4442.8	0	0	0	0	0	4,443
Year 5	2003	4329.7	0	0	0	0	0	4,330
Year 6	2004	4684.6	0	0	0	0	0	4,685
Year 7	2005	4188.1	0	0	0	0	0	4,188
Year 8	2006	4295.3	0	-1	0	0	0	4,296
Year 9	2007	4563	0	0	0	0	0	4,563
Year 10	2008	4102.2	0	0	0	0	0	4,102
<i>Year 11</i>	0	0			0		0	0
<i>Year 12</i>	0	0			0		0	0
<i>Year 13</i>	0	0			0		0	0
<i>Year 14</i>	0	0			0		0	0
<i>Year 15</i>	0	0			0		0	0
10 - 15 year baseline average gross water use								2,962
5 Year Baseline - Gross Water Use								
Year 1	2004	4,685	0	0	0	0	0	4,685
Year 2	2005	4,188	0	0	0	0	0	4,188
Year 3	2006	4,295	0	0	0	0	0	4,295
Year 4	2007	4,563	0	0	0	0	0	4,563
Year 5	2008	4,102	0	0	0	0	0	4,102
5 year baseline average gross water use								4,367
2015 Compliance Year - Gross Water Use								
	2015	3,228	0	0	0	0	0	3,228
* NOTE that the units of measure must remain consistent throughout the UWMP, as reported in Table 2-3								
NOTES: All water supply from District-owned wells. Removed E tank in 2008 (250kgal)								

SB X7-7 Table 4-A: Volume Entering the Distribution System(s)				
Complete one table for each source.				
Name of Source		Salinas Valley Groundwater Basin		
This water source is:				
<input checked="" type="checkbox"/>	The supplier's own water source			
<input type="checkbox"/>	A purchased or imported source			
Baseline Year <i>Fm SB X7-7 Table 3</i>	Volume Entering Distribution System	Meter Error Adjustment* <i>Optional (+/-)</i>	Corrected Volume Entering Distribution System	
10 to 15 Year Baseline - Water into Distribution System				
Year 1	1999	4637		4,637
Year 2	2000	4671.2		4,671
Year 3	2001	4513		4,513
Year 4	2002	4442.8		4,443
Year 5	2003	4329.7		4,330
Year 6	2004	4684.6		4,685
Year 7	2005	4188.1		4,188
Year 8	2006	4295.3		4,295
Year 9	2007	4563		4,563
Year 10	2008	4102.2		4,102
Year 11	0			0
Year 12	0			0
Year 13	0			0
Year 14	0			0
Year 15	0			0
5 Year Baseline - Water into Distribution System				
Year 1	2004	4684.6		4,685
Year 2	2005	4188.1		4,188
Year 3	2006	4295.3		4,295
Year 4	2007	4563		4,563
Year 5	2008	4102.2		4,102
2015 Compliance Year - Water into Distribution System				
2015	3228.04			3,228
<i>* Meter Error Adjustment - See guidance in Methodology 1, Step 3 of Methodologies Document</i>				
NOTES:				

SB X7-7 Table 5: Gallons Per Capita Per Day (GPCD)				
Baseline Year <i>Fm SB X7-7 Table 3</i>		Service Area Population <i>Fm SB X7-7 Table 3</i>	Annual Gross Water Use <i>Fm SB X7-7 Table 4</i>	Daily Per Capita Water Use (GPCD)
10 to 15 Year Baseline GPCD				
Year 1	1999	28,657	4,637	144
Year 2	2000	29,137	4,671	143
Year 3	2001	29,416	4,513	137
Year 4	2002	29,648	4,443	134
Year 5	2003	29,613	4,330	131
Year 6	2004	29,633	4,685	141
Year 7	2005	29,477	4,188	127
Year 8	2006	29,154	4,296	132
Year 9	2007	29,065	4,563	140
Year 10	2008	29,533	4,102	124
<i>Year 11</i>	0	0	0	
<i>Year 12</i>	0	0	0	
<i>Year 13</i>	0	0	0	
<i>Year 14</i>	0	0	0	
<i>Year 15</i>	0	0	0	
10-15 Year Average Baseline GPCD				135
5 Year Baseline GPCD				
Baseline Year <i>Fm SB X7-7 Table 3</i>		Service Area Population <i>Fm SB X7-7 Table 3</i>	Gross Water Use <i>Fm SB X7-7 Table 4</i>	Daily Per Capita Water Use
Year 1	2004	29,633	4,685	141
Year 2	2005	29,477	4,188	127
Year 3	2006	29,154	4,295	132
Year 4	2007	29,065	4,563	140
Year 5	2008	29,533	4,102	124
5 Year Average Baseline GPCD				133
2015 Compliance Year GPCD				
2015		32,375	3,228	89
NOTES:				

SB X7-7 Table 6: Gallons per Capita per Day <i>Summary From Table SB X7-7 Table 5</i>	
10-15 Year Baseline GPCD	135
5 Year Baseline GPCD	133
2015 Compliance Year GPCD	89
NOTES:	

SB X7-7 Table 7: 2020 Target Method		
<i>Select Only One</i>		
Target Method		Supporting Documentation
<input type="checkbox"/>	Method 1	SB X7-7 Table 7A
<input type="checkbox"/>	Method 2	SB X7-7 Tables 7B, 7C, and 7D <i>Contact DWR for these tables</i>
<input checked="" type="checkbox"/>	Method 3	SB X7-7 Table 7-E
<input type="checkbox"/>	Method 4	Method 4 Calculator
NOTES:		

SB X7-7 Table 7-E: Target Method 3				
Agency May Select More Than One as Applicable	Percentage of Service Area in This Hydrological Region	Hydrologic Region	"2020 Plan" Regional Targets	Method 3 Regional Targets (95%)
<input type="checkbox"/>		North Coast	137	130
<input type="checkbox"/>		North Lahontan	173	164
<input type="checkbox"/>		Sacramento River	176	167
<input type="checkbox"/>		San Francisco Bay	131	124
<input type="checkbox"/>		San Joaquin River	174	165
<input checked="" type="checkbox"/>	100%	Central Coast	123	117
<input type="checkbox"/>		Tulare Lake	188	179
<input type="checkbox"/>		South Lahontan	170	162
<input type="checkbox"/>		South Coast	149	142
<input type="checkbox"/>		Colorado River	211	200
Target <i>(If more than one region is selected, this value is calculated.)</i>				117
NOTES:				

SB X7-7 Table 7-F: Confirm Minimum Reduction for 2020 Target			
5 Year Baseline GPCD <i>From SB X7-7 Table 5</i>	Maximum 2020 Target*	Calculated 2020 Target <i>Fm Appropriate Target Table</i>	Confirmed 2020 Target
133	126	117	117
<i>* Maximum 2020 Target is 95% of the 5 Year Baseline GPCD</i>			
NOTES:			

SB X7-7 Table 8: 2015 Interim Target GPCD		
Confirmed 2020 Target <i>Fm SB X7-7 Table 7-F</i>	10-15 year Baseline GPCD <i>Fm SB X7-7 Table 5</i>	2015 Interim Target GPCD
117	135	126
NOTES:		

SB X7-7 Table 9: 2015 Compliance								
Actual 2015 GPCD	2015 Interim Target GPCD	Optional Adjustments (in GPCD)					2015 GPCD (Adjusted if applicable)	Did Supplier Achieve Targeted Reduction for 2015?
		Extraordinary Events	Weather Normalization	Economic Adjustment	TOTAL Adjustments	Adjusted 2015 GPCD		
89	126	NA	NA	NA	0	89.01338654	89.01338654	YES
NOTES:								

SB X7-7 Table 0: Units of Measure Used in 2020 UWMP* <i>(select one from the drop down list)</i>
Acre Feet
<i>*The unit of measure must be consistent throughout the UWMP, as reported in Submittal Table 2-3.</i>
NOTES:

SB X7-7 Table 2: Method for 2020 Population Estimate	
Method Used to Determine 2020 Population (may check more than one)	
<input checked="" type="checkbox"/>	1. Department of Finance (DOF) or American Community Survey (ACS)
<input type="checkbox"/>	2. Persons-per-Connection Method
<input type="checkbox"/>	3. DWR Population Tool
<input type="checkbox"/>	4. Other DWR recommends pre-review
NOTES:	

SB X7-7 Table 3: 2020 Service Area Population	
2020 Compliance Year Population	
2020	36,646
NOTES:	

SB X7-7 Table 4: 2020 Gross Water Use							
Compliance Year 2020	2020 Volume Into Distribution System <i>This column will remain blank until SB X7-7 Table 4-A is completed.</i>	2020 Deductions					2020 Gross Water Use
		Exported Water *	Change in Dist. System Storage* (+/-)	Indirect Recycled Water <i>This column will remain blank until SB X7-7 Table 4-B is completed.</i>	Water Delivered for Agricultural Use*	Process Water <i>This column will remain blank until SB X7-7 Table 4-D is completed.</i>	
	3,291	-	-	-	-	-	3,291
<p>* Units of measure (AF, MG , or CCF) must remain consistent throughout the UWMP, as reported in SB X7-7 Table 0 and Submittal Table 2-3.</p> <p>NOTES: No deductions taken for indirect recycled or process water. Tables 4-B, 4-C and 4-D not used.</p>							

SB X7-7 Table 4-A: 2020 Volume Entering the Distribution System(s), Meter Error Adjustment

Complete one table for each source.

Name of Source		Salinas Valley Groundwater Basin, Monterey Subbasin	
This water source is (check one):			
<input checked="" type="checkbox"/>	The supplier's own water source		
<input type="checkbox"/>	A purchased or imported source		
Compliance Year 2020	Volume Entering Distribution System ¹	Meter Error Adjustment ² <i>Optional</i> (+/-)	Corrected Volume Entering Distribution System
	3,291	-	3,291
¹ <i>Units of measure (AF, MG, or CCF) must remain consistent throughout the UWMP, as reported in SB X7-7 Table 0 and Submittal Table 2-3.</i>			
² <i>Meter Error Adjustment - See guidance in Methodology 1, Step 3 of Methodologies Document</i>			
NOTES			

SB X7-7 Table 5: 2020 Gallons Per Capita Per Day (GPCD)

2020 Gross Water <i>Fm SB X7-7 Table 4</i>	2020 Population <i>Fm</i> <i>SB X7-7 Table 3</i>	2020 GPCD
3,291	36,646	80

NOTES:

SB X7-7 Table 9: 2020 Compliance							
Actual 2020 GPCD ¹	Optional Adjustments to 2020 GPCD					2020 Confirmed Target GPCD ^{1, 2}	Did Supplier Achieve Targeted Reduction for 2020?
	Enter "0" if Adjustment Not Used			TOTAL Adjustments ¹	Adjusted 2020 GPCD ¹ <i>(Adjusted if applicable)</i>		
	Extraordinary Events ¹	Weather Normalization ¹	Economic Adjustment ¹				
80	-	-	-	-	80	117	YES
¹ All values are reported in GPCD ² 2020 Confirmed Target GPCD is taken from the Supplier's SB X7-7 Verification Form Table SB X7-7, 7-F.							
NOTES:							

Appendix I: Voluntary Reporting of Energy Intensity

The MCWD water distribution system has five pressure zones, with eight water storage tanks and six booster pump stations. The District produces all of its water supply from groundwater wells. Treatment consists of chlorination to meet distribution system requirements. Some water is provided directly to customers in the lowest pressure zone, and the rest is boosted into the upper zones for storage and customer use. Power consumption for 2020 is tabulated below. Total water production for the year was 3,291 acre-feet. The portion of that supply boosted into the upper pressure zones was not metered or estimated.

2020 Water System Power Use

Component	kWh
Wells	1,936,251
Booster Pump Stations	1,064,802
SCADA (Controls)	20,000
Total	3,021,053

MCWD provides wastewater collection within its service area, but not treatment. Wastewater treatment is provided by Monterey One Water at the regional treatment plant. The MCWD wastewater collection system includes 20 pump stations. Power consumption for 2020 is tabulated below. Total wastewater conveyed for the year was 2,179 acre-feet.

2020 Wastewater System Power Use

Component	kWh
Lift Stations	335,732
SCADA	20,000
Total	355,732

DWR Standard Tables O-1A and O-2 are provided on the following pages.

Urban Water Supplier: Marina Coast Water District

Water Delivery Product (If delivering more than one type of product use Table O-1C)

Retail Potable Deliveries

12/31/2020

Table O-1A: Recommended Energy Reporting - Water Supply Process Approach									
Enter Start Date for Reporting Period	1/1/2020	Urban Water Supplier Operational Control							
End Date	12/31/2020	Water Management Process					Non-Consequential Hydropower (if applicable)		
<input type="checkbox"/> Is upstream embedded in the values reported?									
	Water Volume Units Used	Extract and Divert	Place into Storage	Conveyance	Treatment	Distribution	Total Utility	Hydropower	Net Utility
Volume of Water Entering Process	AF	3291.4				3291.4	3291.4		3291.4
Energy Consumed (kWh)	N/A	1936251				1084802	3021053		3021053
Energy Intensity (kWh/vol. converted to MG)	N/A	1805.4	0.0	0.0	0.0	1011.5	2816.8	0.0	2816.8
Quantity of Self-Generated Renewable Energy									
<u>0</u> kWh									
Data Quality (Estimate, Metered Data, Combination of Estimates and Metered Data)									
<u>Metered Data</u>									
Data Quality Narrative:									
Water production is metered at the wells. Extract and Divert power is sum of metered power use at the wells. Distribution power use is the sum of metered power use at the booster pump stations and central SCADA office.									
Narrative:									
All water supply comes from groundwater wells.									

Urban Water Supplier:

Marina Coast Water District

Table O-2: Recommended Energy Reporting - Wastewater & Recycled Water						
Enter Start Date for Reporting Period		1/1/2020	Urban Water Supplier Operational Control			
End Date		12/31/2020				
Water Management Process						
<input type="checkbox"/>	Is upstream embedded in the values reported?		Collection / Conveyance	Treatment	Discharge / Distribution	Total
Volume of Water Units Used		AF				
Volume of Wastewater Entering Process (volume units selected above)			2179			2179
Wastewater Energy Consumed (kWh)			355732			355732
Wastewater Energy Intensity (kWh/volume)			501.0	0.0	0.0	501.0
Volume of Recycled Water Entering Process (volume units selected above)						0
Recycled Water Energy Consumed (kWh)						0
Recycled Water Energy Intensity (kWh/volume converted to MG)			0.0	0.0	0.0	0.0

Quantity of Self-Generated Renewable Energy related to recycled water and wastewater operations

0 kWh

Data Quality (Estimate, Metered Data, Combination of Estimates and Metered Data)

Combination of Estimates and Metered Data

Data Quality Narrative:

Wastewater flows are metered at two of three points of connection into the regional wastewater system. The connection from the Airport is not metered, so flow is estimated as 50% of the metered water use within the site. Power use is the sum of metered power use at the lift stations and at the SCADA radio stations.

Narrative:

MCWD provides wastewater collection only. Wastewater is conveyed to the regional treatment plant through the M1W system. Flows are metered where they enter the regional system.

Appendix J: Comments Received on the Draft Plan

No verbal comment was submitted at the Public Hearing for the UWMP.

One comment letters was received:

1. California State University, Monterey Bay

The letter is on the following pages. Responses follow each letter.

Mr. Andrew Sterbenz, PE
Senior Project Manager
Schaaf & Wheeler Consulting Civil Engineers
3 Quail Run Circle, Suite 101
Salinas, CA 93907

6/18/2021

Subject: Marina Coast Water District, 2020 Draft Urban Water Management Plan dated 5/20/2021

Dear Mr. Sterbenz:

Thank you for the opportunity to provide comment on MCWD's Draft 2020 Urban Water Management Plan (UWMP). We appreciate the effort that has gone into the preparation of this draft, in particular the extent to which the document touches on the hydrological and regulatory history of the water supply in the geographical area. We also appreciate that the University was provided an earlier opportunity to comment on the usage forecast underlying the Districts analysis of the Universities medium term water requirements. At this time we would like to offer the following comments on the draft UWMP and its appendices in the interest of further improving the document. (note for ease of searching the page numbers listed here reflect the electronic pdf pagination and not the page numbers printed in the document)

- C1 Page 15 Table 1.2: The UWMP forecast of 977 AFY for CSUMB appears to have accurately incorporated CSUMB's comments relative to existing use and demand factors for the University's main campus occupancy types, however it is still carrying 256.25 AFY for an as yet undefined 2nd Ave. development. As previously commented, this development is still in the conceptual phase and the occupancy types for forecasting have not yet been decided. Depending on the occupancy types that are ultimately chosen this development could use significantly less than the 256.25 AFY forecasted in this UMWP. Given that the overall CSUMB forecast of 977 AFY is well within the Universities allocations and does not result in any shortfalls we suggest the plan be kept as is, but noting that the University retains full flexibility to work within its water allocations.
- C2 Page 20 section 2.4: It seems a bit premature to state a June 21, 2021 adoption date of the plan when the draft plan is still open for public comments, such comments would hopefully result in modification of the document, and the actual adoption occurs after a public hearing and a Board vote which are still in the future and whose outcomes are therefore uncertain. It would seem more appropriate to state the planned adoption process, and note that the copy of the ultimate resolution, which will have the true adoption date, will be included as appendix A.
- C3 Page 21, section 2.5
Bullet points 2: The Districts past estimations of proposed project water use having been prone to significant overestimation some opportunity for the Jurisdiction to review such Water Supply Assessment with the District would be appreciated.
Bullet points 3: The project plans and number of connections have no direct relationship to a Jurisdictions allocation in AFY. It is the estimated water use in AFY of the plans (as described in a Water Supply Assessment) that can be compared to an available, un-committed allocation balance in AFY. The University supports the District resolving discrepancies and withholding new connections as enforcement on a bilateral District-Affected Jurisdiction Basis.

- C4 Bullet points 4: The University supports the District monitoring the average water demand of developments and working with the project owners and affected Jurisdiction during development and with the affected Jurisdiction thereafter to resolve water usage exceeding the projects entitlement and or affected Jurisdictions allocation.
- C5 Page 23 section 3.1.2: While the base reuse plan may have included provisions for CSUMB this should not be written in a manner to in any way imply that FORA or the Base Reuse Plan resulted in the formation of CSUMB. CSUMB was formed independently of FOR A and received nearly all its lands directly from the USA. CSUMB operates as its own land use Jurisdiction and is not subject the planning or building authority of the underlying census tract.
- C6 Page 23 section 3.1.2: This text seems to identify the Cities and the county as Jurisdictions with lands while it appears the educational entities such as CSUMB are not included in the same category. CSUMB has lands and has land use jurisdiction over its lands. The separation being made in this section is not aligning with the other various tables of forecasts and allocations that show all entities having received water allocations under the heading "Jurisdictions". Later in the document all these are again treated in aggregate as "Jurisdictions" as in section 5.4. The document needs to be unambiguous on Entity/Jurisdiction, their allocations and the land areas within their control.
- C7 Page 30 Table 4.1: Please provide CSUMB a breakdown of the assignment of each of its accounts to water use sectors. This does not need to be reflected in the final UWMP.
- C8 Page 31 section 4.2.1: The inclusion of CSUMB areas in the City of Marina General Plan and associated water consumption estimates does not by extension imply that the City has any Jurisdiction over or claim to CSUMB's allocation of water as granted by FORA.
- C9 Page 34 section 4.2.3: On Campus uses specific to CSUMB: CSUMB builds Dormitories and Dinning Facilities separately and while aggregating their usage can be done for planning purposes it does not follow that these aggregated factors can be applied to individual projects of one type or the other. Additionally, CSUMB projected irrigation for Athletic venues where turf is used at 2.3 AFY/acre approximately in line with the factor the District shows in Table 4.4.
- C10 Page 35 After Table 4.4: It might be worth footnoting the difference between the State water conservation goal of 55 gpcd mentioned here and the SB X7-7 goals shown in table 4.9 which are on order of 117 gpcd.
- C11 Page 36 Table 4.5: see earlier comment on projection for CSUMB.
- C12 Page 36 last paragraph: The discussion of the Army housing projection seems to indicate that adjusting a demand factor for a child development center resulted in a 160 AFY swing in projected demanded for the child development center. This seems like an enormously large amount of water related to a single facility. Could there be a typographical error in the number shown ? or perhaps the number shown relates not just to a child development center but to an overall development project ? Please clarify.
- C13 Page 43 bullet point at the top: The District has published water and sewer master plans that include Capital Improvement Plans that are funded by both current users through rates and future users through capacity charges. It should not be implied that replacement of a significant amount of the aging distribution system will occur solely as a result of redevelopment, or be funded solely by redevelopment.
- C14 Page 71 section: 5.4 Future water supply: As water and recycled water allocations have been made on an Entity/Jurisdictional basis the text needs to make clear that each Entities/Jurisdictions shortfall will be met by using recycled water for landscape irrigation within that Entities/Jurisdictions area of planning control, (not census tract), ie the boundaries need to align with the land directly under planning control of the Entity/Jurisdiction and onto which the Entities/Jurisdictions water allocations (potable & recycled) can be applied. As it reads the text indicates that the aggregate shortfall, will be met by using recycled water for landscape irrigation, such use by definition and by virtue of the recycled allocations, not being in aggregate. The language as written implies a shifting of allocations between Jurisdictions as a result of recycled use which is not in keeping with the earlier parts of this document (page 21 2.5 Plan implementation bullet points 2,3,4) and is not acceptable.

- C15 Page 78 table 5.6: Please clarify or footnote if these “Non-Potable Water Demand Projections” are included in, or in addition to “Projected Water Demands by Jurisdiction” as shown in table 1.2 and other places. If these are included in Table 2.1 they might be better characterized as “Potential Non Potable conversions/uses” rather than demands.
- C16 Page 79 section 5.5.2 Pure Water Monterey Project: While the Pure water Monterey Project may function as an in lieu groundwater recharge project for purposes of the ground water sustainability plan the District should be cautious in allowing costs of this project to leak into standard water rates, having already concluded a recycled water sales agreement with the University that fully recovers the capital and operating cost of the project in the recycled water price agreed with the University.
- C17 Page 92: 6.5.4 Revenue and Expenditure Impacts: Full and honest disclosure would require that this document make mention that MCWD’s rate structure and adopted rates as listed here have been declared invalid in Monterey County Superior Court by the decision rendered in “Bay View Community DE, LLC” v. “Marina Coast Water District” case number 18CV000765, dated 8/20/2019.
- C18 Page 98 section 7.2.3 Conservation Pricing: Full and honest disclosure would require that this document make mention that MCWD’s rate structure, has been declared invalid in Monterey County Superior Court by the decision rendered in “Bay View Community DE, LLC” v. “Marina Coast Water District” case number 18CV000765, dated 8/20/2019, specifically because of flaws in the tiered scale. The court ruled that “Tier 2 customers subsidize Tier 1 customers by paying far more than their fair share. Consequently, the 2018 Rates violate Proposition 218”. It is therefore not clear whether conservation pricing can be achieved or maintained in a manner that does not violate proposition 218.

Comments on Appendices:

- C19 Page 45: The Ambag 2022 Subregional Growth Forecast seems to significantly understate CSUMB’s current population and plans. It indicates a 2020 population of 950, when CSUMB already has 7,000 students and is planning for 12,500 by 2035 at which point AMBAG projects only 3,475. CSUMB will try to address this with Ambag.
- C20 Page 47: Jurisdictional Water Allocations within the Ord Community. In 2001 the water and sewer infrastructure were transferred from the USA to FOR A to MCWD but the SVBG allocation remained with FOR A and only transferred to MCWD with the dissolution of FOR A and subject to FOR A’s allocation to the “Jurisdictions”. Please clarify the meaning of Jurisdiction to mean land use jurisdiction and recipient of FOR A allocation
- C21 Page 49: The Promontory apartments having been acquired by CSUMB including all entitlements, control over the City of Marina project specific allocation of 33.3 AFY for that project is under discussion between the University and the City.

We appreciate the opportunity to comment and provide input on this draft UMWP. Should any questions arise please feel free to contact me.

Sincerely,



Mike Lerch
Director of Energy & Utilities
California State University Monterey Bay

cc: Anya Spear, CSUMB; Marcel Forte, CSUMB; Glen Nelson, CSUMB; Lawrence Samuels, CSUMB
Patrick Breen, MCWD; Remleh Scherzinger, MCWD

Response to CSUMB Comments, dated 6/18/2021

1. Table 1.2. Comment acknowledged. No response required.
2. Section 2.4. The report was drafted with the proposed text for the final version, rather than leaving a blank in the sentence. If the plan had not been adopted on 6/21/2021, the date would have been corrected.
3. Section 2.5, second bullet: All water supply assessments are shared as a draft with the project proponent and the land use jurisdiction for review and comment prior to the final draft being published for public comment.
4. Section 2.5, third bullet: Jurisdictional water allocations are based on a certain project description. If the submitted plans are inconsistent with the original project description, the discrepancy should be identified and resolved before building permits are issued. Note that this is more applicable to water allocations for specific plan areas than for single-lot projects.
5. Section 2.5, fourth bullet: Comment acknowledged. No response required.
6. Section 3.1.2: The text is only intended to list the major recipients of land within the former Fort Ord.
7. Section 3.1.2: The text was revised to label cities and counties as Municipal Jurisdictions, and to point out that universities received lands within the former Fort Ord.
8. Table 4.1: The requested data Will be provided separately.
9. Section 4.2.1: The brief description of the City of Marina General Plan was included for information only. The analysis in this and previous Urban Water Management Plans reflects the universities as having independent water allocations and demand projections.
10. Section 4.2.3: Comment acknowledged. No response required.
11. Text following Table 4.4: The goal of 55 gallons per person per day is indoor demand. The target of 117 gpcd is system-wide usage, as explained later in the report.
12. Table 4.5: Comment acknowledged. No response required.
13. Section 4.2.4: In the 2015 UWMP, there was an error in the factor used for the Army's proposed child development center. Because the demand was aggregated with a larger housing area renovation, it did not stand out. The demand factor was corrected in this update.
14. Section 4.4.1: The portions of the former Fort Ord with old, unoccupied buildings (such as the wooden barracks areas) have the oldest water mains in the worst shape. When these areas are razed and rebuilt, the water and sewer mains are also replaced, thus removing leaking pipelines from the system. That is why it is listed as a water conservation activity.
15. Section 5.4: The text refers to Table 5.3, which shows shortages by jurisdiction. The plan does not
16. Table 5.6: Water demands in the report, unless specifically labeled, are total water demands. Non-potable demands are those which may be met with recycled water. The term non-

potable water demand is used in the DWR Guidelines for preparing Urban Water Management Plans, but within MCWD's service area, the only non-potable water demand is landscape irrigation.

17. Section 5.5.2 Comment acknowledged. No response required.
18. Section 6.5.4: The UWMP does not address the rate setting process.
19. Section 7.2.3: The UWMP does not address the rate setting process.
20. Appendix page 45: Please note that the AMBAG population forecast splits CSUMB between Marina and Seaside (likely due to the campus mailing address), so the total forecast in the year 2020 is 5,079 persons. A portion of the Campus housing is in the unincorporated county, so that may be the missing portion.
21. Appendix Page 47: The comment is incorrect. The quitclaim deed conveying the water and sewer infrastructure, easements and property on the former Fort Ord from FORA to MCWD did not withhold the underlying groundwater pumping rights. Those rights were conveyed to MCWD. Per the Water/Wastewater Facilities Agreement between FORA and MCWD, FORA had the responsibility to administer the allocation of groundwater rights among the jurisdictions, and they retained that role until they ceased to exist. MCWD now has the role of "accountant", keeping track of any exchanges between entities with water allocations on the former Fort Ord.
22. Appendix page 49: Comment acknowledged. We will continue to carry the water use and allocation under the City of Marina until the City and University notify us to move it.